

Order No: MAC0105011C3

# Service Manual

Room Air Conditioner

CS-A75KR CU-A75KR / CS-A95KR CU-A95KR / CS-A125KR  
CU-A125KR



© 2001 Matsushita Air-Conditioning Corp. Sdn. Bhd. (183914D).  
All rights reserved. Unauthorized copying and distribution is a  
violation of law.

## WARNING

This service information is designed for experienced repair technicians only and is not designed for use by the general public. It does not contain warnings or cautions to advise non-technical individuals of potential dangers in attempting to service a product. Products powered by electricity should be serviced or repaired only by experienced professional technicians. Any attempt to service or repair the product or products dealt with in this service information by anyone else could result in serious injury or death.

# Panasonic





## 1. Features

- High Efficiency
- Compact Design

- Comfort Environment
- 8 hours of sleep mode operation
- Air purifying filter with deodorizing function to reduce dust, smoke and odours
- Random Auto Restart
- Auto restart at randomly after power failure
- Removable and Washable Front Panel
- Remote Control-Self Illuminating Button
- Catechin Air Purifying Filter
- To trap dust, tobacco smoke and tiny particles in the room; to prevent the growth of bacteria and viruses trapped in this filter
- Deodorizing Filter
- Quality Improvement
- Gas leakage protection
- Prevent compressor reverse rotation
- 2-stage OLP to protect compressor
- Noise prevention during Soft Dry operation
- Service Improvement
- Easy fan motor replacement procedure
- Operation Improvement
- Economy mode to reduce electrical power consumption
- Powerful mode to reach the desired room temperature quickly
- Anti cold draft control
- Long Installation Piping
- CS/CU-A75KR, CS/CU-A95KR, long piping up to 10 meter
- CS/CU-A125KR, long piping up to 15 meter

## **2. Functions**

## **3. Product Specifications**

|                  | Unit                                                                                                                                                                                         | CS-A75KR                                                                                         | CU-A75                                                                                            |
|------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|
| Cooling Capacity | kW<br>BTU/h                                                                                                                                                                                  | 2.11 - 2.06<br>7,200 - 7,020                                                                     |                                                                                                   |
| Heating Capacity | kW<br>BTU/h                                                                                                                                                                                  | 2.30 - 2.25<br>7,840 - 7,670                                                                     |                                                                                                   |
| Moisture Removal | l/h<br>Pint/h                                                                                                                                                                                | 1.4<br>3.0                                                                                       |                                                                                                   |
| Power Source     | Phase<br>V<br>Cycle                                                                                                                                                                          | Single<br>240 - 220<br>50                                                                        |                                                                                                   |
| Airflow Method   | OUTLET<br><br>INTAKE<br> | SIDE VIEW<br> | TOP VIEW<br> |





|                 |                  |                   |                                                                  |                              |
|-----------------|------------------|-------------------|------------------------------------------------------------------|------------------------------|
| Air Volume      | Indoor Air (Lo)  | m3/min<br>(cfm)   | Cooling; 6.0 (210) - 5.7 (200)<br>Heating; 6.3 (220) - 6.1 (210) | —                            |
|                 | Indoor Air (Me)  | m3/min<br>(cfm)   | Cooling; 6.3 (220) - 6.1 (210)<br>Heating; 7.7 (270) - 7.4 (260) | —                            |
|                 | Indoor Air (Hi)  | m3/min<br>(cfm)   | Cooling; 7.7 (270) - 7.2 (250)<br>Heating; 8.6 (300) - 8.4 (300) | —                            |
|                 | Indoor Air (SHi) | m3/min<br>(cfm)   | Cooling; 8.5 (300) - 8.4 (300)<br>Heating; 8.6 (300) - 8.4 (300) | —                            |
| Noise Level     |                  | dB (A)            | Cooling; High 34-33, Low 26-26<br>Heating; High 36-35, Low 26-26 | Cooling; Hig<br>Heating; Hig |
|                 |                  | Power level<br>dB | Cooling; High 46-44, Low 37-38<br>Heating; High 48-48, Low 38-38 | Cooling; Hig<br>Heating; Hig |
| Electrical Data | Input            | W                 | Cooling; 660 - 610<br>Heating; 640 - 580                         |                              |
|                 | Running Current  | A                 | Cooling; 3.2 - 3.0<br>Heating; 3.0 - 2.8                         |                              |
|                 | EER              | W/W (BTU/hW)      | Cooling; 3.20 - 3.38 (10.9 - 11.5)                               |                              |
|                 | COP              | W/W (BTU/hW)      | Heating; 3.59 - 3.88 (12.3 - 13.2)                               |                              |
|                 | Starting Current | A                 | 11.2                                                             |                              |



|                                          |                  |              |                                                   |                                                  |
|------------------------------------------|------------------|--------------|---------------------------------------------------|--------------------------------------------------|
| Piping Connection Port<br>(Flare piping) |                  | inch<br>inch | G ; Half Union 3/8"<br>L ; Half Union 1/4"        | G ; 3-way va<br>L ; 2-way va                     |
| Pipe Size<br>(Flare piping)              |                  | inch<br>inch | G ; (gas side) 3/8"<br>L ; (liquid side) 1/4"     | G ; (gas side)<br>L ; (liquid side)              |
| Drain                                    | Inner diameter   | mm           | 12                                                | —                                                |
| Hose                                     | Length           | m            | 0.7                                               | —                                                |
| Power Cord Length                        |                  | m            | 2.0                                               | —                                                |
| Number of core-wire                      |                  |              | 3 (1.0 mm <sup>2</sup> )                          | —                                                |
| Dimensions                               | Height           | inch (mm)    | 10 - 31/32 (279)                                  | 18 - 29/32                                       |
|                                          | Width            | inch (mm)    | 31 - 15/32 (799)                                  | 30 - 23/32                                       |
|                                          | Depth            | inch (mm)    | 7 - 27/32 (199)                                   | 9 - 21/32                                        |
| Net Weight                               |                  | lb (kg)      | 20 (9.0)                                          | 64 (29.0)                                        |
| Compressor                               | Type             |              | —                                                 | Rotary (1 cylinder)<br>rolling piston            |
|                                          | Motor            | Type         | —                                                 | Induction (2 poles)                              |
|                                          | Rated            | Output       | W                                                 | 550                                              |
| Air Circulation                          | Type             |              | Cross-flow Fan                                    | Propeller                                        |
|                                          | Material         |              | AS + Glass Fiber 30%                              | AES + Glass Fiber 30%                            |
|                                          | Motor            | Type         | Induction (4-poles)                               | Induction (6-poles)                              |
|                                          | Input            |              | W                                                 | 20.6 - 19.1                                      |
|                                          | Rate             | Output       | W                                                 | 10                                               |
|                                          | Fan Speed        | Low          | rpm                                               | Cooling; 820 - 780<br>Heating; 855 - 825         |
|                                          |                  | Medium       | rpm                                               | Cooling; 855 - 825<br>Heating; 1,040 - 1,005     |
|                                          |                  | High         | rpm                                               | Cooling; 1,040 - 1,005<br>Heating; 1,160 - 1,140 |
|                                          |                  | SuperHigh    | rpm                                               | Cooling; 1,160 - 1,140<br>Heating; 1,160 - 1,140 |
| Heat Exchanger                           | Description      |              | Evaporator                                        | Condenser                                        |
|                                          | Tube material    |              | Copper                                            | Copper                                           |
|                                          | Fin material     |              | Aluminium (Pre Coat)                              | Aluminium (Pre Coat)                             |
|                                          | Fin Type         |              | Slit Fin                                          | Louver                                           |
|                                          | Row / Stage      |              | (Plate fin configuration, forced draft)<br>2 × 14 | 1 × 14                                           |
|                                          | FPI              |              | 18                                                | 19                                               |
|                                          | Size (W × H × L) |              | mm                                                | 614 × 294 × 25.4                                 |
| Refrigerant Control Device               |                  |              | —                                                 | Capillary                                        |
| Refrigeration Oil                        |                  | (c.c)        | —                                                 | SUNISO 4G<br>ATMOS M6                            |
| Refrigerant (R-22)                       |                  | g (oz)       | —                                                 | 860 (30.4)                                       |
| Thermostat                               |                  |              | Electronic Control                                | —                                                |
| Protection Device                        |                  |              | —                                                 | Overload Protection                              |

|                      |                |          |                 |                   |
|----------------------|----------------|----------|-----------------|-------------------|
| Capillary Tube       | Length         | mm       | —               | Cooling; 920, 590 |
|                      | Flow Rate      | l/min    | —               | Cooling; 4.0, H   |
|                      | Inner Diameter | mm       | —               | Cooling; 1.1, H   |
| Air Filter           | Material Style |          | P.P. Honeycomb  | —                 |
| Capacity Control     |                |          | Capillary Tube  |                   |
| Compressor Capacitor |                | μ F, VAC | —               | 15 μ F, 44        |
| Fan Motor Capacitor  |                | μ F, VAC | 1.5 μ F, 400VAC | 1.2 μ F, 44       |

**- Specifications are subject to change without notice for further improvement.**





|                  | Unit                                                                                                                                                                                           | CS-A95KR                                                                                          | CU-A95                                                                                            |
|------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|
| Cooling Capacity | kW<br>BTU/h                                                                                                                                                                                    | 2.65 - 2.60<br>9,040 - 8,870                                                                      |                                                                                                   |
| Heating Capacity | kW<br>BTU/h                                                                                                                                                                                    | 3.20 - 3.10<br>10,900 - 10,600                                                                    |                                                                                                   |
| Moisture Removal | l/h<br>Pint/h                                                                                                                                                                                  | 1.6<br>3.4                                                                                        |                                                                                                   |
| Power Source     | Phase<br>V<br>Cycle                                                                                                                                                                            | Single<br>240 - 220<br>50                                                                         |                                                                                                   |
| Airflow Method   | OUTLET<br><br>INTAKE<br> | SIDE VIEW<br> | TOP VIEW<br> |

|                 |                  |                     |                                                                        |                              |
|-----------------|------------------|---------------------|------------------------------------------------------------------------|------------------------------|
| Air Volume      | Indoor Air (Lo)  | m3/min<br>(cfm)     | Cooling; 6.8 (240) - 6.0<br>(210)<br>Heating; 6.8 (240) - 6.0<br>(210) | —                            |
|                 | Indoor Air (Me)  | m3/min<br>(cfm)     | Cooling; 8.0 (280) - 7.1<br>(250)<br>Heating; 8.0 (280) - 7.1<br>(250) | —                            |
|                 | Indoor Air (Hi)  | m3/min<br>(cfm)     | Cooling; 9.4 (330) - 8.9<br>(310)<br>Heating; 9.9 (350) - 9.7<br>(340) | —                            |
|                 | Indoor Air (SHi) | m3/min<br>(cfm)     | Cooling; 9.9 (350) - 9.6<br>(340)<br>Heating; 9.9 (350) - 9.7<br>(340) | —                            |
| Noise Level     |                  | dB (A)              | Cooling; High 39-38, Low<br>28-26<br>Heating; High 39-39, Low<br>28-26 | Cooling; Hig<br>Heating; Hig |
|                 |                  | Power level<br>(dB) | Cooling; High 52-50, Low<br>40-38<br>Heating; High 52-52, Low<br>41-38 | Cooling; Hig<br>Heating; Hig |
| Electrical Data | Input            | W                   | Cooling; 970 - 920<br>Heating; 910 - 840                               |                              |
|                 | Running Current  | A                   | Cooling; 4.3 - 4.3<br>Heating; 4.0 - 3.9                               |                              |
|                 | EER              | W/W (BTU/<br>hW)    | Cooling; 2.73 - 2.83 (9.3 - 9.6)                                       |                              |
|                 | COP              | W/W (BTU/<br>hW)    | Heating; 3.52 - 3.69 (12.0 - 12.6)                                     |                              |
|                 | Starting Current | A                   | 16.4                                                                   |                              |

|                                          |                |              |                                                  |                                       |
|------------------------------------------|----------------|--------------|--------------------------------------------------|---------------------------------------|
| Piping Connection Port<br>(Flare piping) |                | inch<br>inch | G ; Half Union 3/8"<br>L ; Half Union 1/4"       | G ; 3-way va<br>L ; 2-way va          |
| Pipe Size<br>(Flare piping)              |                | inch<br>inch | G ; (gas side) 3/8"<br>L ; (liquid side) 1/4"    | G ; (gas side)<br>L ; (liquid side)   |
| Drain                                    | Inner diameter | mm           | 12                                               | —                                     |
| Hose                                     | Length         | m            | 0.7                                              | —                                     |
| Power Cord Length                        |                | m            | 2.0                                              | —                                     |
| Number of core-wire                      |                |              | 3 (1.0 mm <sup>2</sup> )                         | —                                     |
| Dimensions                               | Height         | inch (mm)    | 10 - 31/32 (279)                                 | 18 - 29/32                            |
|                                          | Width          | inch (mm)    | 31 - 15/32 (799)                                 | 30 - 23/32                            |
|                                          | Depth          | inch (mm)    | 7 - 27/32 (199)                                  | 9 - 21/32                             |
| Net Weight                               |                | lb (kg)      | 20 (9.0)                                         | 71 (32.2)                             |
| Compressor                               | Type           |              | —                                                | Rotary (1 cylinder)<br>rolling piston |
|                                          | Motor          | Type         | —                                                | Induction (2 poles)                   |
|                                          | Rated          | Output       | W                                                | 700                                   |
| Air Circulation                          | Type           |              | Cross-flow Fan                                   | Propeller                             |
|                                          | Material       |              | AS + Glass Fiber 30%                             | AES + Glass Fiber 30%                 |
|                                          | Motor          | Type         | Induction (4-poles)                              | Induction (6-poles)                   |
|                                          | Input          |              | W                                                | 32.2 - 34.5                           |
|                                          | Rate           |              | Output                                           | W                                     |
|                                          | Fan Speed      |              | Low                                              | rpm                                   |
|                                          |                |              | Cooling; 930 - 820<br>Heating; 930 - 820         | —                                     |
|                                          |                |              | Medium                                           | rpm                                   |
|                                          |                |              | Cooling; 1,080 - 965<br>Heating; 1,080 - 965     | —                                     |
| Heat Exchanger                           |                |              | High                                             | rpm                                   |
|                                          |                |              | Cooling; 1,275 - 1,210<br>Heating; 1,345 - 1,310 | —                                     |
|                                          |                |              | SuperHigh                                        | rpm                                   |
|                                          |                |              | Cooling; 1,345 - 1,310<br>Heating; 1,345 - 1,310 | —                                     |
|                                          | Description    |              | Evaporator                                       | Condenser                             |
|                                          | Tube material  |              | Copper                                           | Copper                                |
|                                          | Fin material   |              | Aluminium (Pre Coat)                             | Aluminium (Pre Coat)                  |
|                                          | Fin Type       |              | Slit Fin                                         | Louver                                |
| Refrigerant Control Device               | Row / Stage    |              | (Plate fin configuration, forced draught)        |                                       |
|                                          |                |              | 2 × 14                                           | 1 × 14                                |
|                                          | FPI            |              | 18                                               | 19                                    |
| Size (W × H × L)                         |                | mm           | 614 × 294 × 25.4                                 | 856 × 457.2                           |
| Refrigerant Control Device               |                |              | —                                                | Capillary                             |
| Refrigeration Oil                        |                | (c.c)        | —                                                | SUNISO 4G<br>ATMOS M6                 |
| Refrigerant (R-22)                       |                | g (oz)       | —                                                | 900 (31.5)                            |
| Thermostat                               |                |              | Electronic Control                               | —                                     |
| Protection Device                        |                |              | —                                                | Overload Protection                   |

|                      |                   |              |                     |                       |
|----------------------|-------------------|--------------|---------------------|-----------------------|
| Capillary Tube       | Length            | mm           | —                   | Cooling; 1,033<br>585 |
|                      | Flow Rate         | l/min        | —                   | Cooling; 4.8, H       |
|                      | Inner Diameter    | mm           | —                   | Cooling; 1.2, H       |
| Air Filter           | Material<br>Style |              | P.P.<br>Honeycomb   | —                     |
| Capacity Control     |                   |              | Capillary Tube      |                       |
| Compressor Capacitor |                   | $\mu$ F, VAC | —                   | 25 $\mu$ F, 37        |
| Fan Motor Capacitor  |                   | $\mu$ F, VAC | 1.0 $\mu$ F, 400VAC | 1.2 $\mu$ F, 40       |

- Specifications are subject to change without notice for further improvement.

|                  | Unit                                                                                                                                                                                           | CS-A125KR                                                                                         | CU-A125KR                                                                                         |
|------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|
| Cooling Capacity | kW<br>BTU/h                                                                                                                                                                                    | 3.40 - 3.40<br>11,600 - 11,600                                                                    |                                                                                                   |
| Heating Capacity | kW<br>BTU/h                                                                                                                                                                                    | 4.15 - 4.05<br>14,200 - 13,800                                                                    |                                                                                                   |
| Moisture Removal | l/h<br>Pint/h                                                                                                                                                                                  | 2.1<br>4.4                                                                                        |                                                                                                   |
| Power Source     | Phase<br>V<br>Cycle                                                                                                                                                                            | Single<br>240 - 220<br>50                                                                         |                                                                                                   |
| Airflow Method   | OUTLET<br><br>INTAKE<br> | SIDE VIEW<br> | TOP VIEW<br> |

|                 |                  |                     |                                                                  |                              |
|-----------------|------------------|---------------------|------------------------------------------------------------------|------------------------------|
| Air Volume      | Indoor Air (Lo)  | m3/min<br>(cfm)     | Cooling; 6.8 (240) - 6.0 (210)<br>Heating; 6.8 (240) - 6.0 (210) | —                            |
|                 | Indoor Air (Me)  | m3/min<br>(cfm)     | Cooling; 8.4 (300) - 7.7 (270)<br>Heating; 8.4 (300) - 7.7 (270) | —                            |
|                 | Indoor Air (Hi)  | m3/min<br>(cfm)     | Cooling; 9.2 (320) - 8.8 (310)<br>Heating; 9.7 (340) - 9.5 (340) | —                            |
|                 | Indoor Air (SHi) | m3/min<br>(cfm)     | Cooling; 9.7 (340) - 9.5 (340)<br>Heating; 9.7 (340) - 9.5 (340) | —                            |
| Noise Level     |                  | dB (A)              | Cooling; High 39-39, Low 31-29<br>Heating; High 39-39, Low 31-29 | Cooling; Hig<br>Heating; Hig |
|                 |                  | Power level<br>(dB) | Cooling; High 52-52, Low 42-40<br>Heating; High 52-52, Low 42-40 | Cooling; Hig<br>Heating; Hig |
| Electrical Data | Input            | kW                  | Cooling; 1.31 - 1.26<br>Heating; 1.24 - 1.19                     |                              |
|                 | Running Current  | A                   | Cooling; 5.4 - 5.6<br>Heating; 5.0 - 5.2                         |                              |
|                 | EER              | W/W (BTU/hW)        | Cooling; 2.60 - 2.70 (8.9 - 9.2)                                 |                              |
|                 | COP              | W/W (BTU/hW)        | Heating; 3.35 - 3.40 (11.4 - 11.6)                               |                              |
|                 | Starting Current | A                   | 26.0                                                             |                              |


|                                          |                  |              |                                               |                                                  |
|------------------------------------------|------------------|--------------|-----------------------------------------------|--------------------------------------------------|
| Piping Connection Port<br>(Flare piping) |                  | inch<br>inch | G ; Half Union 1/2"<br>L ; Half Union 1/4"    | G ; 3-way va<br>L ; 2-way va                     |
| Pipe Size<br>(Flare piping)              |                  | inch<br>inch | G ; (gas side) 1/2"<br>L ; (liquid side) 1/4" | G ; (gas side)<br>L ; (liquid side)              |
| Drain                                    | Inner diameter   | mm           | 12                                            | —                                                |
| Hose                                     | Length           | m            | 0.7                                           | —                                                |
| Power Cord Length                        |                  | m            | 2.0                                           | —                                                |
| Number of core-wire                      |                  |              | 3 (1.0 mm <sup>2</sup> )                      | —                                                |
| Dimensions                               | Height           | inch (mm)    | 10 - 31/32 (279)                              | 21 - 1/4 ( )                                     |
|                                          | Width            | inch (mm)    | 31 - 15/32 (799)                              | 27 - 17/32                                       |
|                                          | Depth            | inch (mm)    | 7 - 27/32 (199)                               | 11 - 7/32                                        |
| Net Weight                               |                  | lb (kg)      | 20 (9.0)                                      | 86 (39. )                                        |
| Compressor                               | Type             |              | —                                             | Rotary (1 cylinder)<br>rolling piston            |
|                                          | Motor            | Type         | —                                             | Induction (2 poles)                              |
|                                          | Rated            | Output       | W                                             | 1,100                                            |
| Air Circulation                          | Type             |              | Cross-flow Fan                                | Propeller                                        |
|                                          | Material         |              | AS + Glass Fiber 30%                          | PP Resin                                         |
|                                          | Motor            | Type         | Induction (4-poles)                           | Induction (6 poles)                              |
|                                          | Input            |              | W                                             | 33.3 - 31.0                                      |
|                                          | Rate             | Output       | W                                             | 15                                               |
|                                          | Fan Speed        | Low          | rpm                                           | Cooling; 950 - 835<br>Heating; 950 - 835         |
|                                          |                  | Medium       | rpm                                           | Cooling; 1,165 - 1,075<br>Heating; 1,165 - 1,075 |
|                                          |                  | High         | rpm                                           | Cooling; 1,280 - 1,235<br>Heating; 1,350 - 1,330 |
|                                          |                  | SuperHigh    | rpm                                           | Cooling; 1,350 - 1,330<br>Heating; 1,350 - 1,330 |
| Heat Exchanger                           | Description      |              | Evaporator                                    | Condenser                                        |
|                                          | Tube material    |              | Copper                                        | Copper                                           |
|                                          | Fin material     |              | Aluminium (Pre Coat)                          | Aluminium (Pre Coat)                             |
|                                          | Fin Type         |              | Slit Fin                                      | Louver                                           |
|                                          | Row / Stage      |              | (Plate fin configuration, forced draft)       |                                                  |
|                                          | FPI              |              | 21                                            | 18                                               |
|                                          | Size (W × H × L) |              | mm                                            | 614 × 294 × 25.4                                 |
| Refrigerant Control Device               |                  |              | —                                             | Capillary                                        |
| Refrigeration Oil                        |                  | (c.c)        | —                                             | SUNISO 4G<br>ATMOS M6                            |
| Refrigerant (R-22)                       |                  | g (oz)       | —                                             | 990 (34. )                                       |
| Thermostat                               |                  |              | Electronic Control                            | —                                                |
| Protection Device                        |                  |              | —                                             | Overload Protection                              |

|                      |                   |              |                     |                       |
|----------------------|-------------------|--------------|---------------------|-----------------------|
| Capillary Tube       | Length            | mm           | —                   | Cooling; 1,100<br>470 |
|                      | Flow Rate         | l/min        | —                   | Cooling; 6.0,<br>13.4 |
|                      | Inner Diameter    | mm           | —                   | Cooling; 1.3, H       |
| Air Filter           | Material<br>Style |              | P.P.<br>Honeycomb   | —                     |
| Capacity Control     |                   |              | Capillary Tube      |                       |
| Compressor Capacitor |                   | $\mu$ F, VAC | —                   | 30 $\mu$ F, 37        |
| Fan Motor Capacitor  |                   | $\mu$ F, VAC | 1.5 $\mu$ F, 400VAC | 1.5 $\mu$ F, 40       |

- Specifications are subject to change without notice for further improvement.


## 4. Dimensions

CS-A75KR / CS-A95KR / CS-A125KR




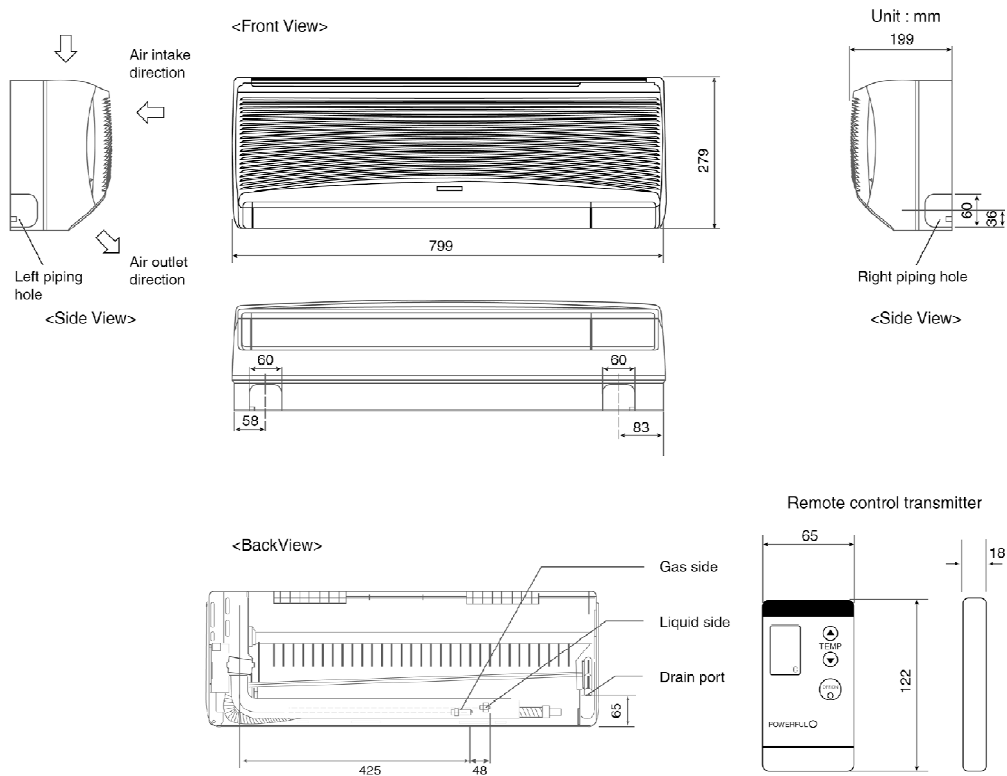





Relative position between the indoor unit and the installation plate <Front View>

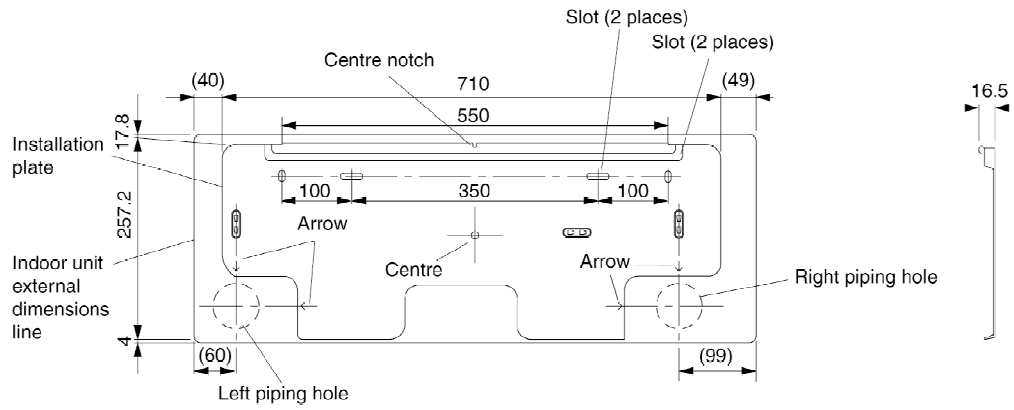

**CU-A75KR / CU-A95KR**

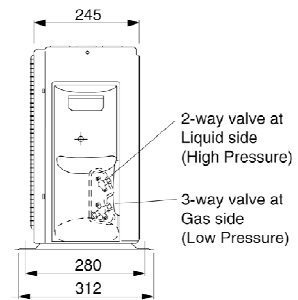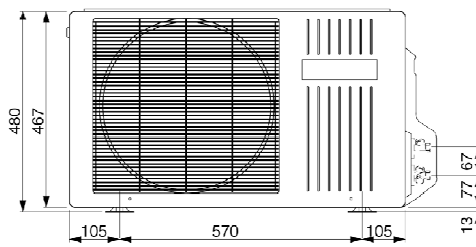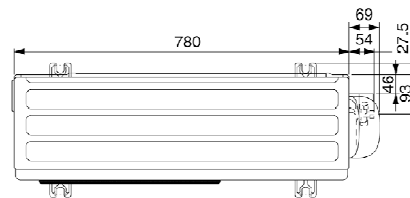


**CU-A125KR**

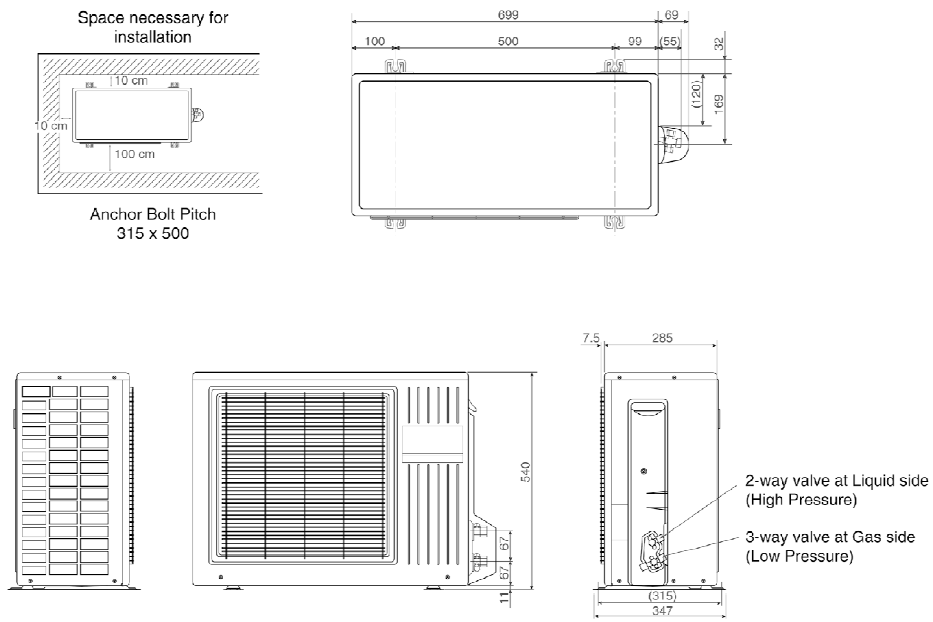


**5. Refrigeration Cycle Diagram**

CS-A75KR / CU-A75KR  
 CS-A95KR / CU-A95KR  
 CS-A125KR / CU-A125KR

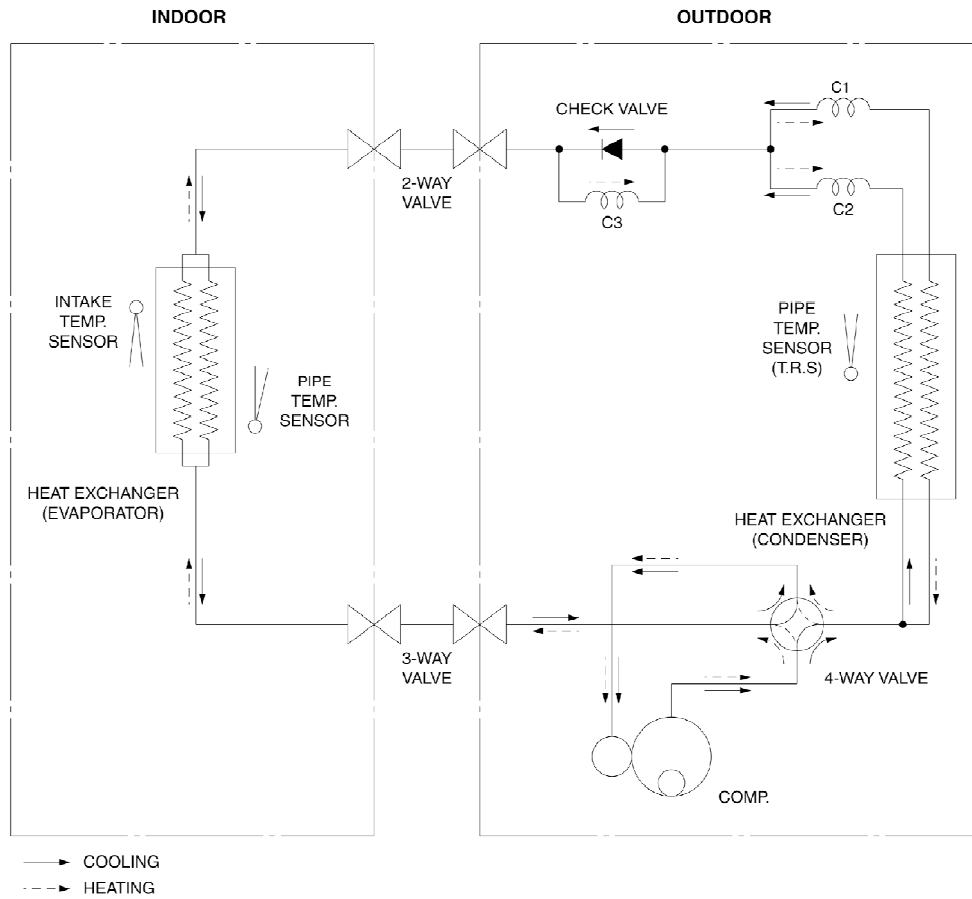

## 6. Block Diagram

CS-A75KR / CU-A75KR  
 CS-A95KR / CU-A95KR  
 CS-A125KR / CU-A125KR

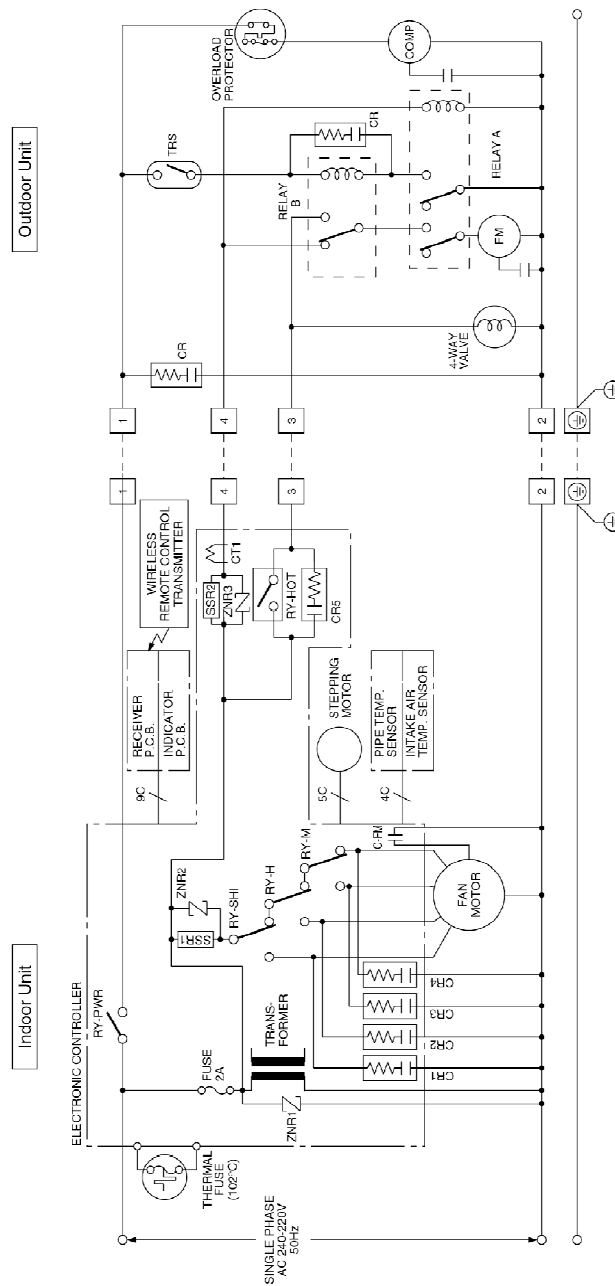


※ [ ] Indicates the electronic control unit.

※ \*C\* Indicates the number of core wires. (Example: 6C=6 core wires).

## 7. Wiring Diagram

**CS-A75KR / CU-A75KR**  
**CS-A95KR / CU-A95KR**  
**CS-A125KR / CU-A125KR**

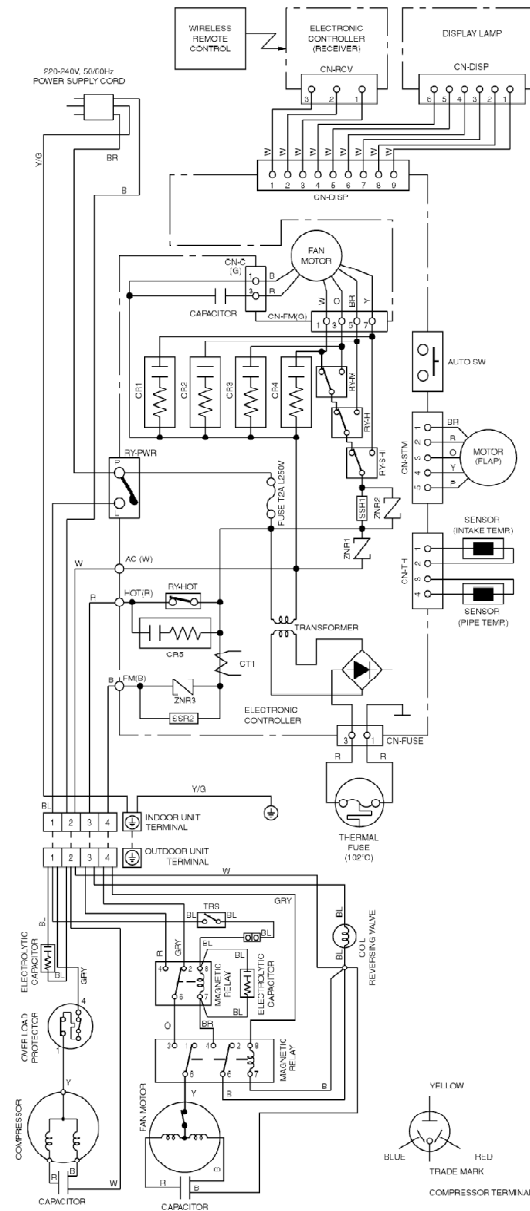

REMARKS

**B** : BLUE  
**BR** : BROWN  
**BL** : BLACK  
**GRY** : GRAY  
**W** : WHITE  
**R** : RED  
**O** : ORANGE  
**P** : PINK  
**Y/G** : YELLOW/GREEN

#### Resistance of Indoor Fan Motor Windings

| MODEL        | CS-A75KR       | CS-A95KR       | CS-A125KR      |
|--------------|----------------|----------------|----------------|
| CONNECTION   | CWA921033      | CWA921032      | CWA921031      |
| YELLOW-BLUE  | 707.1 $\Omega$ | 451.2 $\Omega$ | 450.7 $\Omega$ |
| YELLOW-BROWN | 71.1 $\Omega$  | 86.7 $\Omega$  | 68.2 $\Omega$  |
| BROWN-ORANGE | 64.7 $\Omega$  | 98.4 $\Omega$  | 56.7 $\Omega$  |
| ORANGE-WHITE | 15.7 $\Omega$  | 51.5 $\Omega$  | 56.9 $\Omega$  |
| WHITE-RED    | 116.2 $\Omega$ | 240.8 $\Omega$ | 102.0 $\Omega$ |

#### Resistance of Outdoor Fan Motor Windings

| MODEL       | CU-A75KR       | CU-A95KR | CU-A125KR      |
|-------------|----------------|----------|----------------|
| CONNECTION  | CWA95245       | ←        | CWA95381       |
| BLUE-YELLOW | 260.5 $\Omega$ | ←        | 174.5 $\Omega$ |
| YELLOW-RED  | 446.0 $\Omega$ | ←        | 331.0 $\Omega$ |

#### Resistance of Compressor Windings

| MODEL      | CU-A75KR         | CU-A95KR         | CU-A125KR        |
|------------|------------------|------------------|------------------|
| CONNECTION | 2RS<br>122D5AB02 | 2PS<br>164D3AD02 | 2KS<br>224D5CA02 |
| C-R        | 5.627 $\Omega$   | 3.429 $\Omega$   | 2.211 $\Omega$   |
| C-S        | 12.19 $\Omega$   | 4.763 $\Omega$   | 2.924 $\Omega$   |

## 8. Operation Details

### 8.1. Cooling Mode Operation

Cooling in operation according to Remote Control setting.

Time Delay Safety Control (3 minutes)

- When the compressor is stopped by Remote Control, it restarts after 3 minutes when it is turned ON by Remote Control.
- When the setting temperature is reached during cooling operation, the compressor stops and it will not start for 3 minutes.

7 minutes Time Save Control

- The compressor will start automatically if it has stopped for 7 minutes even if the room temperature is between the compressor ON temperature and OFF temperature.


Starting Current Control

- When the compressor, outdoor fan motor & indoor fan motor are simultaneously started, the indoor fan motor will operate 1.6 second later.

Anti-Freezing Control


- If the temperature of the indoor heat exchanger falls continuously below 2°C for 4 minutes or more, the compressor turns off to protect the indoor heat exchanger from freezing. The fan speed setting remains the same.
- Compressor will restart again when the indoor heat exchanger temperature rises to 10°C (Recovery).

- ✕ 3 minutes waiting of Time Delay Safety Control is valid for Cooling Operation.

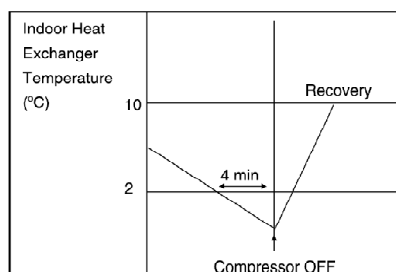

#### Compressor Reverse Rotation Protection Control


- If the compressor is operating continuously for 5 minutes or longer and the temperature difference between intake air and indoor heat exchanger is  $2.5^{\circ}\text{C}$  or less for 2 minutes, compressor will stop and restart automatically. / (Time Delay Safety Control is valid)



- ▲  $T = \text{Intake air temperature} - \text{Indoor heat exchanger temperature}$  / This is to protect reverse rotation of the compressor when there is a instantaneous power failure.

#### Compressor Protection Control

- After the compressor starts for 50 seconds but the outdoor fan motor is still OFF, the compressor will stop and restart automatically. (Time Delay Safety Control is valid).




- If the above phenomenon is repeated for 3 times, the compressor will stops.
- The above phenomenon is reset when there is a change to heating mode or stopped by Remote Control Switch.



### Automatic Fan Speed Mode


When Automatic Fan Speed is selected at Remote Control during cooling operation.

- Fan speed rotates in the range of Hi to Me.
- Deodorizing Control.

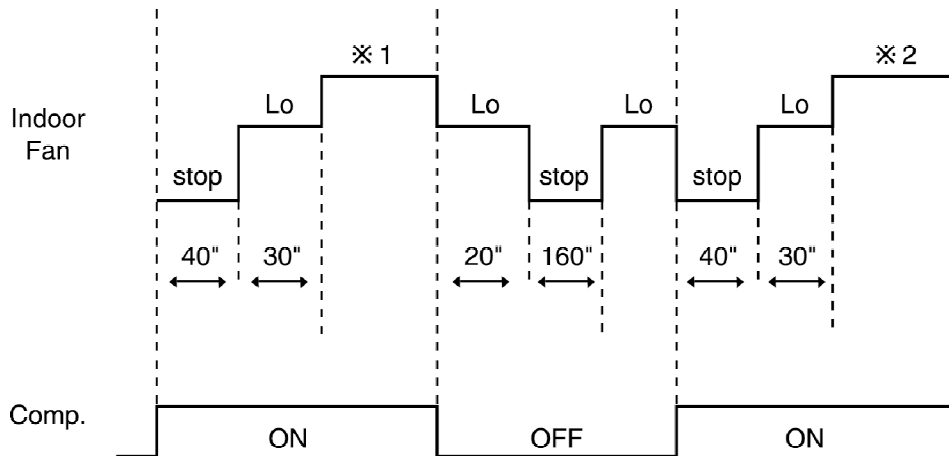

- ※ 1 Fan Speed is Hi until the compressor stops (when the room temperature reaches setting temperature).
- ※ 2 Fan Speed is Me after the compressor restarts.

### Cooling Operation Time Diagram

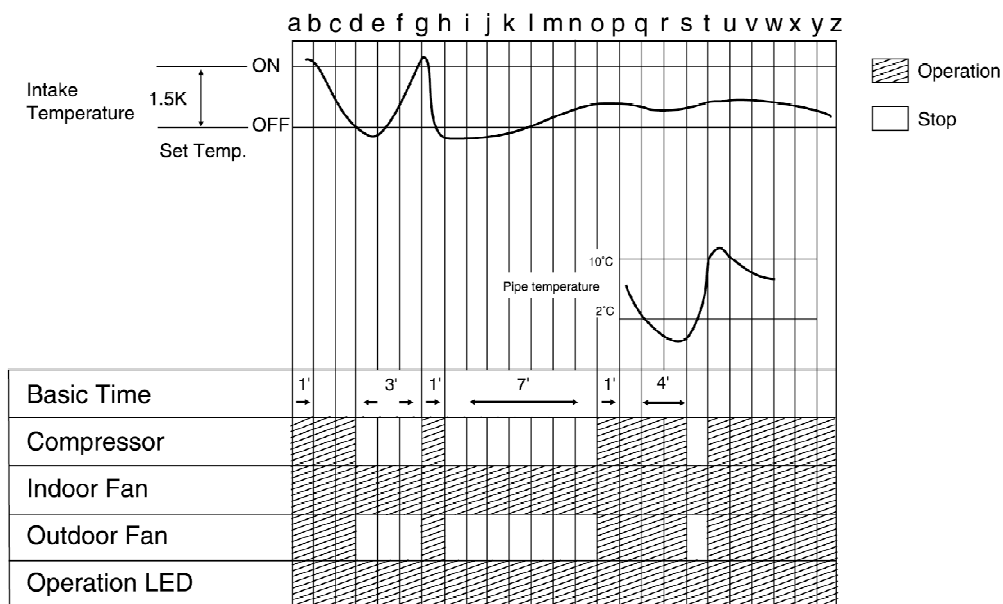

<Description of operation>

d – g : Time Delay Safety Control (waiting for 3 minutes)

g – h : 60 sec. Forced Operation

h – o : 7 min. Time Saved Control

q – t : Anti Freezing Control

## 8.2. Soft Dry Mode Operation

- The unit starts cooling operation until the room temperature reaches the setting temperature set on the Remote Control, and then Soft Dry operation will start.
- During Soft Dry operation, the Indoor Fan will operate at low speed.
- The operation will be switched on and off for up to 10 minutes “ON” and 6 minutes “OFF”. Once Soft Dry operation is turned off, it stops for 6 minutes.

Time Delay Safety Control

- Once the compressor stops, it will not start for 3 minutes during Cooling operation.

Starting Current Control

- Same as Starting Current Control for Cooling Mode operation.

**Anti-Freezing Control**

- Same as Anti-Freezing Control for Cooling Mode operation. (For Soft Dry region, 6 minutes waiting is valid during compressor stops.) /

**Compressor Reverse Rotation Protection Control**

- Same as Compressor Reverse Rotation Protection Control for Cooling Mode Operation. (For Soft Dry region, 6 minutes waiting is valid during compressor stops.)


**Compressor Protection Control**

- Same as Compressor Protection Control for Cooling Mode Operation.


**Automatic Fan Speed Mode**

**When Automatic Fan Speed is selected at Remote Control during Soft Dry operation.**

- Fan speed off and on at Lo speed.
- Deodorizing Control.

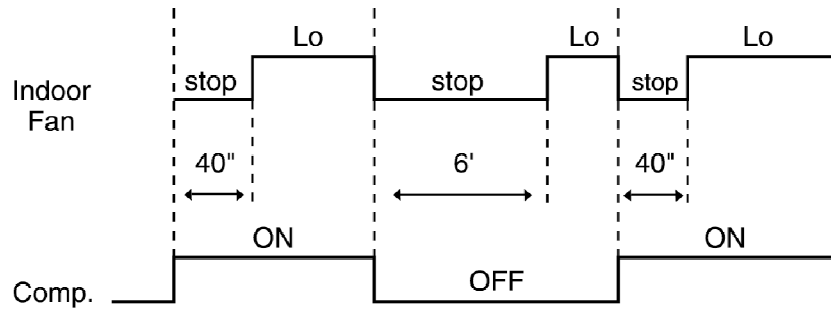

Soft Dry Operation Time Diagram

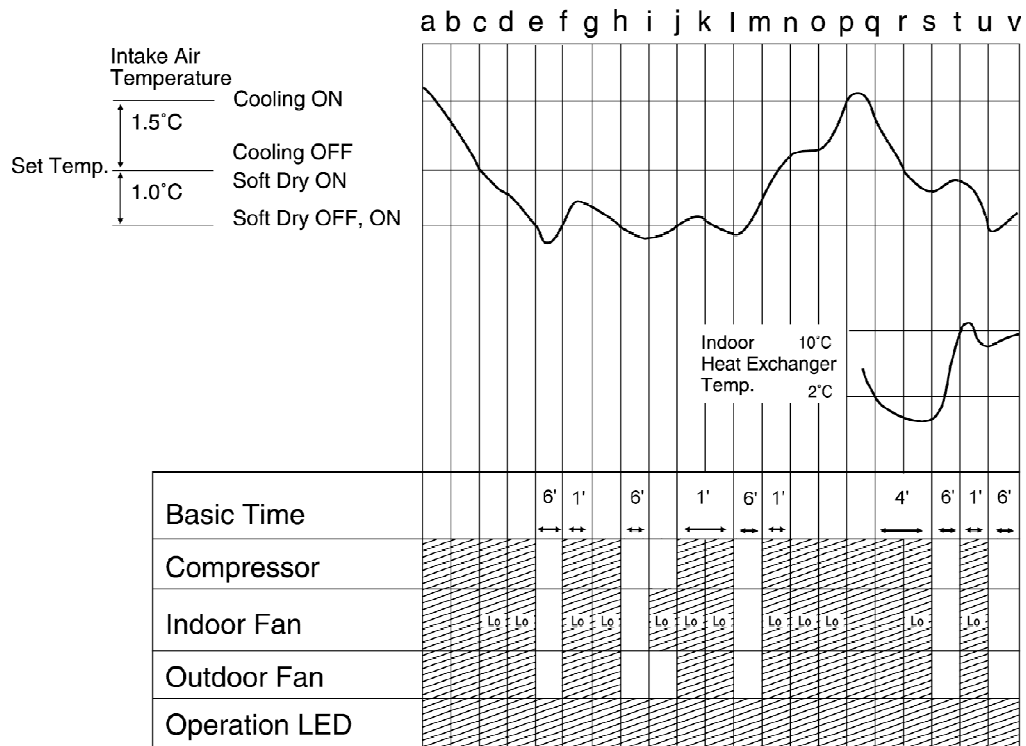

<Description of operation>

a – c, p – r : Cooling Operation

c – p, r – v : Soft Dry Operation

e – f : Soft Dry OFF

j – l : 60 sec. Forced Operation

q – t : Anti Freezing Control

Operation

Stop

## 8.3. Heating Mode Operation

Heating in operation according to Remote Control setting.

**Time Delay Safety Control**

- When the compressor is stopped by Remote Control, it restarts after 3 minutes when the Remote Control is turned ON.
- When the setting temperature is reached during heating operation, the compressor stops and it will not start for 4 minutes. /

**30 minutes Time Save Control**

- The compressor will start automatically if it has stopped for 30 minutes even if the room temperature is between the compressor ON temperature and OFF temperature.

**Overload Protection Control**

- If the temperature of the indoor heat exchanger rises to 51°C, Outdoor Fan stops.  
The Outdoor Fan restarts when the indoor heat exchanger temperature falls to 49°C.
- If the indoor heat exchanger becomes 65°C or more, the compressor will stop and restart automatically.  
(Time Delay Safety Control - 4 minutes waiting).



**Compressor Reverse Rotation Protection Control**

- If the compressor is operating continuously for 5 minutes or longer and temperature difference between intake air and indoor heat exchanger is 5°C or less for 2 minutes, compressor will stop and restart automatically.

**(Time Delay Safety Control is valid).**

**▲ T = Indoor heat exchanger temperature - intake air temperature. / This is to protect reverse rotation of the compressor when there is a instantaneous power failure.**

**4-way Valve Control**


- 4-way valve always ON during Heating operation. (Except Deicing operation)
- When the unit is switched to “OFF” during Heating operation, 4-way valve stay at Heating position for 5 minutes.

**Outdoor Fan Motor Control**

- When compressor stops (reaches room temperature), outdoor fan will operate for 30 seconds. (30 seconds Forced Operation).

### Hot Start Control


**When Heating operation starts, Indoor Fan will not start until the indoor heat exchanger reaches 30°C as diagram shown.**

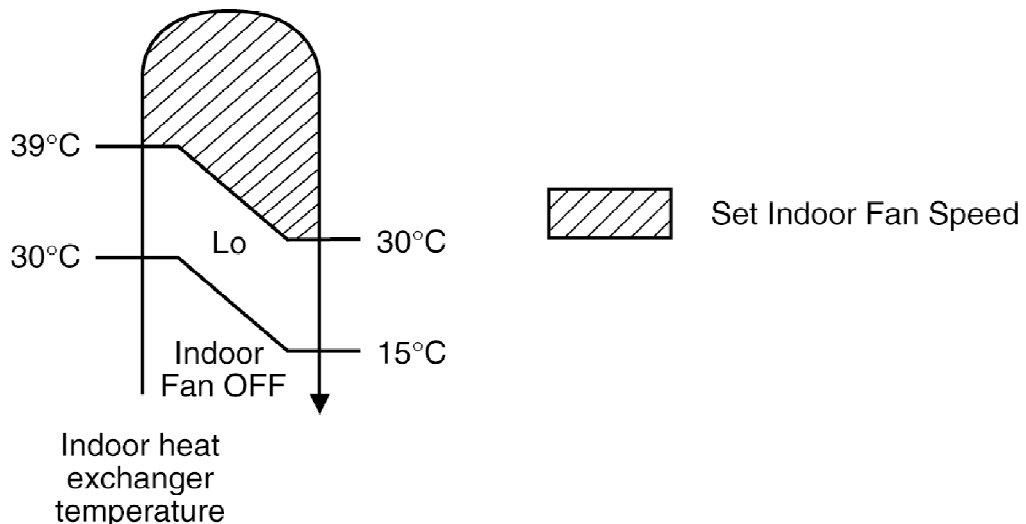

**Hot Start is completed when indoor heat exchanger rises to 39°C.**

### Anti Cold Draft Control

- This operation is to prevent the Cold Draft during Heating mode operation.
- The operation will start when compressor OFF (Thermo OFF) during Heating operation.
- For the first 30 sec from compressor OFF (Thermo OFF), Indoor fan speed will operate accordingly to the Indoor heat exchanger temperature as shown below:

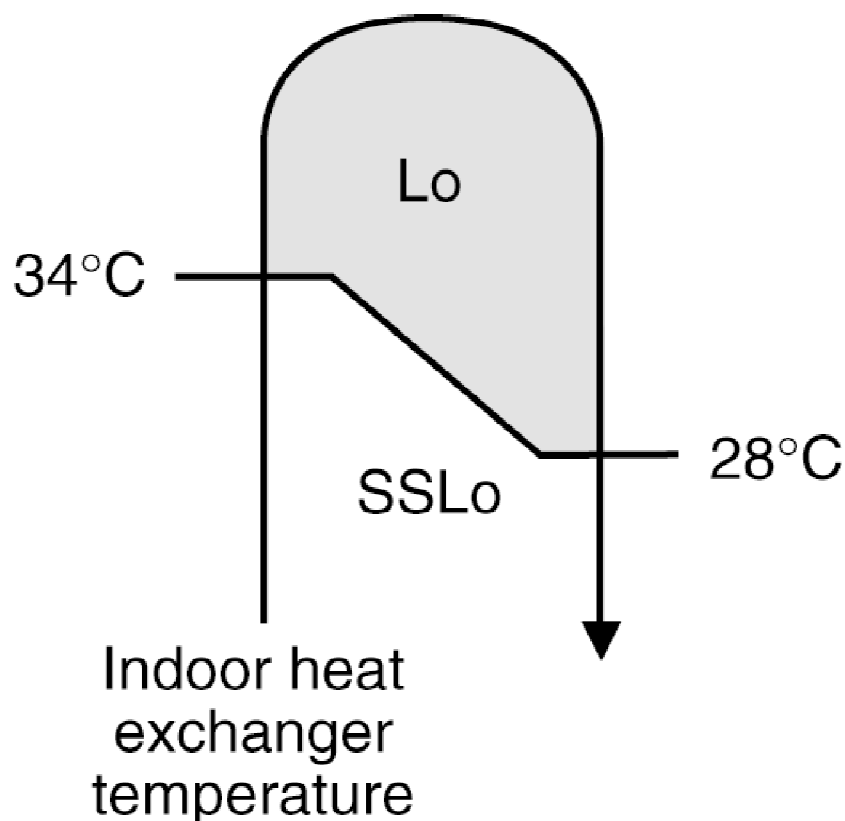

**Note: SSLo: Fan will be running at Lo speed with Indoor heat exchanger temperature 1.5 sec ON and 5.5 sec OFF.**


- After 30 sec. from compressor OFF (thermo OFF), Indoor fan will run at SSLo speed only.
- Anti Cold Draft Control will stop when:
- Intake temperature < set temperature -1.5°C. (Time Delay Safety Control 4 minutes waiting is valid)
- After 30 minutes time saved control.  
(see page 22).

Automatic Fan Speed Mode

**When Automatic Fan Speed is selected at Remote Control during heating operation.**


- Fan speed rotates in the range of Me → Lo according to the heat exchanger temperature.



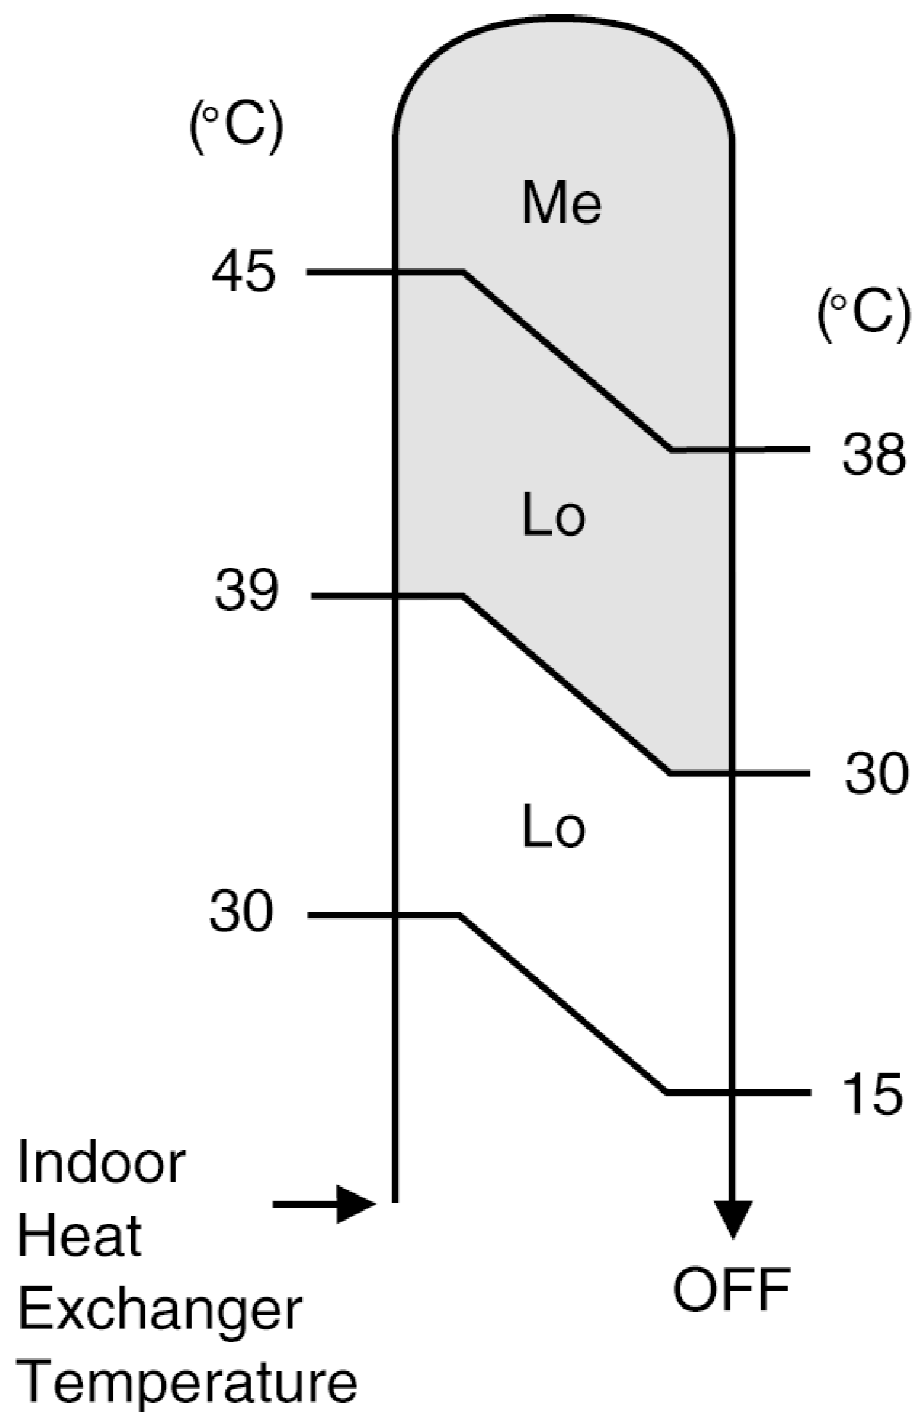

- If use Manual Fan Speed,  at above diagram will operate with setting Fan Speed.

### Heating Operating Time Diagram

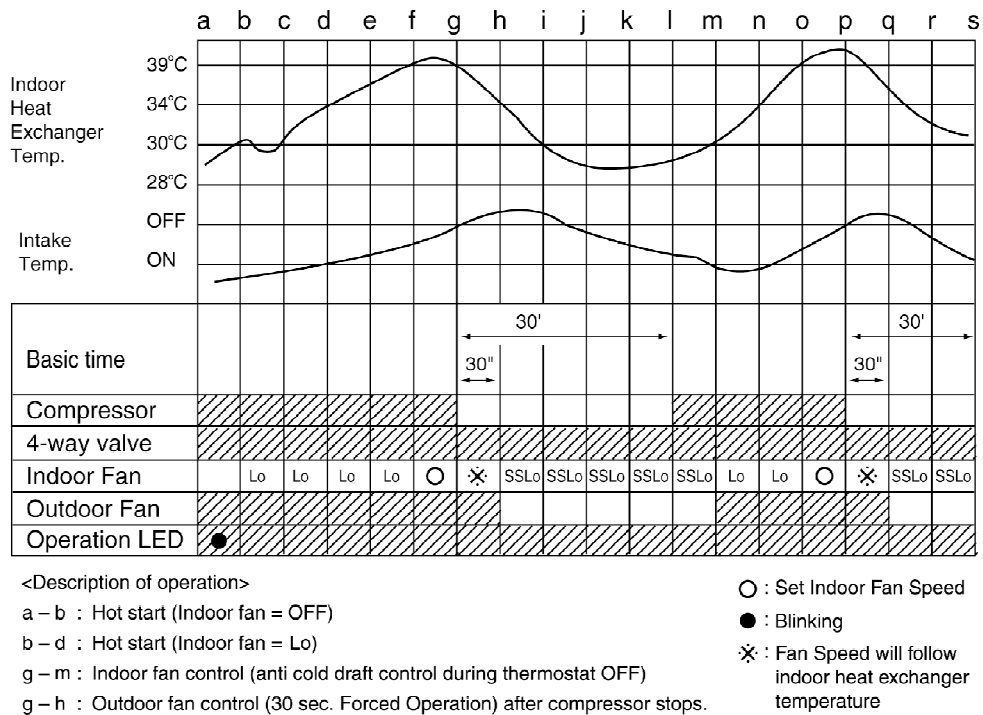

### Deicing Control

Deice starts to prevent frosting at outdoor heat exchanger.

#### - Normal Deicing

Deice operations detection commences after 30 minutes of Heating operation starts or 60 minutes after previous deice operation. If the TRS (Thermal Reed Switch) senses the outdoor piping temperature drops to -3°C (TRS CLOSE) or less for 50 sec. continuously during compressor is in operation, deice will start. (There is no detection during Outdoor Fan stops.)

#### - Overload Deicing

During heating operation, if the outdoor Fan OFF duration (due to overload control) is accumulated up to 60 minutes and after compressor starts for 1 minutes, deicing starts.

#### - Deicing ends when


1. 12 minutes after deicing operation starts;

2. TRS senses the outdoor piping temperature rises to 4°C (TRS OPEN).
3. Deicing will not end immediately as time delay (Td) is valid as shown below.

| Time taken from deicing starts to TRS OPEN (T) | Td (seconds) |
|------------------------------------------------|--------------|
| $T < 3 \text{ minutes}$                        | 0            |
| $3 \text{ minutes} \leq T < 6 \text{ minutes}$ | 60           |
| $6 \text{ minutes} \leq T < 9 \text{ minutes}$ | 120          |
| $T \geq 9 \text{ minutes}$                     | 180          |

- Once deicing operation starts, it will not end for 60 seconds.
- After deicing operation, compressor stops for 30 seconds and 4-way valve stays at cooling position for 10 seconds.

Normal Deicing Time Diagram

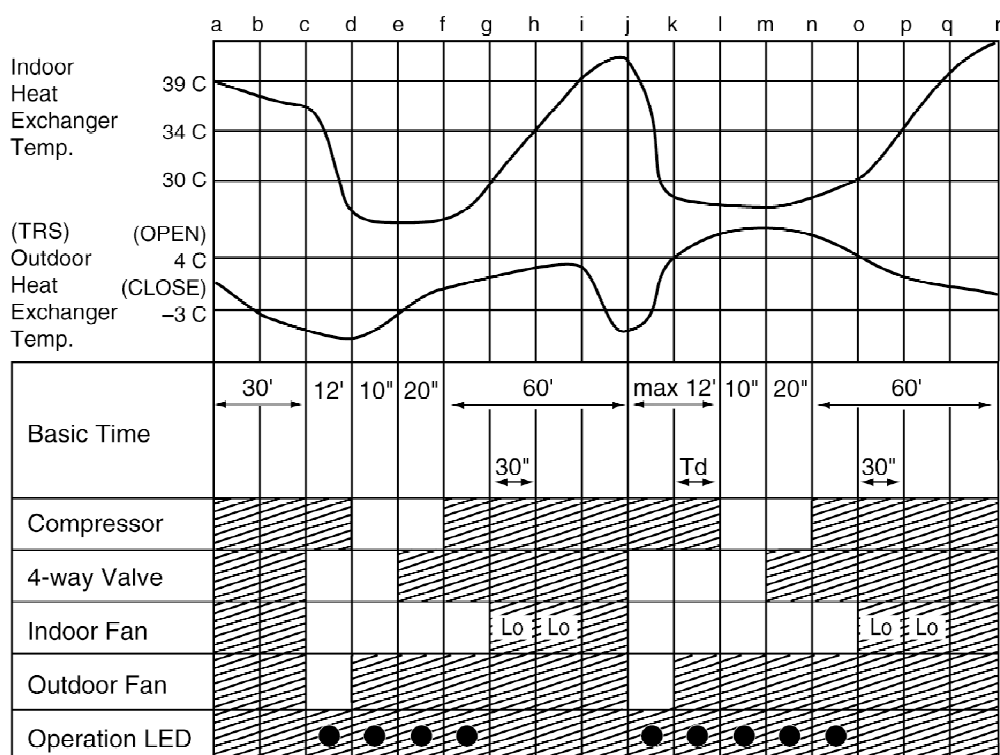


<Description of operation>

- a – c : Deicing operation judging condition established
- c – d : Deicing operation (timer detected)
- d – e, l – m : Time delay for 4-way valve
- e – f, m – n : Hot start (no thermo OFF)
- g – h, o – p : Not thermo OFF (after finished hot start)
- j – l : Deicing operation (TRS detected)

- : Blinking
- ▨ : Operation
- : Stop

## Overload Deicing Time Diagram

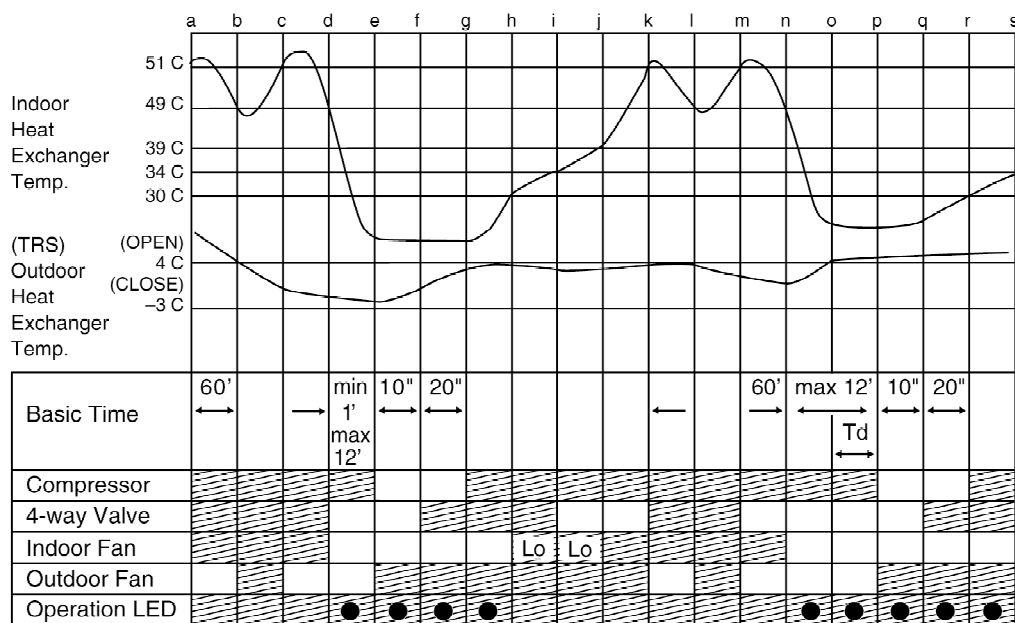

<Description of operation>

- a – d, k – h : Overload Control
- d – g : Overload Deicing (timer detected)
- g – h : Hot start (indoor fan OFF)
- h – i : Hot start (indoor fan Lo)
- n – p : Overload Control (TRS detected)

- : Blinking
- ▨ : Operation
- : Stop

## 8.4. Automatic Mode Operation

1. When the Automatic Mode Operation is selected, the indoor fan operates at Lo fan speed for 25 seconds to sense intake air temperature and determine the 1st operation mode.

Standard for Determining Operation Mode  
1st Judgement

|                        |      |          |
|------------------------|------|----------|
| Intake Air Temperature | 23°C | Cooling  |
|                        | 20°C | Soft Dry |
|                        | 20°C | Heating  |

※ Automatic Set Temperature  
Refer 3. as below.

2. Operation mode will be determine again after 1 hour of operation, if the room temperature reaches to set temperature and compressor off time is over 7 minutes 30 seconds continuously.

- ✗ The present operation mode will be continued, if the room temperature does not reach to set temperature (Compressor keeps running) eventhough after 1 hour from automatic operation n started.

|                                                                  |
|------------------------------------------------------------------|
| Standard for Determining Operation Mode<br>2nd Judgement onwards |
|------------------------------------------------------------------|

| Present Mode | Judgement                   | Next Mode                         |                                   |                                   |
|--------------|-----------------------------|-----------------------------------|-----------------------------------|-----------------------------------|
|              |                             | Cooling                           | Soft Dry                          | Heating                           |
| Cooling      | 23°C<br>Cooling<br>Heating  | O<br>(Judgement:<br>23°C & Above) | Not Applicable                    | O<br>(Judgement:<br>Below 23°C)   |
| Soft Dry     | 20°C<br>Soft Dry<br>Heating | Not Applicable                    | O<br>(Judgement:<br>20°C & Above) | O<br>(Judgement:<br>Below 20°C)   |
| Heating      | 25°C<br>Cooling<br>Heating  | O<br>(Judgement:<br>Above 25°C)   | Not Applicable                    | O<br>(Judgement:<br>25°C & below) |

✕ Automatic Set Temperature  
Refer 3. as below.

### 3. Automatic Set Temperature

For each operation, set temperature will automatically set as shown below.

However it can be selected 2°C higher or 2°C lower from standard set temperature by pressing the “Room Temperature Setting button”.

| Operation Mode | ▲ <sub>Hi</sub><br>AUTO | AUTO   | AUTO <sub>Hi</sub><br>▼ <sub>Lo</sub> |
|----------------|-------------------------|--------|---------------------------------------|
|                | (+2°C)                  | (±0°C) | (-2°C)                                |
| Cooling        | 27°C                    | 25°C   | 23°C                                  |
| Soft Dry       | 24°C                    | 22°C   | 20°C                                  |
| Heating        | 23°C                    | 21°C   | 19°C                                  |

## 8.5. Sleep Mode Auto Operation

### Cooling or Soft Dry Operation


When you press the SLEEP Mode, the following movement will start to avoid overcooling.

- The fan speed refer to Indoor Fan Motor Control.
- The setting temperature will be risen by  $0.5^{\circ}\text{C}$  at the start of operation and by  $0.5^{\circ}\text{C}$  one hour later.
- The operation will stop after 8 hours.
- When using together with the Timer, the ON-Timer has priority.

### Heating Operation

When you press the SLEEP Mode, the following movement will start to avoid overheating.

- The fan speed refer to Indoor Fan Motor Control.
- The setting temperature will be decrease by  $2^{\circ}\text{C}$  at the start of operation and by  $3^{\circ}\text{C}$  one hour later.
- The operation will stop after 8 hours.
- When using together with the Timer, the ON-Timer has priority.

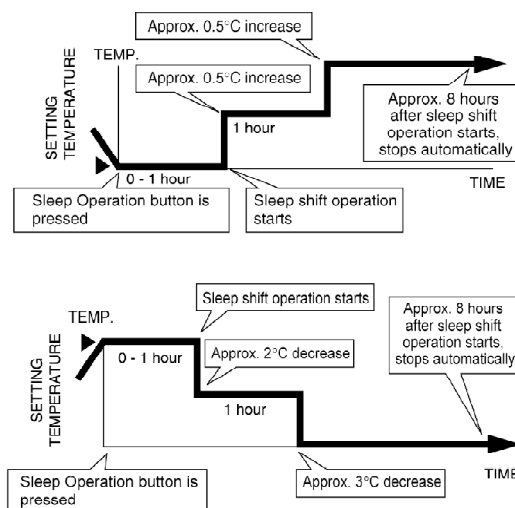

## 8.6. Random Auto Restart Control

- If there is a power failure, operation will be automatically restarted after 3 to 5 1/2 minutes when the power is resumed. It will start with previous operation mode and airflow direction.
- Restart time is decided randomly using 4 parameter: Intake air temperature, setting temperature, fan speed and Air

**Swing Blade position.**

- Random Auto Restart Control is not available when Timer or Sleep Mode is set.
- This control can be omitted by open the circuit of JX1. (Refer Circuit Diagram)

### **8.7. Delay ON Timer Control**

- When the Delayed ON Timer is set by using the remote control, the unit will start operate slightly before the set time, so that the room will reach nearly to the set temperature by the desired time.
- For Cooling and Soft Dry mode, the operation will start 15 minutes before the set time.
- For Heating mode, the operation will start 30 minutes before the set time.
- For Automatic mode, the indoor fan will operate at Lo speed for 25 seconds, 30 minutes before the set time to detect the intake air temperature to determine the operation mode. The operation indication lamp will blink at this time.

### **8.8. Remote Control Signal Receiving Sound**

- Long beep sound will be heard when:-
  - Stopping the Air Conditioner using ON/OFF switch.
  - Stopping the Sleep Mode.
  - Stopping the Powerful Mode.
  - Stopping the Economy Mode.
- Short beep sound will be heard for others.
- To switch off the beep sound:-

Press the “Automatic Operation Button” continuously for 10 seconds or more (“beep” “beep” will be heard at the 10th second). Repeat the above if you want to switch ON the beep sound or switch OFF the power switch at the indoor unit and switch it ON again. /

✕ However, if the “Automatic Operation Button” has been pressed the Automatic cooling operation activated.

If you do not require this operation, you may change it by using the remote control.

### **8.9. Indoor Fan Speed Control**

**Auto Fan Speed Control**

When set to Auto Fan Speed, the fan speed is shifted automatically between Stop to SHi depend on each operation as shown below.

#### Manual Fan Speed Control

Basic fan speed adjustment (3 settings, from Lo to Hi) can be carried out by using the Fan Speed selection button at the remote control.

| Tap                    |          |                |    | SHi | Hi | Me | Lo | RLo |
|------------------------|----------|----------------|----|-----|----|----|----|-----|
| COOLING                | Normal   | Manual         | Hi |     | O  |    |    |     |
|                        |          |                | Me |     |    | O  |    |     |
|                        |          |                | Lo |     |    |    | O  |     |
|                        |          | Auto Fan Speed |    |     | O  | O  |    |     |
|                        |          | Sleep Shift    |    |     |    |    | O  |     |
|                        | Powerful | Manual         |    | O   |    |    |    |     |
|                        |          | Auto Fan Speed |    | O   |    |    |    |     |
|                        |          | Sleep Shift    |    |     |    |    | O  |     |
|                        | Economy  | Manual         |    |     |    |    |    | O   |
|                        |          | Auto Fan Speed |    |     |    |    |    | O   |
|                        |          | Sleep Shift    |    |     |    |    | O  |     |
| SOFT DRY               | Normal   | Manual         |    |     |    |    | O  |     |
|                        | Powerful | Auto Fan Speed |    |     |    |    | O  |     |
|                        | Economy  | Sleep Shift    |    |     |    |    | O  |     |
| HEATING (A75K)         | Normal   | Manual         | Hi | O   |    |    | O  |     |
|                        |          |                | Me |     | O  |    | O  |     |
|                        |          |                | Lo |     |    | O  | O  |     |
|                        |          | Auto Fan Speed |    |     | O  | O  | O  |     |
|                        |          | Sleep Shift    |    |     |    |    | O  |     |
|                        | Powerful | Manual         |    | O   | O  | O  | O  |     |
|                        |          | Auto Fan Speed |    |     | O  | O  | O  |     |
|                        |          | Sleep Shift    |    |     |    |    | O  |     |
|                        | Economy  | Manual         |    | O   | O  | O  | O  |     |
|                        |          | Auto Fan Speed |    |     | O  | O  | O  |     |
|                        |          | Sleep Shift    |    |     |    |    | O  |     |
| HEATING (A95K & A125K) | Normal   | Manual         | Hi | O   |    |    | O  |     |
|                        |          |                | Me |     |    | O  | O  |     |
|                        |          |                | Lo |     |    |    | O  |     |
|                        |          | Auto Fan Speed |    |     |    | O  | O  |     |
|                        |          | Sleep Shift    |    |     |    |    | O  |     |
|                        | Powerful | Manual         |    | O   |    | O  | O  |     |
|                        |          | Auto Fan Speed |    |     |    | O  | O  |     |
|                        |          | Sleep Shift    |    |     |    |    | O  |     |
|                        |          | Manual         |    | O   |    | O  | O  |     |
|                        |          |                |    |     |    |    |    |     |



|                       |                |                       |  |  |          |          |  |
|-----------------------|----------------|-----------------------|--|--|----------|----------|--|
|                       | <b>Economy</b> | <b>Auto Fan Speed</b> |  |  | <b>O</b> | <b>O</b> |  |
|                       |                | <b>Sleep Shift</b>    |  |  |          | <b>O</b> |  |
| <b>MODE JUDGEMENT</b> |                |                       |  |  |          | <b>O</b> |  |


※ RLo: Random Low Speed.  
Lo, RLo<sup>-</sup>, RLo<sup>+</sup>, Fan Speed is operates randomly.

Random Low Speed

| Fan Speed | Lo  | RLo <sup>-</sup> |      |      |      | RLo <sup>+</sup> |     |    |     |
|-----------|-----|------------------|------|------|------|------------------|-----|----|-----|
| Time      | 10" | 4.5"             | 0.5" | 4.5" | 0.5" | 4"               | 1"  | 4" | 1"  |
| Fan Motor | ON  | ON               | OFF  | ON   | OFF  | ON               | OFF | ON | OFF |


## 8.10. Airflow Direction Control

### 1. Vertical Airflow Direction Cooling and Soft Dry Mode

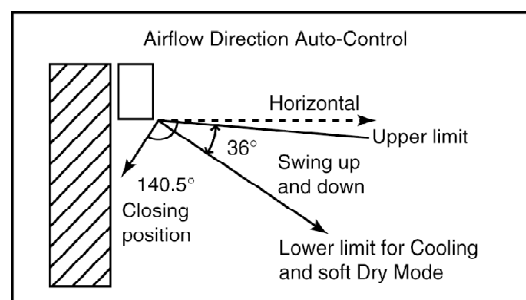


- The louver swings up and down as shown above.
- The louver does not swing when the Indoor Fan stops during operation.


### 2. Vertical Airflow Direction Heating Mode

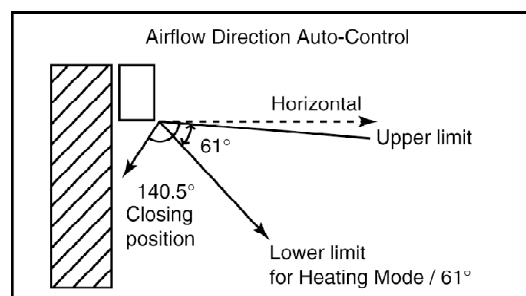

- When the intake air temp. reaches 38°C, the louver is changed from upper to lower limit. When the intake air temp falls to 35°C, the louver is changed from lower to upper limit.

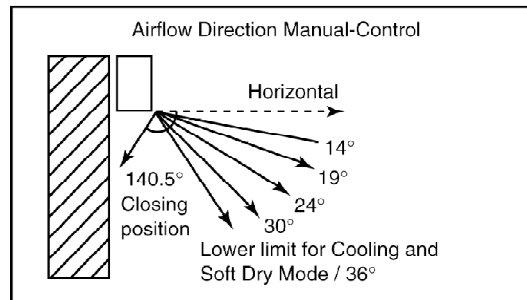

- The louver can be selected between 14° - 36° (as shown above) when pressing Manual Airflow Direction Selection Button.

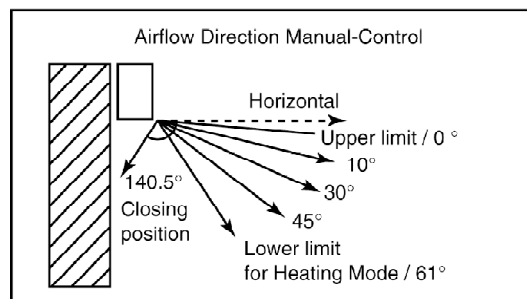

- The louver can be selected between 0° - 61° (as shown above) when pressing Manual airflow Direction Selection Button.

### 3. Horizontal Airflow Direction

- The left and right airflow direction louvers can be adjusted manually.

## 8.11. Economy Mode Operation

Purpose of this operation is to save or reduced electrical power consumption of the room air conditioner.

However consumer is advised to use Economy Mode operation after the room temperature reaches the desired temperature.


### 1. Cooling and Soft Dry Mode

- When the Economy Mode is set, the set temperature will be automatically increased 0.5°C against the present setting temperature. This operation automatically will be running under Random Fan speed.
- Vertical Airflow Direction:-  
In "Manual" or "Auto" setting, the vane will automatically

change to Auto Air Swing.

## 2. Heating Mode

- When the Economy Mode is set, the temperature will be automatically decreased 0.5°C against the present setting temperature.
- The Fan Speed will shift as shown below:



- When the Auto Fan speed is selected, the fan speed will automatically change from Lo to Me depending to the Indoor piping temperature.
- When the manual Fan Speed is selected, the fan speed will automatically change to Lo, then follows set fan speed when the Indoor piping temperature reaches 39°C.

### - Vertical Airflow Direction:-

In “Manual” or “Auto” setting, the vane will automatically change to Auto Air Swing. /

## 3. Economy Mode will stop if:

- Economy mode button is pressed again.
- Stopped by ON / OFF switch.
- Timer-off activates.
- Powerful mode button is pressed.
- Fan Speed control button is pressed.
- Sleep mode button is pressed ON.
- Operating mode is changed.

## 8.12. Powerful Mode Operation

Purpose of this operation is to be obtain the setting temperature quickly.

### 1. Cooling and Soft Dry Mode


- When the Powerful Mode is set, the set temperature will be automatically decreased 3°C against the present setting temperature. This operation automatically will be running under Super High Fan speed.
- Vertical Airflow Direction:-

In “Manual” setting, the vane will automatically shift down 10°C lower than previous setting.

In “Auto” setting, the vane will automatically swing up and down. However the upper and down. However the upper and lower limit will be shifted 10° downward.

## 2. Heating Mode

- When the Powerful Mode is set, the set temperature will be automatically increased 3°C against the present setting temperature.
- The Fan Speed will shift as shown below:



- When the Auto Fan speed is selected, the fan speed will automatically change from Lo to Me depending to the Indoor piping temperature.
- When the manual Fan Speed is selected, the fan speed will automatically set to Lo, then follows set fan speed when the Indoor piping temperature reaches 42°C.

 Set Fan Speed

- \* Shows different temperature than normal heating. This higher temperature is to provide warmer air.

- **Vertical Airflow Direction:-**

In “Manual” setting, the vane will automatically shift down 5°C lower than previous setting.

In “Auto” setting, the vane will automatically shift between upper and lower limit depending on the intake air temperature as Heating Mode, Airflow Direction Auto-Control. However the upper and lower limit will be shifted 5°C downward.

3. Powerful mode will operate for 15 minutes only.

4. Powerful Mode will stop if:

- Power mode button is pressed again.
- Stopped by ON / OFF switch.
- Timer-off activates.
- Economy mode button is pressed.
- Sleep mode button is pressed.
- Operating mode is changed.

## 9. Operating Instructions

## 10. Installation Instructions

| Required tools for Installation Works       |                |                      |                                                                                     |
|---------------------------------------------|----------------|----------------------|-------------------------------------------------------------------------------------|
| 1. Philips screw driver                     | 5. Spanner     | 9. Gas leak detector | 13. Multimeter                                                                      |
| 2. Level gauge                              | 6. Pipe cutter | 10. Measuring tape   | 14. Torque wrench<br>18 N.m (1.8 kgf.m)<br>42 N.m (4.2 kgf.m)<br>55 N.m (5.5 kgf.m) |
| 3. Electric drill, hole core drill (ø70 mm) | 7. Reamer      | 11. Thermometer      | 15. Vacuum pump                                                                     |
| 4. Hexagonal wrench (4 mm)                  | 8. Knife       | 12. Megameter        | 16. Gauge manifold                                                                  |

### 10.1. Safety Precautions

- Read the following “SAFETY PRECAUTIONS” carefully before installation.
- Electrical work must be installed by all licensed electrician. Be sure to use the correct rating of the power plug and main circuit for the model to be installed.
- The caution items stated here must be followed because these important contents are related to safety. The meaning of each indication used is as below.

Incorrect installation due to ignoring of the instruction will cause harm or damage, and the seriousness is classified by the following indication.

|                                                                                                    |                                                                           |
|----------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------|
|  <b>WARNING</b> | This indication shows the possibility of causing death or serious injury. |
|----------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------|

|                                                                                                    |                                                                                |
|----------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------|
|  <b>CAUTION</b> | This indication shows the possibility of causing injury or damage to property. |
|----------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------|

The items to be followed are classified by the symbols:

|                                                                                     |                                                                          |
|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------|
|  | Symbol with background white denotes item that is PROHIBITED from doing. |
|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------|

- Carry out test running to confirm that no abnormality occurs after

the installation. Then, explain to user the operation, care and maintenance as stated in instruction. Please remind the customer to keep the operating instructions for future reference.



## WARNING

1. Engage dealer or specialist for installation. If installation done by the user is defective, it will cause water leakage, electrical shock or fire.
2. Install according to this installation instruction strictly. If installation is defective, it will cause water leakage, electrical shock or fire.
3. Use the attached accessories parts and specified parts for installation. Otherwise, it will cause the unit to fall, water leakage, fire or electrical shock.
4. Install at a strong and firm location which is able to withstand the set's weight. If the strength is not enough or installation is not properly done, the set will drop and cause injury.
5. For electrical work, follow the local national wiring standard, regulation and this installation instruction. An independent circuit and single outlet must be used. If electrical circuit capacity is not enough or defect found in electrical work, it will cause electrical shock or fire.
6. Use the specified cable (1.5 mm<sup>2</sup>) and connect tightly for indoor/outdoor connection. Connect and clamp the cable so that no external force will be acted on the terminal. If connection or fixing is not perfect, it will cause heat-up or fire at the connection.
7. Wire routing must be properly arranged so that control board cover is fixed properly. If control board cover is not fixed perfectly, it will cause heat-up at connection point of terminal, fire or electrical shock.
8. When carrying out piping connection, take care not to let air or other substances other than the specified refrigerant go into refrigeration cycle. Otherwise, it will cause lower capacity, abnormal pressure in the refrigeration cycle, explosion and injury.
9. Do not damage or use unspecified power supply cord. Otherwise, it will cause fire or electrical shock.
10. Do not modify the length of the power supply cord or use of the extension cord, and do not share the single outlet with other electrical appliances. Otherwise, it will cause fire or electrical shock.




## CAUTION

1. Grounding is necessary. It may cause electrical shock if grounding is not perfect.
2. Do not install the unit at place where leakage of flammable gas may occur. In case gas leaks and accumulates at surrounding of the unit, it may cause fire.
3. Carry out drainage piping as mentioned in installation instructions. If drainage is not perfect, water may enter the room and damage the furniture.

## ATTENTION

1. Selection of the installation location.  
Select a installation location which is rigid and strong enough to support or hold the unit, and location for easy maintenance.
2. Power supply connection to the room air conditioner.  
Connect the power supply cord of the room air conditioner to the mains using one of the following method.  
Power supply point shall be the place where there is ease for access for the power disconnect in case of emergency. In some countries, permanent connection of this room air conditioner to the mains supply is prohibited.
  1. Power supply connection to the receptacle using a power plug. Use an approved 16A power plug with earth pin for the connection to the receptacle.
  2. Power supply connection to a circuit breaker for the permanent connection. Use an approved 16A circuit breaker for the permanent connection. It must be a double pole switch with a minimum 3 mm contact gap.
3. Do not release refrigerant.  
Do not release refrigerant during piping work for installation, re-installation and during repair or replacement of refrigeration parts. Take care of the liquid refrigerant, it may cause frostbite.
4. Installation work.  
It may need two people to carry out the installation work.
5. Do not install this appliance in a laundry room or other location where water may drip from the ceiling, etc.

### Attached accessories

| No. | Accessories part                                                                                                       | Qty. | No. | Accessories part                                                                                                           | Qty. |
|-----|------------------------------------------------------------------------------------------------------------------------|------|-----|----------------------------------------------------------------------------------------------------------------------------|------|
| 1   | Installation plate<br>              | 1    | 6   | Drain elbow<br>                        | 2    |
| 2   | Installation plate fixing screw<br> | 6    | 7   | Band<br>                               | 1    |
| 3   | Remote control<br>                  | 1    | 8   | Remote Control holder<br>              | 1    |
| 4   | Battery<br>                         | 2    | 9   | Remote Control holder fixing screw<br> | 2    |
| 5   | Air purifying filter<br>            | 2    |     |                                                                                                                            |      |

Applicable piping kit  
CZ-3F5, 7AEN (CS/CU-A75KR, A95KR)  
CZ-4F5, 7, 10AN (CS/CU-A125KR)

SELECT THE BEST LOCATION

#### INDOOR UNIT

- There should not be any heat source or steam near the unit.
- There should not be any obstacles blocking the air circulation.
- A place where air circulation in the room is good.
- A place where drainage can be easily done.
- A place where noise prevention is taken into consideration.
- Do not install the unit near the door way.
- Ensure the spaces indicated by arrows from the wall, ceiling, or other obstacles.
- Indoor unit of this room air conditioner shall be installed on the wall in a height of at least 2.3 m.


#### OUTDOOR UNIT



- If an awning is built over the unit to prevent direct sunlight or rain, be careful that heat radiation from the condenser is not obstructed.
- There should not be any animal or plant which could be affected by hot air discharged.
- Keep the spaces indicated by arrows from wall, ceiling, fence or other obstacles.
- Do not place any obstacles which may cause a short circuit of the discharged air.
- If piping length is over the common length, additional refrigerant should be added as shown in the table.



| Model           | Piping size |        | Common Length | Max. Elevation (m) | Max. Piping Length (m) | Additional Refrigerant (g/m) |
|-----------------|-------------|--------|---------------|--------------------|------------------------|------------------------------|
|                 | Gas         | Liquid |               |                    |                        |                              |
| A75KR/<br>A95KR | 3/8"        | 1/4"   | 7.5           | 5                  | 10                     | 20                           |
| A125KR          | 1/2"        | 1/4"   | 7.5           | 5                  | 15                     | 20                           |

### Indoor/Outdoor unit installation diagram

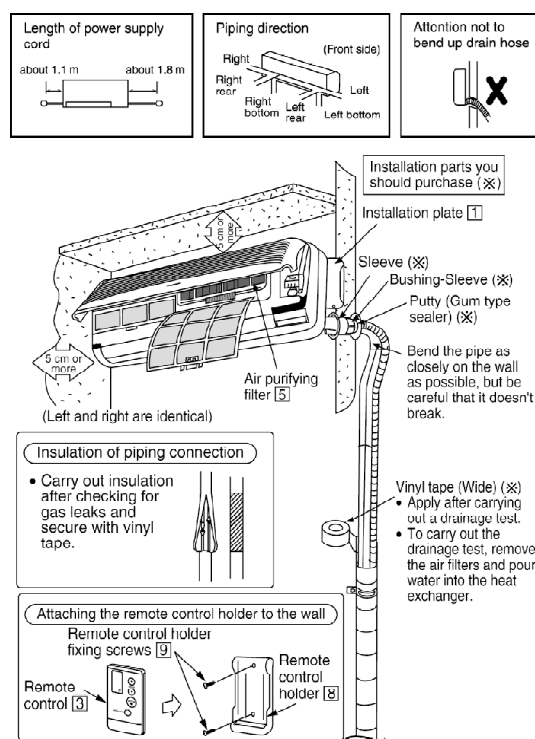

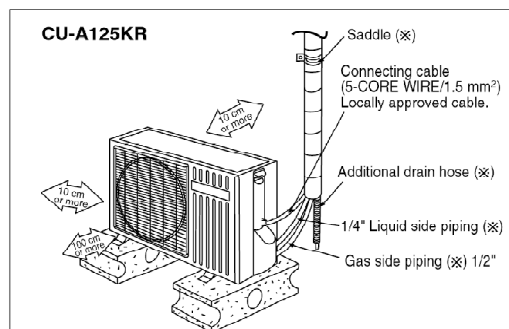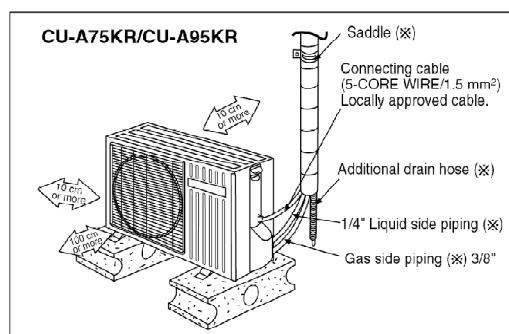


- This illustration is for explanation purposes only. / The indoor unit will actually face a different way.

## 10.2. INDOOR UNIT

10.2.1. SELECT THE BEST LOCATION / (Refer to "Select the best location" section)

### 10.2.2. HOW TO FIX INSTALLATION PLATE

The mounting wall is strong and solid enough to prevent it from the vibration.

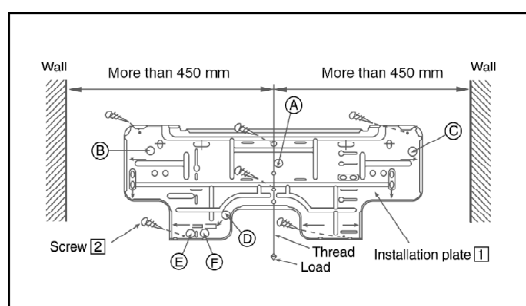

- Ⓐ : Unit centre should be at more than 450 mm at right and left of the wall.  
The height should be more than 195 mm from the ceiling.
- Ⓑ : From installation plate end to unit left side end is 50 mm.
- Ⓒ : From installation plate end to unit right side end is 50 mm.
- Ⓓ : Connecting cable should be about 750 mm from this line. (Only for left rear piping)
- Ⓔ : For left side piping, piping connection for liquid should be here.
- Ⓕ : For left side piping, piping connection for gas should be here.

**1. Mount the installation plate on the wall with 6 screws. / (If mounting the unit on the concrete wall consider using anchor bolts.)**

- Always mount the installation plate horizontally by aligning the marking-off line with the thread and using a level gauge.

**2. Drill the piping plate hole with ø70 mm hole-core drill.**

- Line according to the arrows marked on the lower left and right side of the installation plate. The meeting point of the extended line is the centre of the hole.
- Drill the piping hole at either the right or the left and the hole should be slightly slanted to the outdoor side.


### **10.2.3. TO DRILL A HOLE IN THE WALL AND INSTALL A SLEEVE OF PIPING**

- 1. Insert the piping sleeve to the hole.**
- 2. Fix the bushing to the sleeve.**
- 3. Cut the sleeve until it extrudes about 15 mm from the wall.**

**Caution**


When the wall is hollow, please be sure to use the sleeve for tube ass'y to prevent dangers caused by mice biting the indoor/outdoor connecting cable.

#### 4. Finish by sealing the sleeve with putty or caulking compound at the final stage.

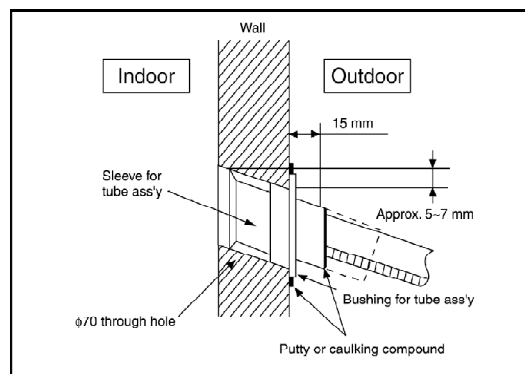


### 10.2.4. INDOOR UNIT INSTALLATION




#### 1. For the right rear piping

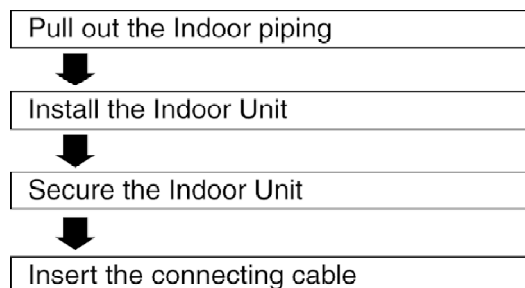


#### 2. For the right and right bottom piping

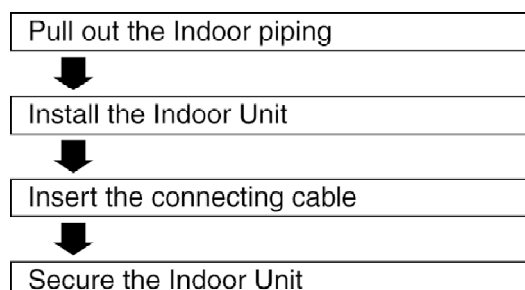

#### 3. For the embedded piping

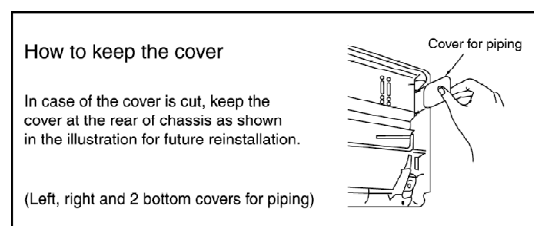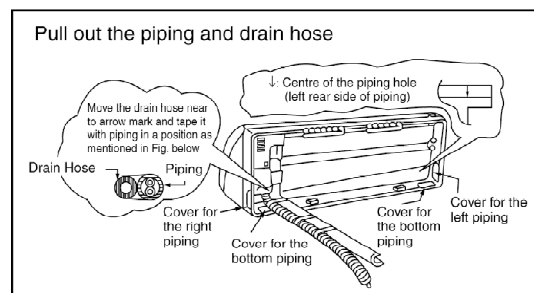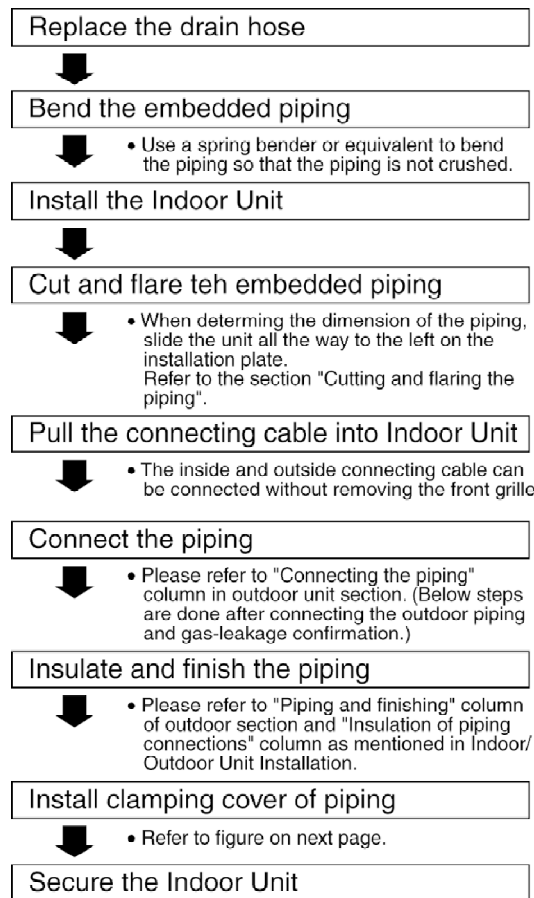


### Insert the connecting cable

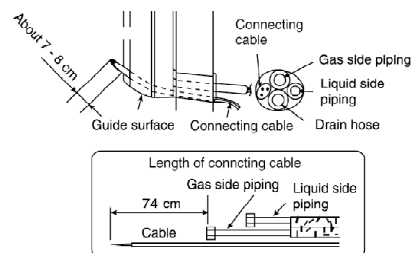


### Install the indoor unit

Hook the indoor unit onto the upper portion of installation plate (Engage the indoor unit with the upper edge of the installation plate). Ensure the hooks are properly seated on the installation plate by moving it in left and right.




### Secure the indoor unit

1. Tape the extra power supply cord in a bundle and keep it behind the chassis.
  - Ensure that the power supply cord is not clamped in between the unit's hook (2 positions) and installation plate
2. Press the lower left and right side of the unit against the installation plate until hooks engages with their slots (sound click).





To take out the unit, push the [PUSH] marking at the bottom unit, and pull it slightly towards you to disengage the hooks from the unit.




**(This can be used for left rear piping and left bottom piping also.)**

### Exchange the drain hose and the cap


Refer view for left piping installation



Adjust the piping slightly downwards

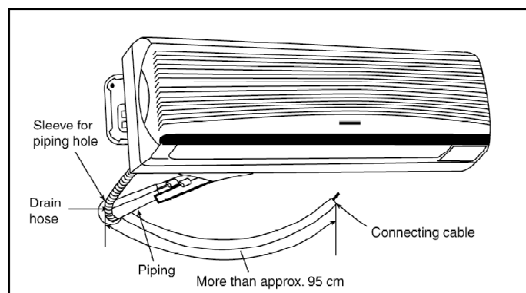


- How to pull the piping and drain hose out, in case of the embedded piping.

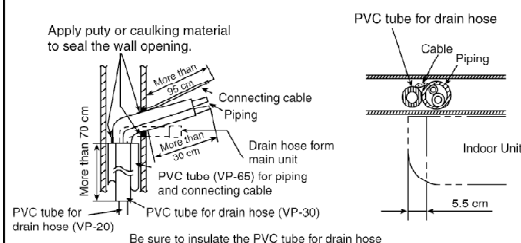


#### ATTACHMENT OF THE PIPING BAND


- For the right rear piping, it is not necessary to use piping band. The piping band can be attached when the extension flare pipe is used or when doing the piping work (under condition as shown in the diagram below) on the floor.
- The location to attach the piping band change according to the direction of the piping. Press the band knot to the hole in order to fix the band as shown in diagram below.

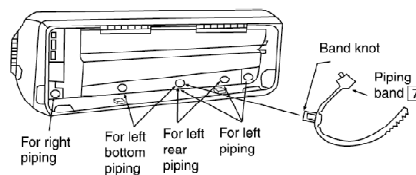

- Tighten the band so that the cable and the piping are secure. Be sure to cut any excess from the piping band (failure to cut away the excess piping band may produce abnormal noise during operation of condensation).



- In case of left piping how to insert the connecting cable and drain hose.



(For the right piping, follow the same procedure)

### 10.2.5. CONNECT THE CABLE TO THE INDOOR UNIT


1. The inside and outside connecting cable can be connected without removing the front grille.

**2. Connecting cable between indoor unit and outdoor unit shall be approved polychloroprene sheathed  $5 \times 1.5 \text{ mm}^2$  flexible cord, type designation H05 RN-F or heavier cord.**

- Ensure the color of wires of outdoor unit and the terminal Nos. are the same to the Indoor's respectively.
- Earth lead wire shall be longer than the other lead wires as shown in the figure for the electrical safety in case of the slipping out of the cord from the anchorage. /

|                               |                                                                                   |                                                                                   |                                                                                   |                                                                                    |                                                                                     |
|-------------------------------|-----------------------------------------------------------------------------------|-----------------------------------------------------------------------------------|-----------------------------------------------------------------------------------|------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|
| Terminals on the indoor unit  | 1                                                                                 | 2                                                                                 | 3                                                                                 | 4                                                                                  |  |
| Color of wires                |  |  |  |  |  |
| Terminals on the outdoor unit | 1                                                                                 | 2                                                                                 | 3                                                                                 | 4                                                                                  |  |


- Secure the cable onto the control board with the holder (clammer).

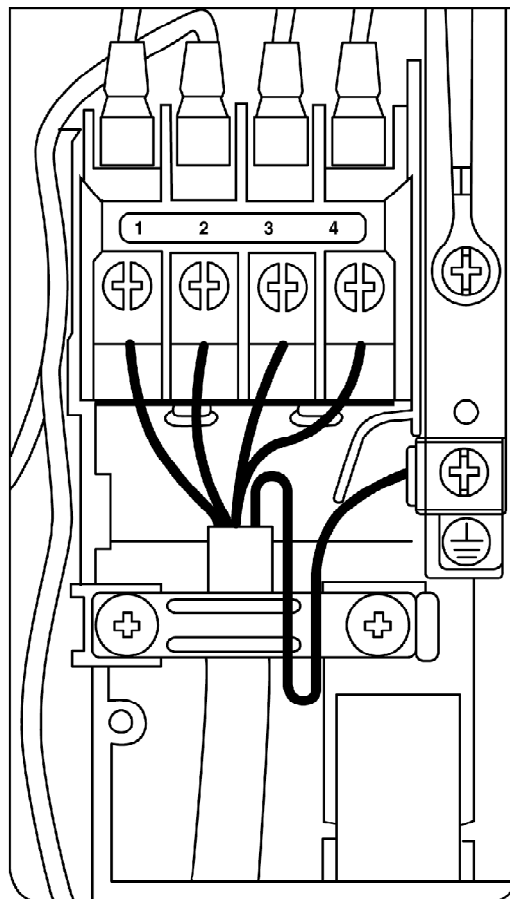

**INSTALLATION OF AIR PURIFYING FILTERS**



1. Open the front panel.
2. Remove the air filters.
3. Hold the purifying filters by their tabs and install as shown in the illustration at below.

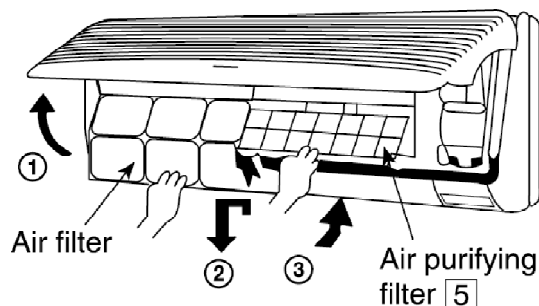


#### HOW TO TAKE OUT FRONT GRILLE

Please follow below steps to take out front grille if necessary such as when servicing.

1. Set the vertical airflow direction louver to the horizontal position.
2. Slide down the two caps on the front grille as shown in the illustration below, and then remove the two mounting screws.
3. Pull the lower section of the front grille towards you to remove the front grille.

When reinstalling the front grille, first set the vertical airflow direction louver to the horizontal position and then carry out above steps 2 - 3 in the reverse order.

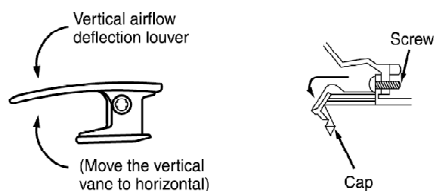

#### AUTO SWITCH OPERATION

The below operations will be performed by pressing the “AUTO” switch.

### **1. AUTO OPERATION MODE**


The Auto operation will be activated immediately once the Auto Switch is pressed.

### **2. TEST RUN OPERATION (FOR PUMP DOWN/SERVICING PURPOSE)**

The Test Run operation will be activated if the Auto Switch is pressed continuously for more than 5 sec. to below 10 sec. A “beep” sound will occur at the fifth sec., in order to identify the starting of Test Run operation

### **3. REMOTE CONTROLLER RECEIVING SOUND ON/OFF**

The ON/OFF of Remote Controller receiving sound can be change over by pressing the “AUTO” Switch continuously for 10 sec. and above. A “beep”, “beep” sound will occur at the tenth sec., in order to indicate the “ON/OFF” change over of remote control receiving sound.




## **10.3. OUTDOOR UNIT**

### **10.3.1. SELECT THE BEST LOCATION / (Refer to “Select the best location” section)**

### **10.3.2. INSTALL THE OUTDOOR UNIT**

- After selecting the best location, start installation according to Indoor/outdoor Unit Installation Diagram.

1. Fix the unit on concrete or rigid frame firmly and horizontally by bolt nut. (10 mm).
2. When installing at roof, please consider strong wind and earthquake. Please fasten the installation stand firmly with bolt or nails.

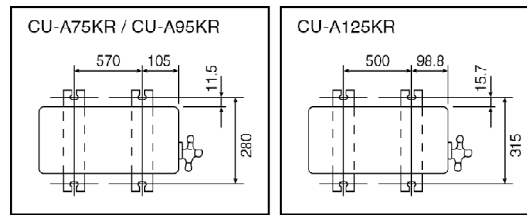


### 10.3.3. CONNECTING THE PIPING

#### Connecting the Piping to Indoor Unit

Please make flare after inserting flare nut (locate at joint portion of tube assembly) onto the copper pipe. (In case of using long piping)

Connect the piping

- Align the center of piping and sufficiently tighten the flare nut with fingers.
- Further tighten the flare nut with torque wrench in specified torque as stated in the table.

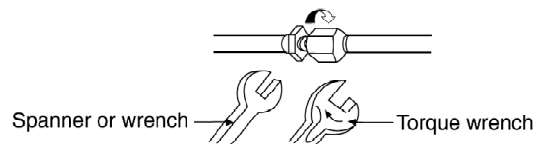

| MODEL       | Piping size (Torque) |               |
|-------------|----------------------|---------------|
|             | Gas                  | Liquid        |
| A75KR/A95KR | 3/8" (42 N.m)        | 1/4" (18 N.m) |
| A125KR      | 1/2" (55 N.m)        | 1/4" (18 N.m) |


#### Connecting the Piping to Outdoor Unit

Decide piping length and then cut by using pipe cutter. Remove burrs from cut edge. Make flare after inserting the flare nut (located at valve) onto the copper pipe.

Align center of piping to valves and then tighten with torque wrench to the specified torque as stated in the table.


#### CUTTING AND FLARING THE PIPING

1. Please cut using pipe cutter and then remove the burrs.
2. Remove the burrs by using reamer. If burrs is not removed, gas leakage may be caused.  
Turn the piping and down to avoid the metal powder entering the pipe.
3. Please make flare after inserting the flare nut onto the copper pipes.

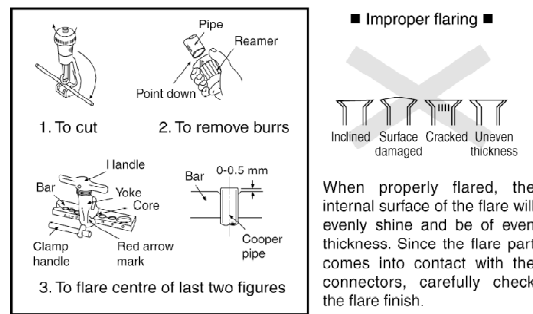

#### 10.3.4. EVACUATION OF THE EQUIPMENT

WHEN INSTALLING AND AIR CONDITIONER, BE SURE TO EVACUATE THE AIR INSIDE THE INDOOR UNIT AND PIPES in the following procedure.

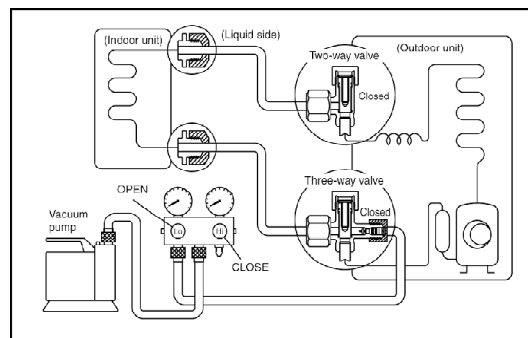

1. Connect a charging hose with a push pin to the Low and High side of a charging set and the service port of the 3-way valve.
  - Be sure to connect the end of the charging hose with the push pin to the service port.
2. Connect the center hose of the charging set to a vacuum pump.
3. Turn on the power switch of the vacuum pump and make sure that the needle in the gauge moves from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa). Then evacuate the air approximately ten minutes.
4. Close the valve of both the Low and High sides of the charging set and turn off the vacuum pump. Make sure that the needle in the gauge does not move after approximately five minutes.
 

**Note: BE SURE TO TAKE THIS PROCEDURE IN ORDER TO AVOID REFRIGERANT GAS LEAKAGE.**
5. Disconnect the charging hose from the vacuum pump and from the service port of the 3-way valve.
6. Tighten the service port caps of the 3-way valve at torque of 18 N.m with a torque wrench.

7. Remove the valve caps of both of the 2-way valve and 3-way valve. Position both of the valves to “OPEN” using a hexagonal wrench (4 mm).
8. Mount valve caps onto the 2-way valve and the 3-way valve.
  - Be sure to check for gas leakage.

**CAUTION**

- If gauge needle does not move from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa), in step 3 above take the following measure:
- If the leak stops when the piping connections are tightened further, continue working from step 3.
- If the leak does not stop when the connections are retightened, repair the location of leak.
- Do not release refrigerant during piping work for installation and re-installation. Take care of the liquid refrigerant, it may cause frostbite.

### 10.3.5. CONNECT THE CABLE TO THE OUTDOOR UNIT

1. Remove the control board cover from the unit by loosening the screw.
2. Connecting cable between indoor unit and outdoor unit shall be approved polychloroprene sheathed  $5 \times 1.5 \text{ mm}^2$  flexible cord, type designation H05 RN-F or heavier cord.

|                               |                                                                                     |                                                                                     |                                                                                     |                                                                                      |                                                                                       |
|-------------------------------|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|
| Terminals on the indoor unit  | 1                                                                                   | 2                                                                                   | 3                                                                                   | 4                                                                                    |  |
| Color of wires                |  |  |  |  |  |
| Terminals on the outdoor unit | 1                                                                                   | 2                                                                                   | 3                                                                                   | 4                                                                                    |  |

3. Secure the cable onto the control board with the holder (clammer).
4. Attach the control board cover back to the original position with the screw.

### 10.3.6. PIPE INSULATION


1. Please carry out insulation at pipe connection portion as mentioned in Indoor/Outdoor Unit Installation Diagram. Please

wrap the insulated piping end to prevent water from going inside the piping.

2. If drain hose or connecting piping is in the room (where dew may form), please increase the insulation by using POLY-E FOAM with thickness 6 mm or above.

#### DISPOSAL OF OUTDOOR UNIT DRAIN WATER


- If a drain elbow is used, the unit should be placed on a stand which is taller than 3 cm.
- If the unit is used in an area where temperature falls below 0°C for 2 or 3 days in succession, it is recommended not to use a drain elbow, for the drain water freezes and the fan will not rotate.



Install the hose at an angle so that the water smoothly flows out.


#### CHECK THE DRAINAGE

- Open front panel and remove air filters. / (Drainage checking can be carried out without removing the front grille.)
- Pour a glass of water into the drain tray-styrofoam.
- Ensure that water flows out from drain hose of the indoor unit.

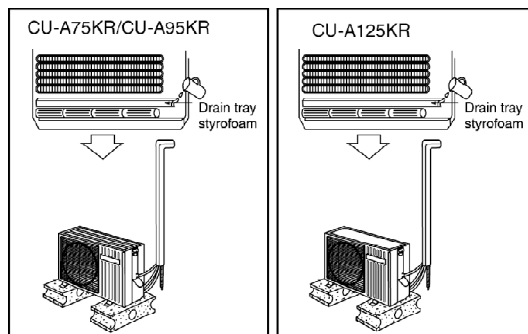

## EVALUATION OF THE PERFORMANCE

- Operate the unit at cooling operation mode for fifteen minutes or more.
- Measure the temperature of the intake and discharge air.
- Ensure the difference between the intake temperature and the discharge is more than 8°C.

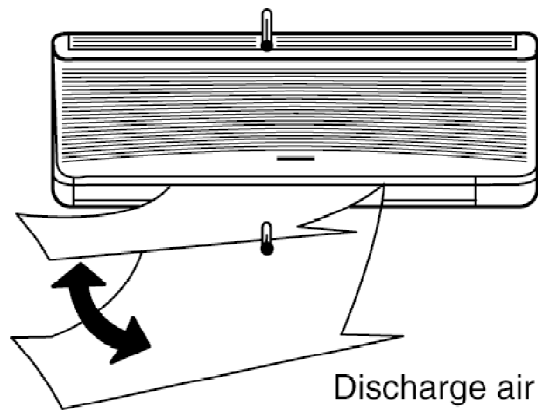

### NOTE

These equipment shall be connected to a suitable mains network with a main impedance less than the following:

CS-A75KR / CU-A75KR: 0.33  $\Omega$

CS-A95KR / CU-A95KR: 0.23  $\Omega$



CS-A125KR / CU-A125KR: 0.2  $\Omega$

## CHECK ITEMS

- ☐ Is there any gas leakage at flare nut connections?
- ☐ Has the heat insulation been carried out at flare nut connection?
- ☐ Is the connecting cable being fixed to terminal board firmly?
- ☐ Is the connecting cable being clamped firmly?
- ☐ Is the drainage OK?  
(Refer to "Check the drainage" section)
- ☐ Is the earth wire connection properly done?
- ☐ Is the indoor unit properly hooked to the installation plate?
- ☐ Is the power supply voltage complied with rated value?
- ☐ Is there any abnormal sound?
- ☐ Is the cooling operation normal?
- ☐ Is the thermostat operation normal?
- ☐ Is the remote control's LCD operation normal?
- ☐ Is the air purifying filter installed?

## 11. 2-way, 3-way Valve

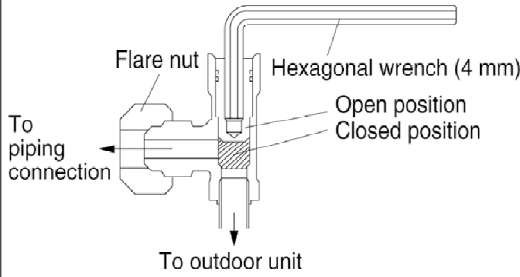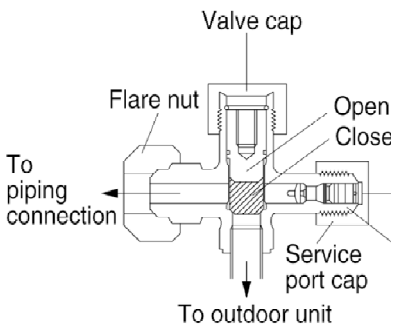


|                                                              | 2-way Valve (Liquid Side)                                                          | 3-way Valve (Gas Side)                                                              |                                   |
|--------------------------------------------------------------|------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|-----------------------------------|
|                                                              |  |  |                                   |
| <b>Works</b>                                                 | <b>Shaft Position</b>                                                              | <b>Shaft Position</b>                                                               | <b>Service</b>                    |
| <b>Shipping</b>                                              | <b>Close<br/>(With valve cap)</b>                                                  | <b>Closed<br/>(With valve cap)</b>                                                  | <b>Clo<br/>(With</b>              |
| <b>Evacuation<br/>(Installation and<br/>Re-installation)</b> | <b>Closed<br/>(Counter-Clockwise)</b>                                              | <b>Closed<br/>(Clockwise)</b>                                                       | <b>Op<br/>(Push</b>               |
| <b>Operation</b>                                             | <b>Open<br/>(With valve cap)</b>                                                   | <b>Open<br/>(With valve cap)</b>                                                    | <b>Clo<br/>(With</b>              |
| <b>Pumping down<br/>(Transferring)</b>                       | <b>Closed<br/>(Clockwise)</b>                                                      | <b>Open<br/>(Counter-<br/>Clockwise)</b>                                            | <b>Op<br/>(Conn<br/>manifol</b>   |
| <b>Evacuation<br/>(Servicing)</b>                            | <b>Open</b>                                                                        | <b>Open</b>                                                                         | <b>Op<br/>With vacu</b>           |
| <b>Gas charging<br/>(Servicing)</b>                          | <b>Open</b>                                                                        | <b>Open</b>                                                                         | <b>Op<br/>(With cl<br/>cylind</b> |
| <b>Pressure check<br/>(Servicing)</b>                        | <b>Open</b>                                                                        | <b>Open</b>                                                                         | <b>Op<br/>(Conn<br/>manifol</b>   |

|                              | 2-way Valve (Liquid Side) | 3-way Valve (Gas Side) |                            |
|------------------------------|---------------------------|------------------------|----------------------------|
| Gas releasing<br>(Servicing) | Open                      | Open                   | Open<br>(Connect manifold) |

## 11.1. Evacuation of Installation

**WHEN INSTALLING AN AIR CONDITIONER, BE SURE TO EVACUATE THE AIR INSIDE THE INDOOR UNIT AND PIPES in the following procedure.**

**If air remain in the indoor unit and refrigeration pipes, it will affect the compressor, reduce to cooling capacity, and could lead to a malfunction.**

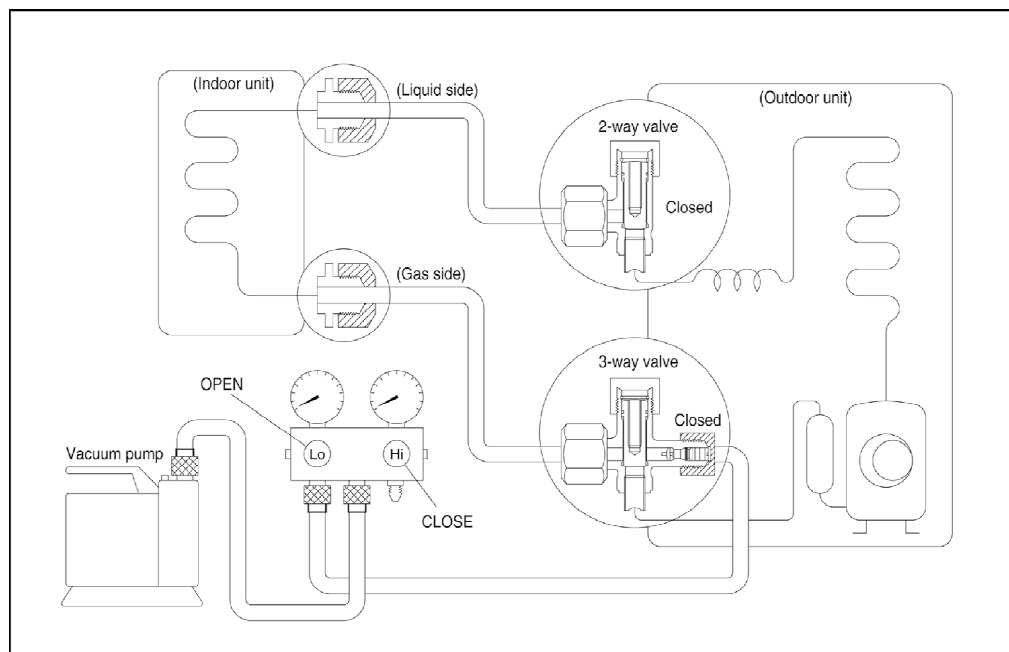

**Procedure:**

- 1. Connect a charging hose with a push pin to the Low side of a charging set and the service port of a 3-way valve.**
  - Be sure to connect the end of the charging hose with the push pin to the service port.**
- 2. Connect the centre hose of the charging set to a vacuum pump.**
- 3. Turn on the power switch of the vacuum pump and make sure that the needle in the gauge moves from 0 MPa (0 cmHg) to -0.1 MPa (-76 cmHg). Then evacuate the air for approximately ten minutes.**

4. Close the Low side valve of the charging set and turn off the vacuum pump. Make sure that the needle in the gauge does not move after approximately five minutes.  
**BE SURE TO TAKE THIS PROCEDURE IN ORDER TO AVOID GAS LEAKAGE.**
5. Disconnect the charging hose from the vacuum pump and from the service port of the 3-way valve.
6. Tighten the service port cap at a torque of 18 N.m with a torque wrench.
7. Remove the valve caps of the 2-way valve and the 3-way valve. Position both of the valves to “open” using a hexagonal wrench (4 mm).
8. Mount the valve caps onto the 2-way and 3-way valves.
  - Be sure to check for gas leakage.


**Caution**

If gauge needle does not move from 0 cmHg to -76 cmHg in step (3) above, take the following measures:

If the leaks stop when the piping connections are tightened further, continue working from step (3).

If the leaks do not stop when the connections are retightened, repair the location of the leak.

## **11.2. Pumping down**

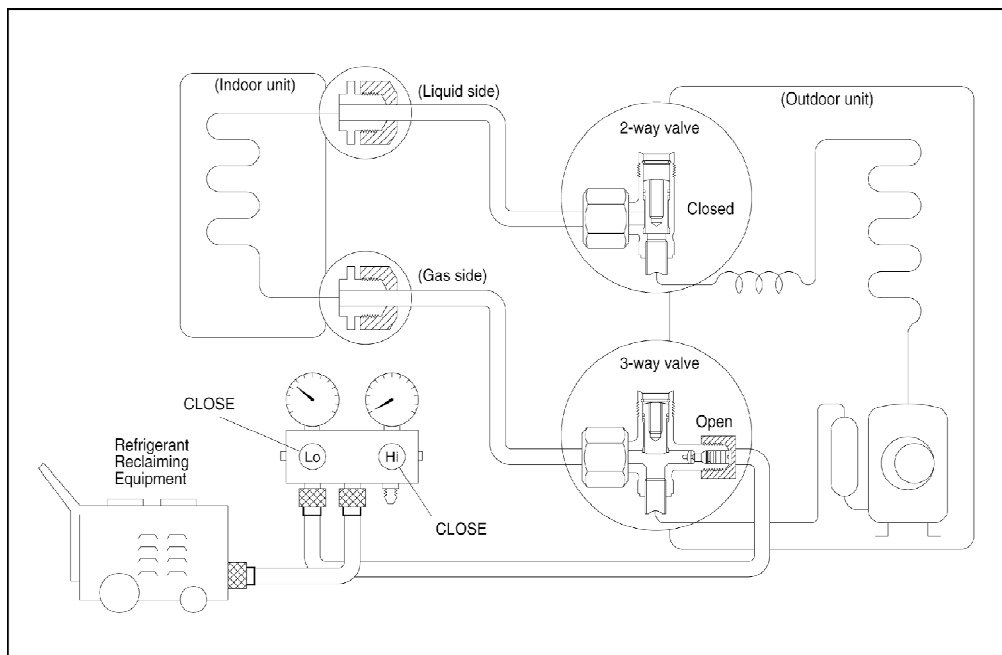

**Procedure:**

- 1. Confirm that both the 2-way and 3-way valves are set to the opened position.**
  - Remove the valve stem caps and confirm that the valve stems are in the opened position.
  - Be sure to use a hexagonal wrench to operate the valve stems.
- 2. Operate the unit for 10 to 15 minutes.**
- 3. Stop operation and wait for 3 minutes, then connect the charge set to the service port of the 3-way valve.**
  - Connect the charge hose with the push pin to the Gas service port.
- 4. Air purging of the charge hose.**
  - Open the low-pressure valve on the charge set slightly to purge air from the charge hose.
- 5. Set the 2-way valve to the closed position.**
- 6. Operate the air conditioner at the cooling cycle and stop it when the gauge indicates 0 MPa (0 kg/cm<sup>2</sup>G).**

If the unit cannot be operated at the cooling condition (weather is rather cool), short the Pumping Down pins on the Main Control

**P.C.B.**

(Simply press the pumping down button if it is equipped.)

**So that the unit can be operated.**

**7. Immediately set the 3-way valve to the closed position.**

- Do this quickly so that the gauge ends up indicating 0.1 MPa (1 kg/cm<sup>2</sup>G) to 0.3 MPa (3 kg/cm<sup>2</sup>G).

**8. Use refrigerant reclaiming equipment to collect refrigerant from indoor unit and pipes.**

**9. Disconnect the charge set, and mount the 2-way and 3-way valve's stem caps and the service port caps.**


- Use a torque wrench to tighten the service port cap to a torque of 18 N.m.
- Be sure to check for gas leakage.

**10. Disconnect pipes from indoor unit and outdoor unit.**

### **11.3. Evacuation of Re-installation**

**WHEN REINSTALLING AN AIR CONDITIONER, BE SURE TO EVACUATE THE AIR INSIDE THE INDOOR UNIT AND PIPES in the following procedure.**

**If air remain in the indoor unit and refrigeration pipes, it will affect the compressor, reduce to cooling capacity, and could lead to a malfunction.**

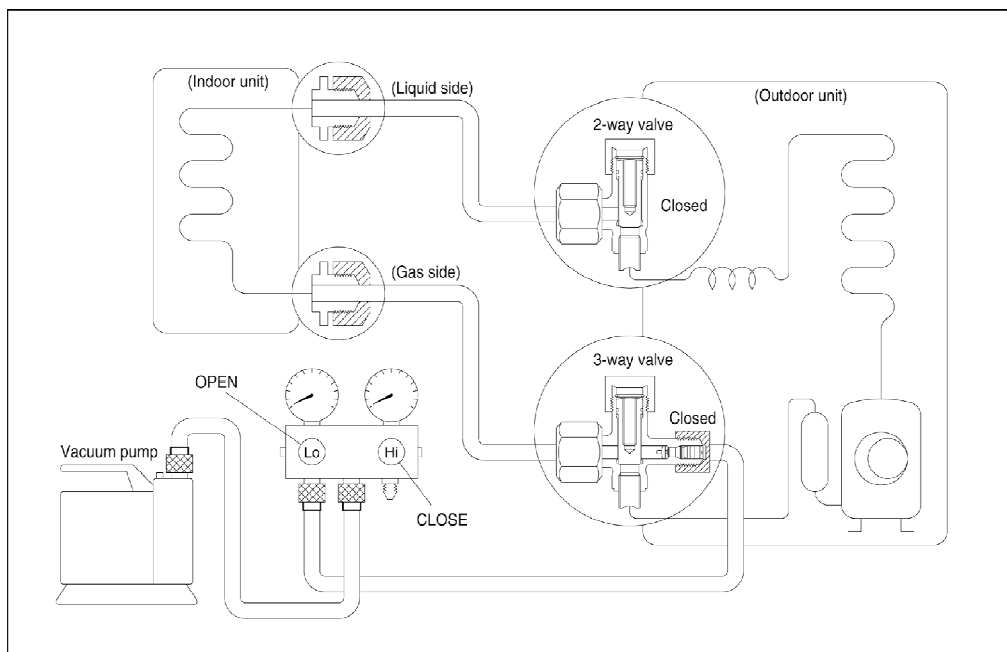

**Procedure:**

- 1. Connect a charging hose with a push pin to the Low side of a charging set and the service port of the 3-way valve.**
  - Be sure to connect the end of the charging hose with the push pin to the service port.**
- 2. Connect the centre hose of the charging set to a vacuum pump.**
- 3. Turn on the power switch of the vacuum pump and make sure that the needle in the gauge moves from 0 MPa (0 cmHg) to -0.1 MPa (-76 cmHg). Then evacuate the air for approximately ten minutes.**
- 4. Close the Low side valve of the charging set and turn off the vacuum pump. Make sure that the needle in the gauge does not move after approximately five minutes.**

**BE SURE TO TAKE THIS PROCEDURE IN ORDER TO AVOID GAS LEAKAGE.**
- 5. Disconnect the charging hose from the vacuum pump.**
- 6. Charge the pipes and indoor unit with gas refrigerant from 3-way valve service port, and then discharge the refrigerant until low side (gas side) gauge needle indicates 0.3 MPa (3 kg/cm<sup>2</sup>).**
- 7. Tighten the service port cap at a torque of 18 N.m with a torque wrench.**
- 8. Remove the valve caps of the 2-way valve and the 3-way valve. Position both of the valves to “open” using a hexagonal wrench (4 mm).**
- 9. Mount the valve caps onto the 2-way and 3-way valves.**
  - BE SURE TO USE REFRIGERANT RECLAIMING EQUIPMENT WHILE DISCHARGING THE REFRIGERANT.**
  - Purge the air from charge set's centre hose.**
  - Be sure to check for gas leakage.**

**Caution**


If gauge needle does not move from 0 MPa (0 cmHg) to -0.1 MPa (-76 cmHg) in step (3) above, take the following measures:

If the leaks stop when the piping connections are tightened further, continue working from step 3.

If the leaks do not stop when the connections are retightened, repair the location of the leak.

### 11.4. Balance refrigerant of the 2-way, 3-way valves

(Lack of refrigerant in the refrigeration cycle)

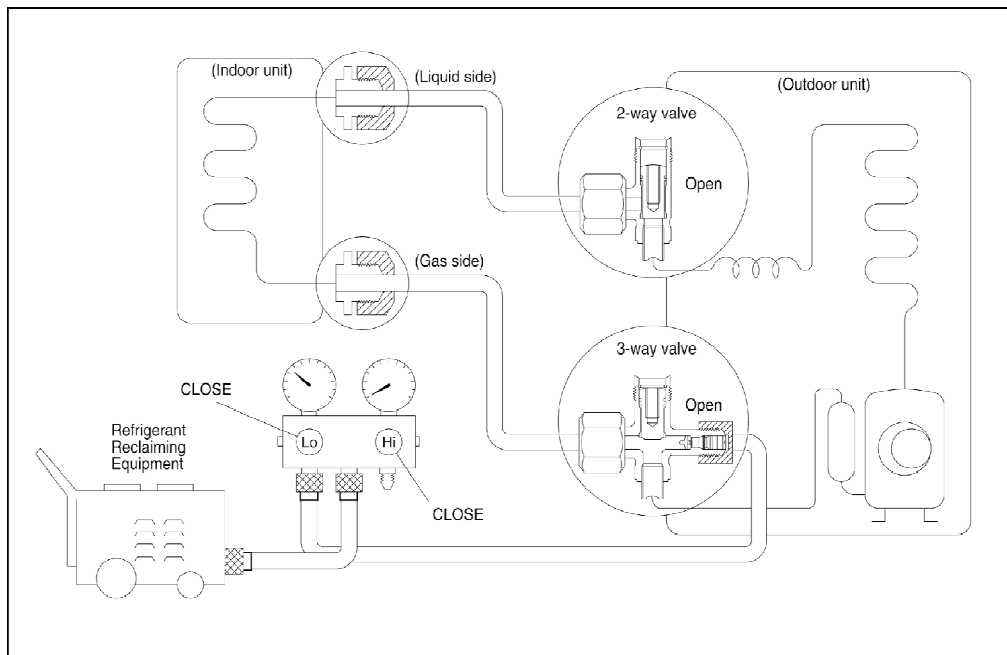


Procedure:

1. Confirm that both the 2-way and 3-way valves are set to the open position.
2. Connect the charge set to the 3-way valve's service port.
  - Leave the valve on the charge set closed.
  - Connect the charge hose with the push-pin to the service port.
3. Connect the charge set's centre hose to refrigerant reclaiming equipment.

- Purge the air from charge hose.
4. Open the valve (Low side) on the charge set and discharge the refrigerant until the gauge indicates 0.05 MPa (0.5 kg/cm<sup>2</sup>G) to 0.1 MPa (1 kg/cm<sup>2</sup>G).
    - If there is no air in the refrigeration cycle (the pressure when the air conditioner is not running is higher than 0.1 MPa (1 kg/cm<sup>2</sup>G), discharge the refrigerant until the gauge indicates 0.05 MPa (0.5 km/cm<sup>2</sup>G) to 0.1 MPa (1 kg/cm<sup>2</sup>G). If this is the case, it will not be necessary to apply a evacuation.
    - Discharge the refrigerant gradually; if it is discharged too suddenly, the refrigeration oil will also be discharged.
  5. Turn on refrigerant reclaiming equipment.

### 11.5. Evacuation

(No refrigerant in the refrigeration cycle)

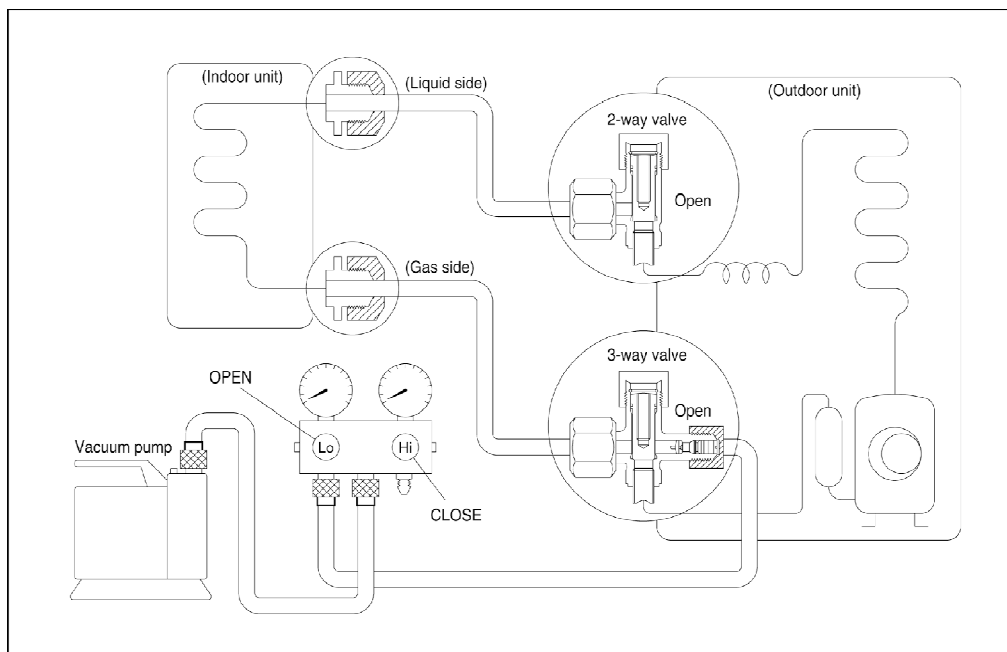

Procedure:

1. Connect the vacuum pump to the charge set's centre hose.
2. Evacuation for approximately one hour.
  - Confirm that the gauge needle has moved toward -0.1 MPa (-76 cmHg) [vacuum of 4 mmHg or less.]
3. Close the valve (Low side) on the charge set, turn off the vacuum



**pump, and confirm that the gauge needle does not move (approximately 5 minutes after turning off the vacuum pump).**


**4. Disconnect the charge hose from the vacuum pump.**

**- Vacuum pump oil**

**If the vacuum pump oil becomes dirty or depleted, replenish as needed.**

## **11.6. Gas charging**

**(After Evacuation)**

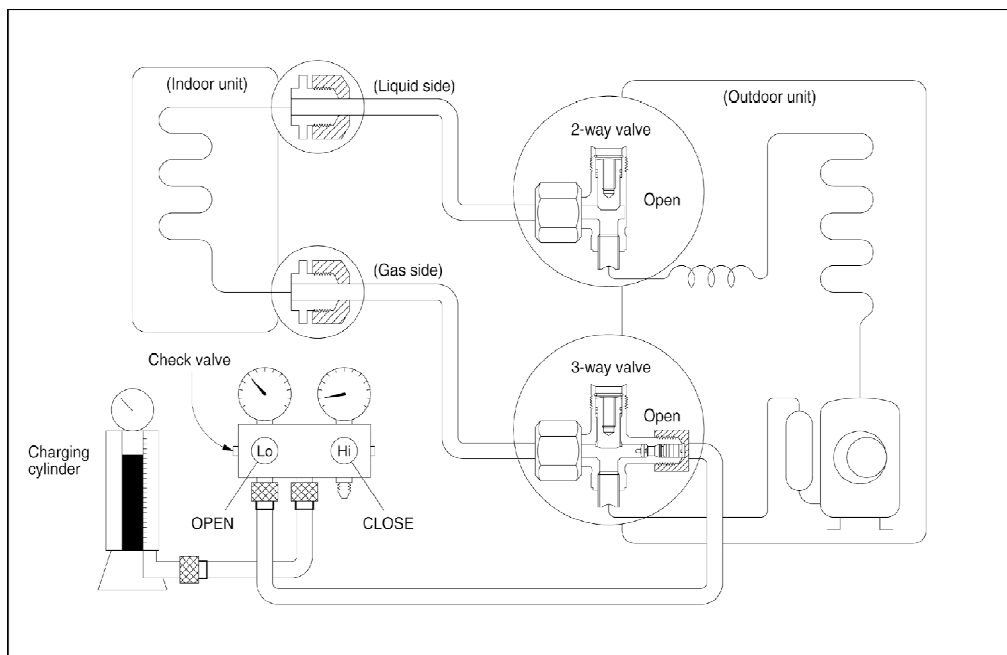

**Procedure:**

**1. Connect the charge hose to the charging cylinder.**

**- Connect the charge hose which you disconnected from the vacuum pump to the valve at the bottom of the cylinder.**

**2. Purge the air from the charge hose.**

**- Open the valve at the bottom of the cylinder and press the check valve on the charge set to purge the air (be careful of the liquid refrigerant).**

**3. Open the valve (Low side) on the charge set and charge the system with liquid refrigerant.**

**- If the system cannot be charged with the specified amount of**

refrigerant, it can be charged with a little at a time (approximately 150 g each time) while operating the air conditioner in the cooling cycle; however, one time is not sufficient, wait approximately 1 minute and then repeat the procedure. (pumping down-pin)

This is different from previous procedures. Because you are charging with liquid refrigerant from the gas side, absolutely do not attempt to charge with large amount of liquid refrigerant while operating the air conditioner.

**4. Immediately disconnect the charge hose from the 3-way valve's service port.**

- Stopping partway will allow the refrigerant to be discharged.
- If the system has been charged with liquid refrigerant while operating the air conditioner, turn off the air conditioner before disconnecting the hose.

**5. Mount the valve stem caps and the service port cap.**

- Use torque wrench to tighten the service port cap to a torque of 18 N.m.
- Be sure to check for gas leakage.

## **12. Servicing Information**

- Inspection points for the Indoor Electronic Controller

**1. The Electronic Controller, a signal Receiver and an Indicator ([Fig. 2](#)) can be seen by the below steps:**

- Remove the 2 caps and 2 screws at the bottom of the front grille. ([Fig. 1](#))
- Remove the front grille by releasing the 2 hooks at the top of the front grille. ([Fig. 1](#))
- Remove the control board cover by releasing the 2 tabs at left, 1 tab on top and 2 more tabs at right side of the control board cover. ([Fig. 1](#))

**2. To remove the Electronic Controller, release the hook that**

holding the electronic controller. (Fig. 2)

- Indoor Fan Motor removal procedure:-

1. Remove the control board by:-

- Releasing CN-C (GRN) connector. (Fig. 2)
- Releasing CN-FM (GRN) connector. (Fig. 2)
- Releasing CN-STM connector. (Fig. 2)
- Remove the earth wire screw. (Fig. 2)
- Release the intake air sensor. (Fig. 2)
- Release the piping sensor. (Fig. 2)
- Unhook and release the terminal board. (Fig. 3)
- Remove the right and left screws. (Fig. 3)
- Then remove the control board by pressing down the hook at the left and press up the right hook. (Fig. 3)

2. Remove the Fan Motor by:-

- Release the Fan motor leadwire by pressing the hook at the center of the connector. (Fig. 4)
- Then remove the particular piece that holding the fan motor by pressing the tab. (Fig. 4)
- Remove the discharge grille and then the drain hose. (Fig. 4)

Fig. 1

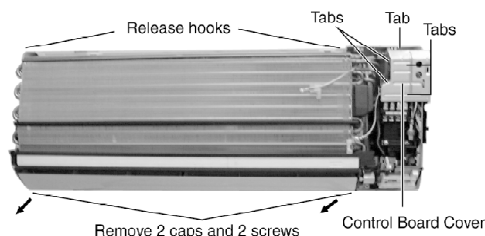


Fig. 2

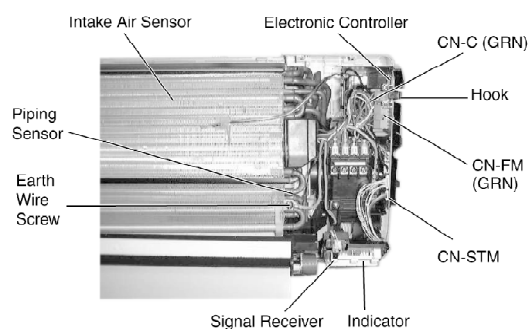


Fig. 3


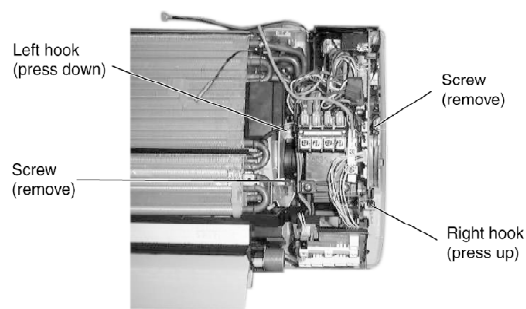


**Fig. 4**

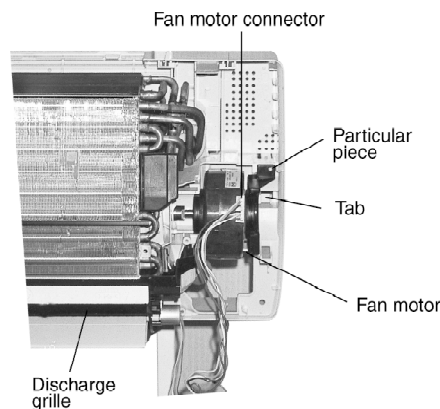

- Finally remove the fan motor by removing the screw. (**Fig. 5**)
- REMINDER - To reinstall the fan motor, adjust the connector of the fan motor as **Fig. 5**.
- Cross Flow Fan Removal Procedure.
  1. Remove the control board and the fan motor by referring to the "Indoor Fan Motor Removal Procedure".
  2. Remove the evaporator screw. (**Fig. 6**)
  3. Press the particular piece to loosen the evaporator. (**Fig. 7**)
  4. Remove the bearing. (**Fig. 7**)
  5. Push up the evaporator and take out the cross-flow Fan. (**Fig. 7**)

**Fig. 5**

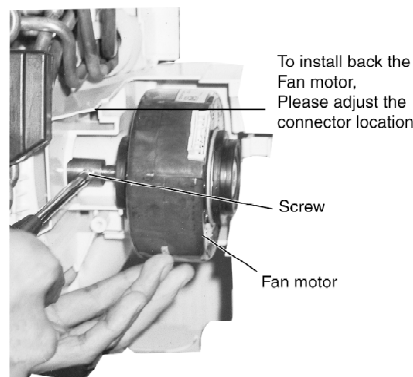


**Fig. 6**


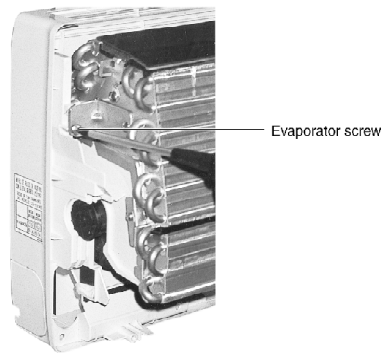


**Fig. 7**

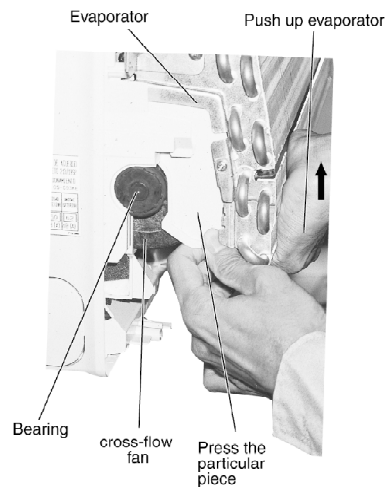



**- Remote Control Reset**

When the batteries are inserted for the first time, or the batteries are replaced, all the indications will blink and the remote control might not work.

If this happen, remove the back cover of the remote control and you will find a resetting terminal, and by shorting it with a minus screwdriver, it will return to normal.

**- Changing the wireless remote control transmission code**

When two indoor units are installed in the same room, in order to prevent operating errors caused by using two remote controls, add a jumper wire to the remote control side (J-B) and a carbon resistor (1/4 W, 10 kW) to the indoor printed circuit (RX-1) board, it is possible to select from 2 types of transmission codes including one at time of delivery condition (1).

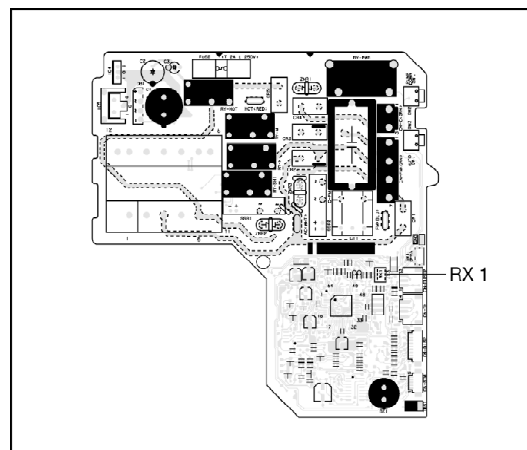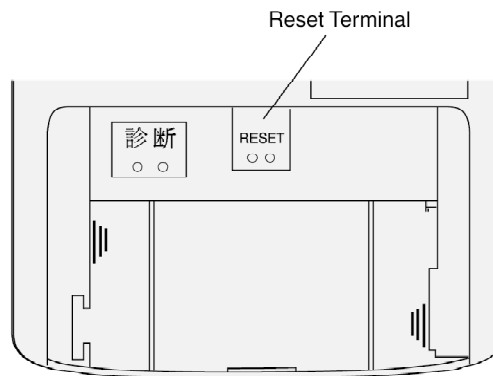

|   | Remote control | Indoor printed circuit board |       | Note                |
|---|----------------|------------------------------|-------|---------------------|
|   | J - B          | SW1                          | RX1   |                     |
| 1 | —              | OPEN                         | —     | At product delivery |
| 2 | Jumper wire    | OPEN                         | 10 kΩ |                     |

NOTE: As of information in Electronic Circuit Diagram.

## 13. Troubleshooting Guide

### 13.1. Refrigeration cycle system


In order to diagnose malfunctions, make sure that there are no electrical problems before inspecting the refrigeration cycle. Such problems include insufficient insulation, problem with the power source, malfunction of a compressor and a fan.

The normal outlet air temperature and pressure of the refrigeration cycle depends on various conditions, the standard values for them are shown in the table to the right.

Normal Pressure and Outlet Air Temperature (Standard)

|              | Gas pressure<br>Mpa<br>(kg/cm <sup>2</sup> G) | Outlet air<br>temperature<br>(°C) |
|--------------|-----------------------------------------------|-----------------------------------|
| Cooling Mode | 0.4 ~ 0.6 (4 ~ 6)                             | 12 ~ 16                           |
| Heating Mode | 1.5 ~ 2.1 (15 ~ 21)                           | 36 ~ 45                           |

\* Condition: Indoor fan speed; High  
Outdoor temperature 35°C at the cooling mode and 7°C at the heating mode

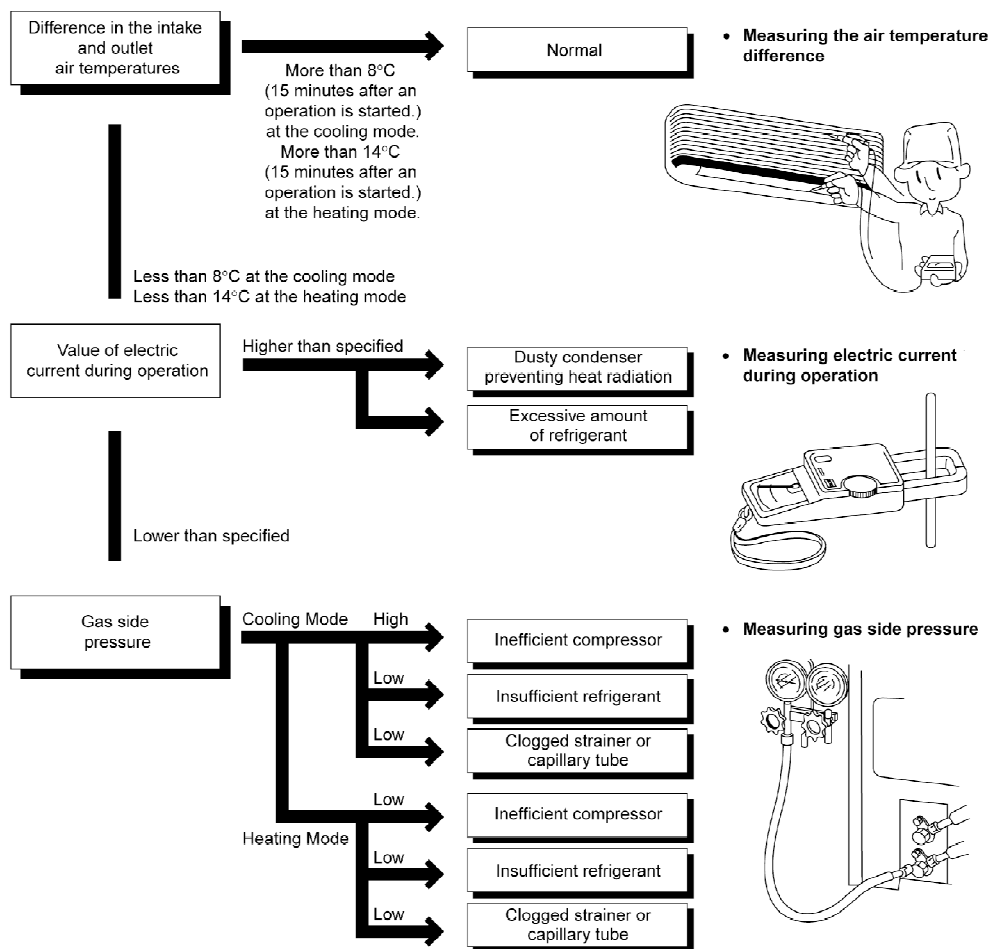

### 13.1.1. Relationship between the condition of the air conditioner and pressure and electric current

| Condition of the air conditioner              | Cooling Mode                                                                        |                                                                                     |                                                                                     | Heating Mode                                                                          |                                                                                       |                                                                                       |
|-----------------------------------------------|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|
|                                               | Low Pressure                                                                        | High Pressure                                                                       | Electric current during operation                                                   | Low Pressure                                                                          | High Pressure                                                                         | Electric current during operation                                                     |
| Insufficient refrigerant (gas leakage)        |    |    |    |    |    |    |
| Clogged capillary tube or Strainer            |    |    |    |    |    |    |
| Short circuit in the indoor unit              |    |    |    |    |    |    |
| Heat radiation deficiency of the outdoor unit |  |  |  |  |  |  |
| Inefficient compression                       |  |  |  |  |  |  |

- Carry out the measurements of pressure, electric current, and temperature fifteen minutes after an operation is started.

### 13.1.2. Diagnosis methods of a malfunction of a compressor and 4-way valve




| Nature of fault                                 | Symptom                                                                                                                                                                                                                                                                                                                      |
|-------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Insufficient compressing of a compressor</b> | <ul style="list-style-type: none"> <li>-Electric current during operation becomes approximately 20% lower than the normal value</li> <li>-The discharge tube of the compressor becomes abnormally hot (normally 70 to 90°C).</li> <li>-The difference between high pressure and low pressure becomes almost zero.</li> </ul> |
| <b>Locked compressor</b>                        | <ul style="list-style-type: none"> <li>-Electric current reaches a high level abnormally, and the value exceeds the limit of an ammeter. In some cases, a breaker turns off.</li> <li>-The compressor is a humming sound.</li> </ul>                                                                                         |
| <b>Insufficient switches of the 4-way valve</b> | <ul style="list-style-type: none"> <li>-Electric current during operation becomes approximately 80% lower than the normal value</li> <li>-The temperature difference between from the discharge tube to the 4-way valve and from the 4-way valve to the 4-way valve becomes almost zero.</li> </ul>                          |

## 14. Technical Data


## ■ Thermostat characteristics

CS-A75KR / CS-A95KR / CS-A125KR


### • Cooling

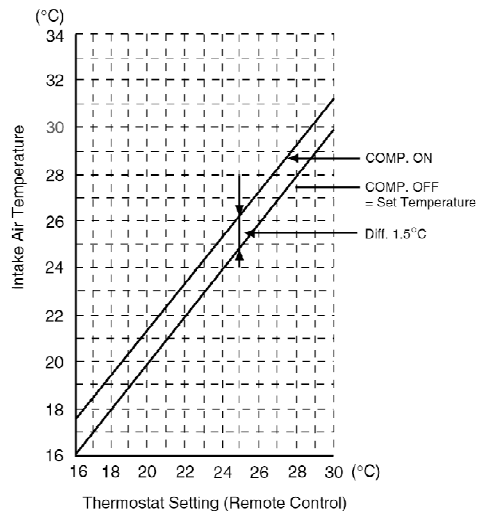

### • Soft Dry

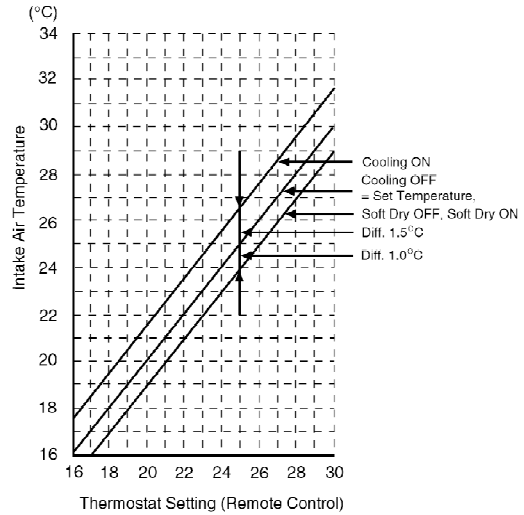

### • Heating

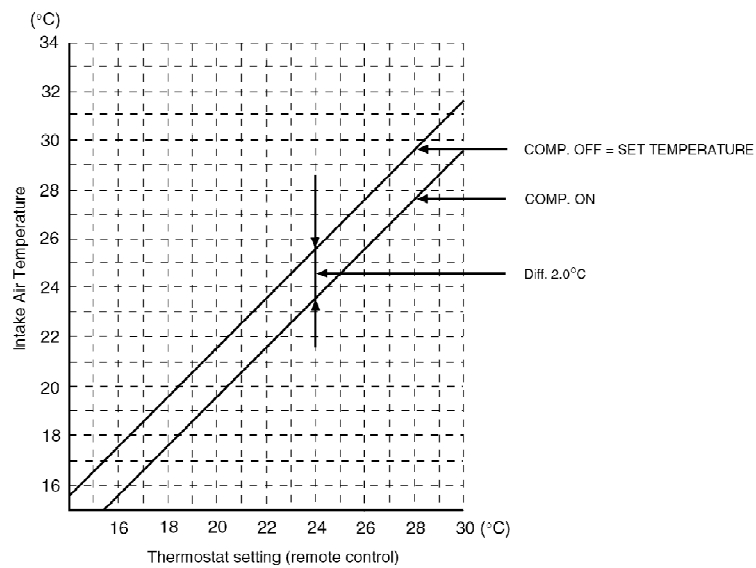

## ■ Sensible Capacity Chart

### • CS-A75KR

| 240V                        | Outdoor Temp. (°C) |      |      |      |      |      |      |      |      |      |      |      |
|-----------------------------|--------------------|------|------|------|------|------|------|------|------|------|------|------|
| Indoor<br>wet bulb<br>temp. | 30                 |      |      | 35   |      |      | 40   |      |      | 46   |      |      |
|                             | TC                 | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   |
| 17.0°C                      | 2.09               | 1.59 | 0.60 | 1.96 | 1.52 | 0.65 | 1.82 | 1.46 | 0.70 | 1.65 | 1.39 | 0.75 |
| 19.0°C                      |                    |      |      | 2.11 |      | 0.66 |      |      |      |      |      |      |
| 19.5°C                      | 2.30               | 1.66 | 0.62 | 2.15 | 1.60 | 0.66 | 2.00 | 1.54 | 0.71 | 1.82 | 1.46 | 0.76 |
| 22.0°C                      | 2.50               | 1.72 | 0.63 | 2.34 | 1.66 | 0.67 | 2.18 | 1.60 | 0.72 | 1.98 | 1.52 | 0.78 |

| 220V                        | Outdoor Temp. (°C) |      |      |      |      |      |      |      |      |      |      |      |
|-----------------------------|--------------------|------|------|------|------|------|------|------|------|------|------|------|
| Indoor<br>wet bulb<br>temp. | 30                 |      |      | 35   |      |      | 40   |      |      | 46   |      |      |
|                             | TC                 | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   |
| 17.0°C                      | 2.04               | 1.55 | 0.56 | 1.91 | 1.49 | 0.60 | 1.78 | 1.43 | 0.64 | 1.62 | 1.36 | 0.69 |
| 19.0°C                      |                    |      |      | 2.06 |      | 0.61 |      |      |      |      |      |      |
| 19.5°C                      | 2.24               | 1.62 | 0.57 | 2.10 | 1.56 | 0.61 | 1.95 | 1.50 | 0.66 | 1.77 | 1.43 | 0.71 |
| 22.0°C                      | 2.45               | 1.68 | 0.58 | 2.28 | 1.62 | 0.62 | 2.13 | 1.56 | 0.67 | 1.93 | 1.49 | 0.72 |

• CS-A95KR

| 240V                        | Outdoor Temp. (°C) |      |      |      |      |      |      |      |      |      |      |      |
|-----------------------------|--------------------|------|------|------|------|------|------|------|------|------|------|------|
| Indoor<br>wet bulb<br>temp. | 30                 |      |      | 35   |      |      | 40   |      |      | 46   |      |      |
|                             | TC                 | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   |
| 17.0°C                      | 2.63               | 1.99 | 0.89 | 2.46 | 1.91 | 0.96 | 2.28 | 1.84 | 1.02 | 2.08 | 1.75 | 1.10 |
| 19.0°C                      |                    |      |      | 2.65 |      | 0.97 |      |      |      |      |      |      |
| 19.5°C                      | 2.89               | 2.09 | 0.91 | 2.70 | 2.00 | 0.97 | 2.51 | 1.93 | 1.04 | 2.28 | 1.84 | 1.12 |
| 22.0°C                      | 3.15               | 2.16 | 0.92 | 2.94 | 2.08 | 0.99 | 2.73 | 2.01 | 1.06 | 2.49 | 1.91 | 1.14 |

| 220V                        | Outdoor Temp. (°C) |      |      |      |      |      |      |      |      |      |      |      |
|-----------------------------|--------------------|------|------|------|------|------|------|------|------|------|------|------|
| Indoor<br>wet bulb<br>temp. | 30                 |      |      | 35   |      |      | 40   |      |      | 46   |      |      |
|                             | TC                 | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   |
| 17.0°C                      | 2.58               | 1.96 | 0.84 | 2.41 | 1.88 | 0.91 | 2.24 | 1.80 | 0.97 | 2.04 | 1.71 | 1.05 |
| 19.0°C                      |                    |      |      | 2.60 |      | 0.92 |      |      |      |      |      |      |
| 19.5°C                      | 2.83               | 2.05 | 0.86 | 2.65 | 1.97 | 0.92 | 2.46 | 1.89 | 0.99 | 2.24 | 1.80 | 1.07 |
| 22.0°C                      | 3.09               | 2.12 | 0.87 | 2.88 | 2.04 | 0.94 | 2.68 | 1.97 | 1.01 | 2.44 | 1.88 | 1.08 |

• CS-A125KR

| 240V                        | Outdoor Temp. (°C) |      |      |      |      |      |      |      |      |      |      |      |
|-----------------------------|--------------------|------|------|------|------|------|------|------|------|------|------|------|
| Indoor<br>wet bulb<br>temp. | 30                 |      |      | 35   |      |      | 40   |      |      | 46   |      |      |
|                             | TC                 | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   |
| 17.0°C                      | 3.37               | 2.56 | 1.20 | 3.15 | 2.45 | 1.29 | 2.93 | 2.36 | 1.38 | 2.67 | 2.24 | 1.49 |
| 19.0°C                      |                    |      |      | 3.40 |      | 1.31 |      |      |      |      |      |      |
| 19.5°C                      | 3.70               | 2.68 | 1.22 | 3.46 | 2.57 | 1.32 | 3.22 | 2.48 | 1.41 | 2.93 | 2.36 | 1.52 |
| 22.0°C                      | 4.04               | 2.78 | 1.24 | 3.77 | 2.67 | 1.34 | 3.51 | 2.58 | 1.43 | 3.19 | 2.46 | 1.54 |

| 220V                        | Outdoor Temp. (°C) |      |      |      |      |      |      |      |      |      |      |      |
|-----------------------------|--------------------|------|------|------|------|------|------|------|------|------|------|------|
| Indoor<br>wet bulb<br>temp. | 30                 |      |      | 35   |      |      | 40   |      |      | 46   |      |      |
|                             | TC                 | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   | TC   | SHC  | IP   |
| 17.0°C                      | 3.37               | 2.56 | 1.15 | 3.15 | 2.45 | 1.24 | 2.93 | 2.36 | 1.33 | 2.67 | 2.24 | 1.43 |
| 19.0°C                      |                    |      |      | 3.40 |      | 1.26 |      |      |      |      |      |      |
| 19.5°C                      | 3.70               | 2.68 | 1.18 | 3.46 | 2.57 | 1.27 | 3.22 | 2.48 | 1.35 | 2.93 | 2.36 | 1.46 |
| 22.0°C                      | 4.04               | 2.78 | 1.20 | 3.77 | 2.67 | 1.29 | 3.51 | 2.58 | 1.38 | 3.19 | 2.46 | 1.49 |


TC - Total Cooling Capacity (kW)  
SHC - Sensible Heat Capacity (kW)  
IP - Input Power (kW)

Indoor 27°C/19°C  
Outdoor 35°C/24°C


## ■ Operation characteristics

### CS-A75KR / CU-A75KR


#### • Cooling Characteristic

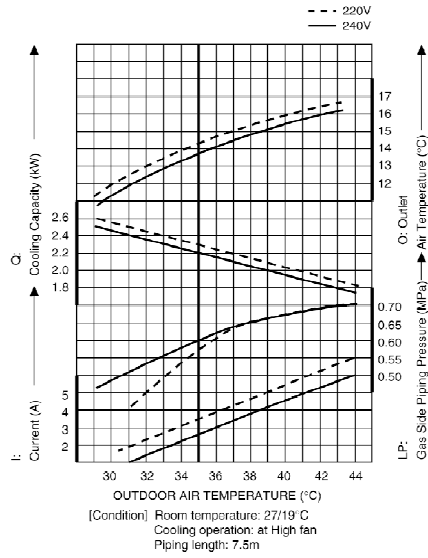


#### • Piping Length Characteristic (Cooling)

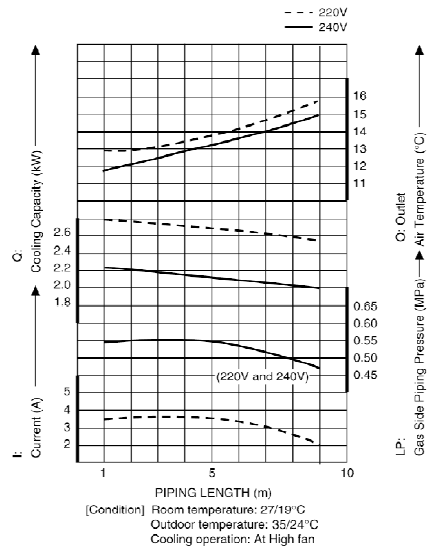

#### • Heating Characteristic

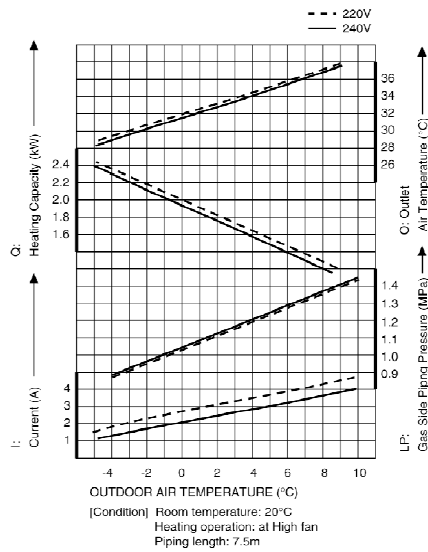


#### • Piping Length Characteristic (Heating)

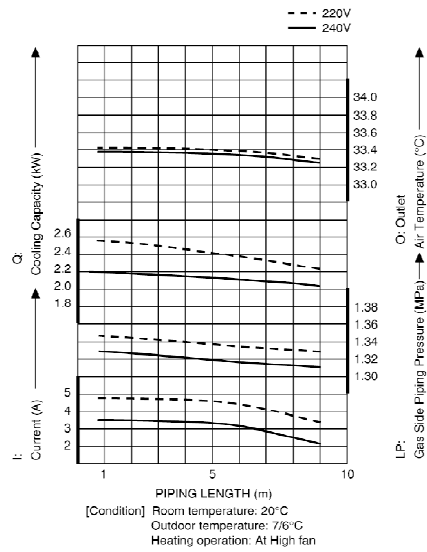


## ■ Operation characteristics

### CS-A95KR / CU-A95KR


#### • Cooling Characteristic

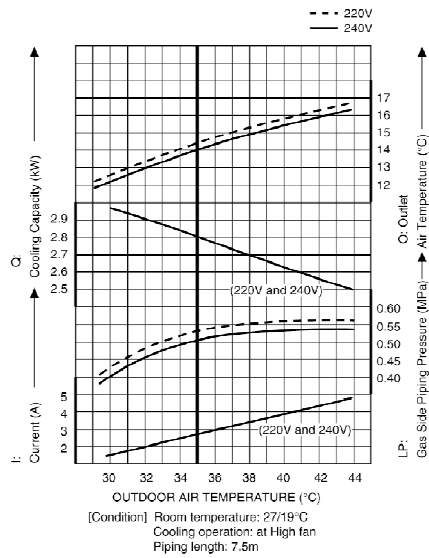


#### • Piping Length Characteristic (Cooling)

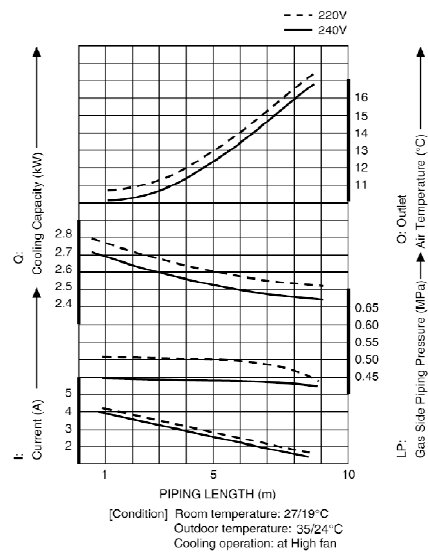

#### • Heating Characteristic

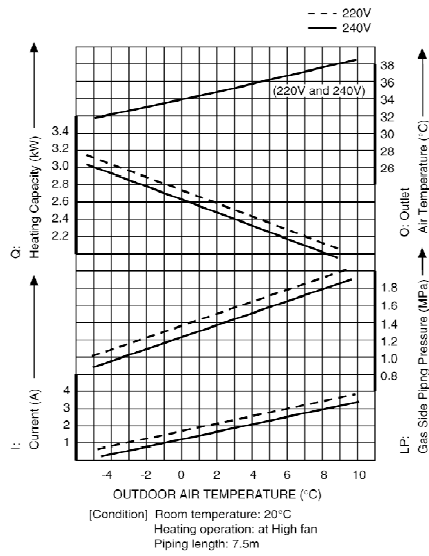


#### • Piping Length Characteristic (Heating)

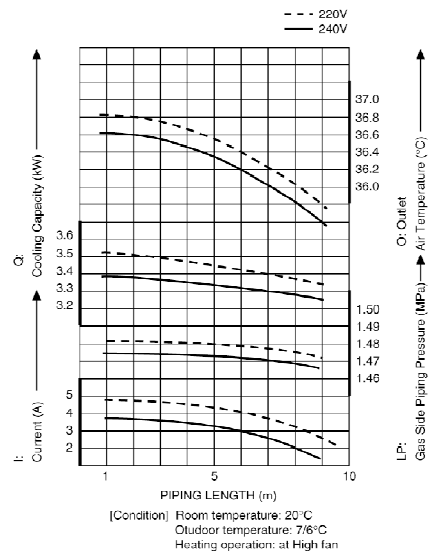


## ■ Operation characteristics

### CS-A125KR / CU-A125KR


#### • Cooling Characteristic

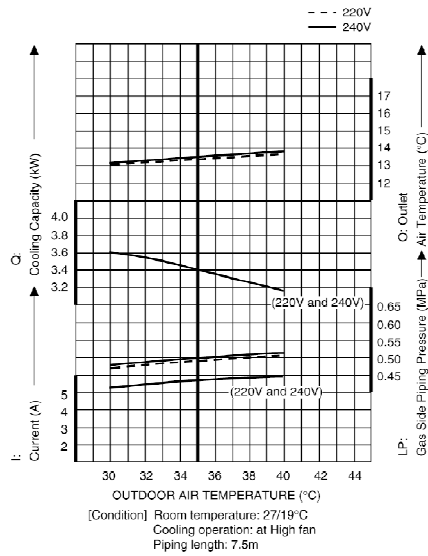


#### • Piping Length Characteristic (Cooling)

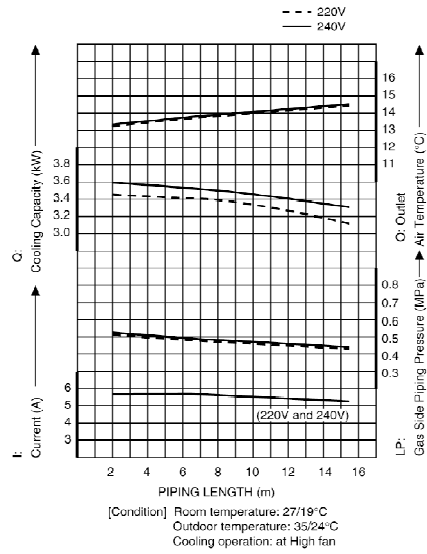

#### • Heating Characteristic

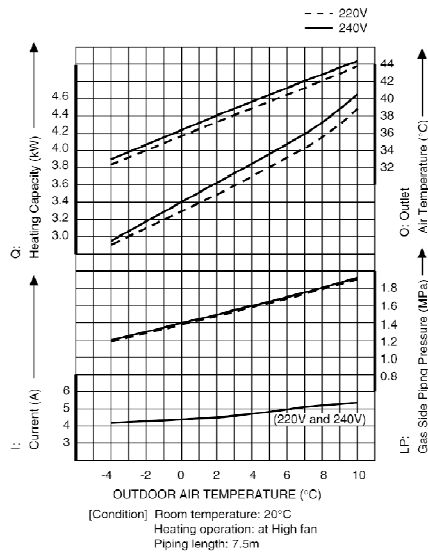


#### • Piping Length Characteristic (Heating)

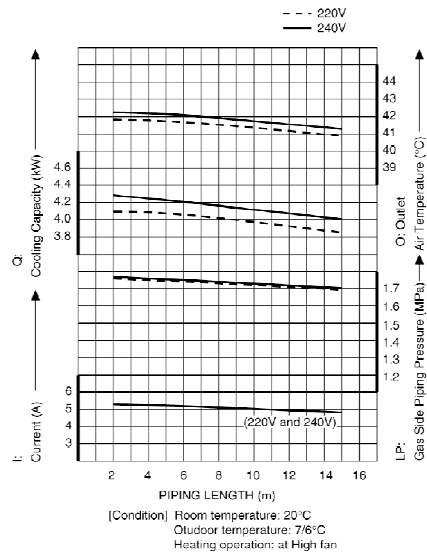

## 15. Exploded View

## CS-A75KR / CS-A95KR / CS-A125KR

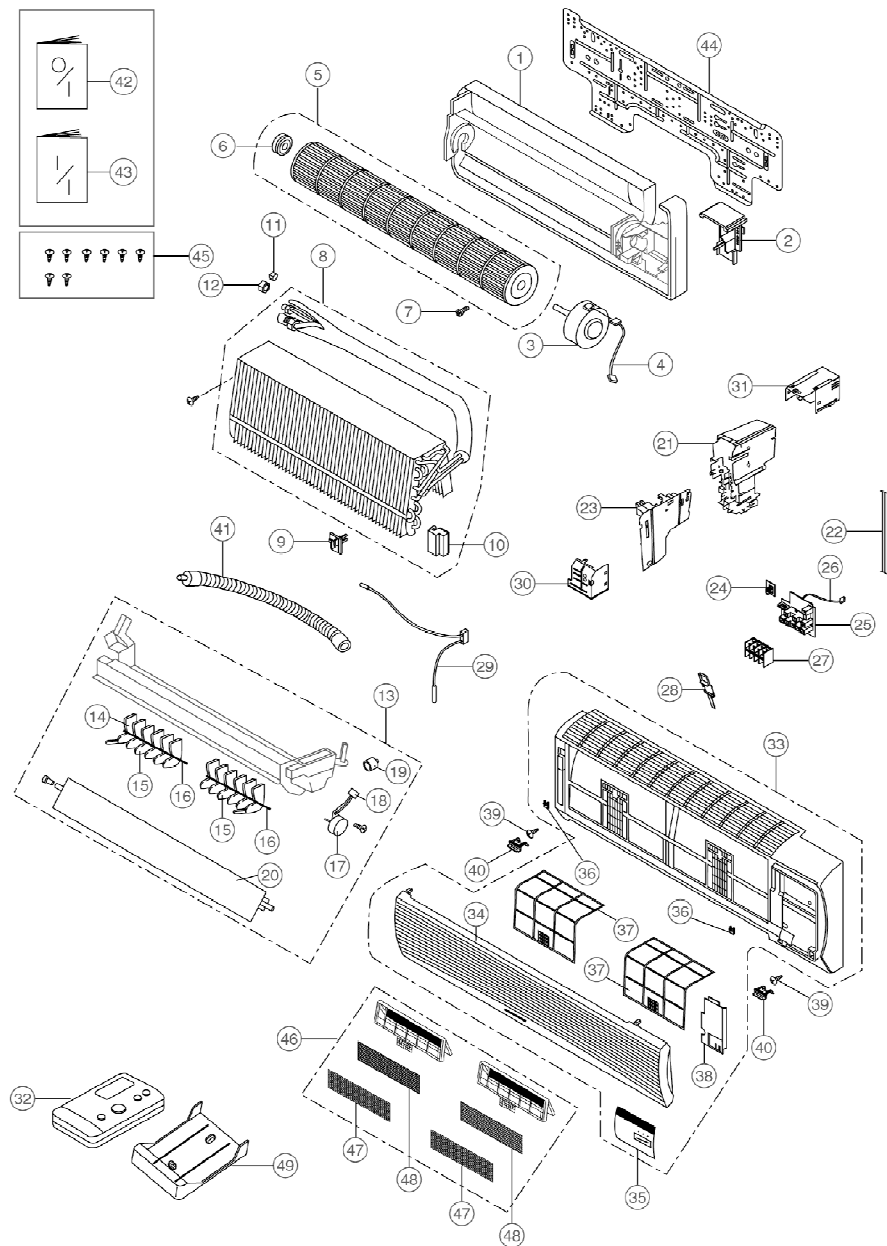

### Note:

The above exploded view is for the purpose of parts disassembly and replacement.  
The non-numbered parts are not kept as standard service parts.

## 16. Replacement Parts List

<Model: CS-A75KR / CS-A95KR / CS-A125KR>



| NO.       | DESCRIPTION & NAME               | Q'TY | CS-A75KR        | CS-A95KR   | CS-A125KR       | REMARKS |
|-----------|----------------------------------|------|-----------------|------------|-----------------|---------|
| <u>1</u>  | CHASSY COMPLETE                  | 1    | CWD50C338       | ←          | ←               |         |
| <u>2</u>  | PARTICULAR PIECE                 | 1    | CWD931019       | ←          | ←               |         |
| <u>3</u>  | FAN MOTOR                        | 1    | CWA921033       | CWA921032  | CWA921031       | 0       |
| <u>4</u>  | LEAD WIRE - FAN MOTOR            | 1    | CWA67C2097      | ←          | ←               |         |
| <u>5</u>  | CROSS FLOW FAN                   | 1    | CWH02C060       | ←          | ←               |         |
| <u>6</u>  | BEARING                          | 1    | CWH64K007       | ←          | ←               |         |
| <u>7</u>  | SCREW - CROSS FLOW FAN           | 1    | CWH4580304      | ←          | ←               |         |
| <u>8</u>  | EVAPORATOR & TUBE ASS'Y COMPLETE | 1    | CWB30C1059      | ←          | CWB30C1060      |         |
| <u>9</u>  | INTAKE AIR SENSOR HOLDER         | 1    | CWH32142        | ←          | ←               |         |
| <u>10</u> | ANTI VIBRATION BUSHING           | 1    | CWH50211        | ←          | ←               |         |
| <u>11</u> | FLARE NUT (1/4")                 | 1    | CWH6002140      | ←          | ←               |         |
| <u>12</u> | FLARE NUT (1/2") OR (3/8")       | 1    | CWT25005 (3/8") | ←          | CWT25007 (1/2") |         |
| <u>13</u> | DISCHARGE GRILLE COMPLETE        | 1    | CWE20C2062      | CWE20C2061 | CWE20C2085      |         |
| <u>14</u> | VERTICAL VANE WITH TAB           | 2    | CWE24458        | ←          | ←               |         |
| <u>15</u> | VERTICAL VANE                    | 10   | CWE24457        | ←          | ←               |         |
| <u>16</u> | CONNECTING BAR                   | 2    | CWE26194        | ←          | ←               |         |
| <u>17</u> | AIR SWING MOTOR                  | 1    | CWA98259        | CWA98C033  | ←               | 0       |
| <u>18</u> | LEAD WIRE - AIR SWING MOTOR      | 1    | CWA67C2106      | ←          | ←               |         |
| <u>19</u> | CAP FOR DRAIN TRAY               | 1    | CWH52C1001      | ←          | ←               |         |
| <u>20</u> | HORIZONTAL VANE                  | 1    | CWE241027       | ←          | ←               |         |
| <u>21</u> | CONTROL BOARD                    | 1    | CWH10965A       | ←          | ←               |         |
| <u>22</u> | POWER SUPPLY CORD                | 1    | CWA20C2102      | ←          | ←               |         |
| <u>23</u> | ELECTRONIC CONTROLLER            | 1    | CWA742320       | CWA742327  | CWA742313       | 0       |
| <u>24</u> | RECEIVER                         | 1    | CWA74919        | ←          | ←               | 0       |
| <u>25</u> | INDICATOR COMPLETE               | 1    | CWE39C1024      | ←          | ←               | 0       |
| <u>26</u> | LEAD WIRE - INDICATOR            | 1    | CWA67C2105      | ←          | ←               |         |
| <u>27</u> | TERMINAL BOARD                   | 1    | CWA28C2026      | ←          | CWA28C2025      | 0       |
| <u>28</u> | INDICATOR HOLDER                 | 1    | CWD931018A      | ←          | ←               |         |
| <u>29</u> | SENSOR COMPLETE                  | 1    | CWA50C608       | ←          | ←               | 0       |
| <u>30</u> | CONTROL BOARD FRONT COVER        | 1    | CWH13456        | ←          | ←               |         |
| <u>31</u> | CONTROL BOARD TOP COVER          | 1    | CWH13457        | ←          | ←               |         |
| <u>32</u> | REMOTE CONTROL COMPLETE          | 1    | CWA75C2081      | ←          | ←               | 0       |
| <u>33</u> | FRONT GRILLE COMPLETE            | 1    | CWE11C2106      | ←          | ←               |         |
| <u>34</u> | INTAKE GRILLE COMPLETE           | 1    | CWE22C1006      | ←          | ←               |         |
| <u>35</u> | DECORATION BASE COMPLETE         | 1    | CWE35C1007      | ←          | ←               |         |
| <u>36</u> | TAB                              | 2    | CWD931020       | ←          | ←               |         |
| <u>37</u> | AIR FILTER                       | 2    | CWD00240        | ←          | ←               |         |
| <u>38</u> | GRILLE DOOR                      | 1    | CWE141013       | ←          | ←               |         |
| <u>39</u> | SCREW FOR FRONT GRILLE           | 2    | XTN4+16C        | ←          | ←               |         |
| <u>40</u> | CAP FOR FRONT GRILLE             | 2    | CWH52267        | ←          | ←               |         |
| <u>41</u> | DRAIN HOSE                       | 1    | CWH85285        | ←          | ←               |         |
| <u>42</u> | OPERARTING INSTRUCTIONS          | 1    | CWF563254       | ←          | ←               |         |
| <u>43</u> | INSTALLATION INSTRUCTIONS        | 1    | CWF612166       | ←          | ←               |         |
| <u>44</u> | INSTALLATION PLATE               | 1    | CWH36157        | ←          | ←               |         |


| NO.                | DESCRIPTION & NAME                 | Q'TY | CS-A75KR   | CS-A95KR | CS-A125KR | REMARKS |
|--------------------|------------------------------------|------|------------|----------|-----------|---------|
| <a href="#">45</a> | BAG COMPLETE - INSTALLATION SCREW  | 1    | CWH82C067  | ←        | ←         |         |
| <a href="#">46</a> | AIR PURIFYING FILTER COMPLETE      | 1    | CWD00C1028 | ←        | ←         |         |
| <a href="#">47</a> | AIR PURIFYING FILTER (CATECHIN)    | 2    | CWD001014  | ←        | ←         | 0       |
| <a href="#">48</a> | AIR PURIFYING FILTER (DEODORIZING) | 2    | CWD001033  | ←        | ←         | 0       |
| <a href="#">49</a> | REMOTE CONTROL HOLDER              | 1    | CWH36161   | ←        | ←         |         |

(Note)

- All parts are supplied from MACC, Malaysia (Vendor Code: 086).
- “O” marked parts are recommended to be kept in stock.

## 17. Exploded View

## CU-A75KR / CU-A95KR

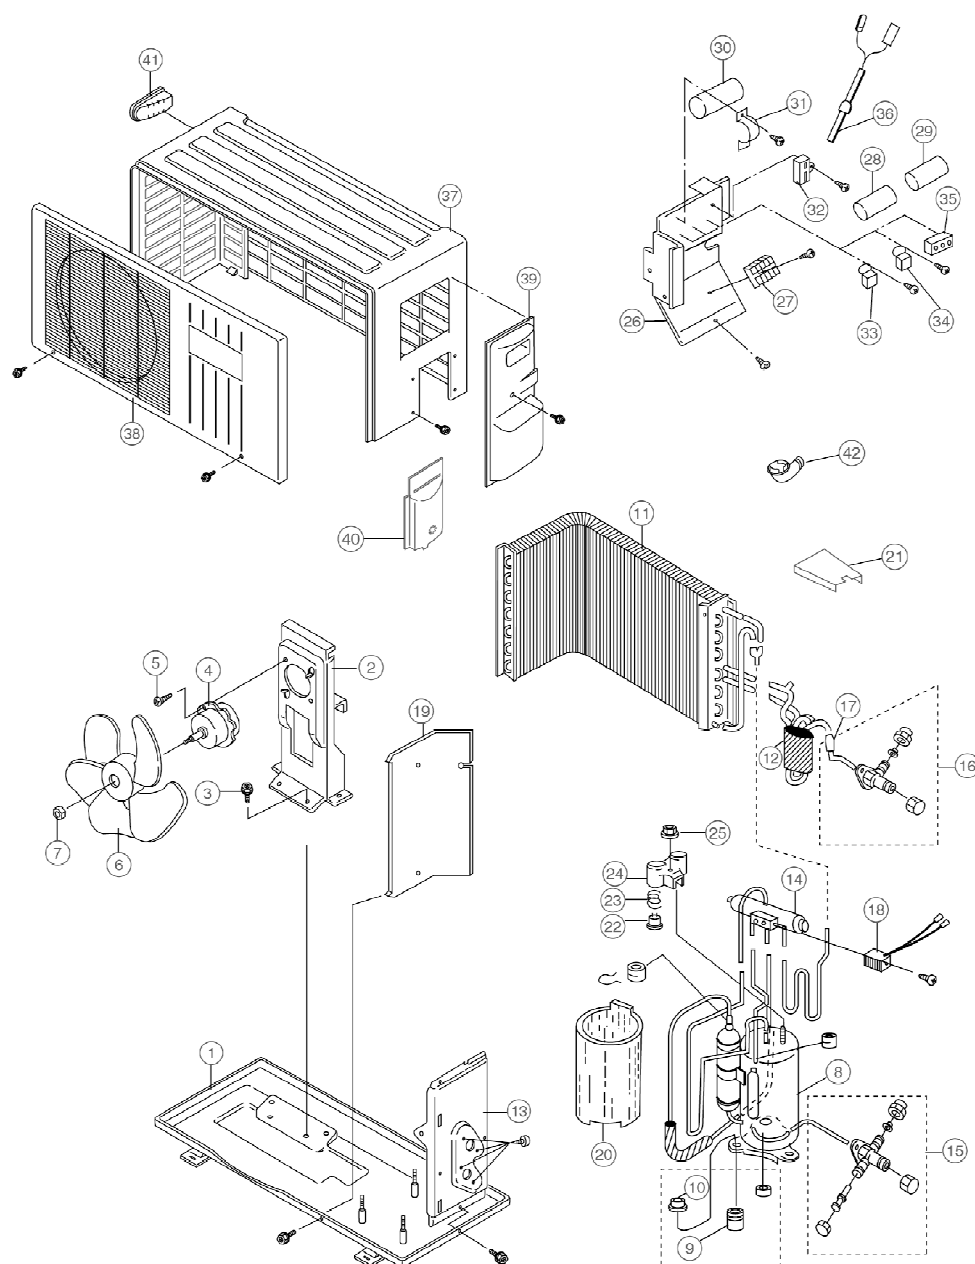

### Note:

The above exploded view is for the purpose of parts disassembly and replacement.  
The non-numbered parts are not kept as standard service parts.

## 18. Replacement Parts List

<Model: CU-A75KR / CU-A95KR>


| NO.       | DESCRIPTION & NAME                      | Q'TY | CU-A75KR                        | CU-A95KR                       | REMARKS |
|-----------|-----------------------------------------|------|---------------------------------|--------------------------------|---------|
| <u>1</u>  | CHASSY ASS'Y                            | 1    | CWD50K2037A                     | CWD50K2038A                    |         |
| <u>2</u>  | FAN MOTOR BRACKET                       | 1    | CWD54113                        | ←                              |         |
| <u>3</u>  | SCREW - FAN MOTOR BRACKET               | 4    | CWH4580399                      | ←                              |         |
| <u>4</u>  | FAN MOTOR                               | 1    | CWA95245                        | ←                              | 0       |
| <u>5</u>  | SCREW - FAN MOTOR MOUNT                 | 3    | CWH55027                        | ←                              |         |
| <u>6</u>  | PROPELLER FAN                           | 1    | CWH00K052                       | ←                              |         |
| <u>7</u>  | NUT - PROPELLER FAN                     | 1    | CWH56032                        | ←                              |         |
| <u>8</u>  | COMPRESSOR                              | 1    | 2RS122D5AB02                    | 2PS164D3AD02                   | 0       |
| <u>9</u>  | ANTI - VIBRATION BUSHING                | 3    | CWH50077                        | ←                              |         |
| <u>10</u> | NUT - COMPRESSOR MOUNT                  | 3    | CWH56000                        | ←                              |         |
| <u>11</u> | CONDENSER                               | 1    | CWB32C043                       | ←                              |         |
| <u>12</u> | TUBE ASS'Y (CHECK VALVE / CAPILLARY)    | 1    | CWT01C260                       | CWT01C257                      |         |
| <u>13</u> | HOLDER COUPLING ASS'Y                   | 1    | CWH351011                       | ←                              |         |
| <u>14</u> | 4-WAY VALVE                             | 1    | CWB00002                        | ←                              | 0       |
| <u>15</u> | 3-WAY VALVE                             | 1    | CWB01479                        | ←                              | 0       |
| <u>16</u> | 2-WAY VALVE                             | 1    | CWB02307                        | ←                              | 0       |
| <u>17</u> | STRAINER                                | 1    | CWB11025                        | ←                              |         |
| <u>18</u> | V - COIL COMPLETE                       | 1    | CWA43C2002                      | ←                              | 0       |
| <u>19</u> | SOUND PROOF BOARD                       | 1    | CWH15C081                       | ←                              |         |
| <u>20</u> | SOUND PROOF MATERIAL / (FOR COMPRESSOR) | 1    | CWG302073                       | CWG302031                      |         |
| <u>21</u> | L - SHAPED PLATE                        | 1    | CWD60247                        | ←                              |         |
| <u>22</u> | OVERLOAD PROTECTOR                      | 1    | CWA12345                        | CWA12346                       | 0       |
| <u>23</u> | HOLDER - O.L.P.                         | 1    | CWH7041200                      | ←                              |         |
| <u>24</u> | TERMINAL COVER                          | 1    | CWH171011                       | ←                              |         |
| <u>25</u> | NUT - TERMINAL COVER                    | 1    | CWH7080300                      | ←                              |         |
| <u>26</u> | CONTROL BOARD                           | 1    | CWH10881                        | ←                              |         |
| <u>27</u> | TERMINAL BOARD ASS'Y                    | 1    | CWA28K216                       | ←                              |         |
| <u>28</u> | ELECTROLYTIC CAPACITOR                  | 1    | CWA32C045                       | ←                              | 0       |
| <u>29</u> | ELECTROLYTIC CAPACITOR                  | 1    | CWA32C067                       | ←                              | 0       |
| <u>30</u> | CAPACITOR - COMPRESSOR                  | 1    | CWA31653<br>(15 $\mu$ F, 440V)  | CWA31646<br>(25 $\mu$ F, 370V) | 0       |
| <u>31</u> | HOLDER CAPACITOR                        | 1    | CWH30057                        | ←                              |         |
| <u>32</u> | CAPACITOR - FAN MOTOR                   | 1    | CWA31602<br>(1.2 $\mu$ F, 400V) | ←                              | 0       |
| <u>33</u> | ELECTROMAGNETIC SWITCH                  | 1    | K6C2C7A00001                    | ←                              | 0       |
| <u>34</u> | ELECTROMAGNETIC SWITCH                  | 1    | CWA00059                        | ←                              | 0       |
| <u>35</u> | TERMINAL BOARD ASS'Y                    | 1    | CWA4711012                      | ←                              |         |
| <u>36</u> | TEMPERATURE RELAY                       | 1    | CWA14C1001                      | ←                              | 0       |
| <u>37</u> | CABINET ASS'Y                           | 1    | CWE00K1019A                     | ←                              |         |
| <u>38</u> | CABINET FRONT PLATE                     | 1    | CWE06C117A                      | ←                              |         |
| <u>39</u> | CONTROL BOARD COVER                     | 1    | CWH131062                       | ←                              |         |
| <u>40</u> | PLATE FOR CONTROL BOARD COVER           | 1    | CWD911083                       | ←                              |         |
| <u>41</u> | HANDLE                                  | 1    | CWE16037C                       | ←                              |         |
| <u>42</u> | L - TUBE                                | 1    | CWH5850080                      | ←                              |         |

(Note)

- All parts are supplied from MACC, Malaysia (Vendor Code: 086).
- “O” marked parts are recommended to be kept in stock.

## 19. Exploded View

CU-A125KR

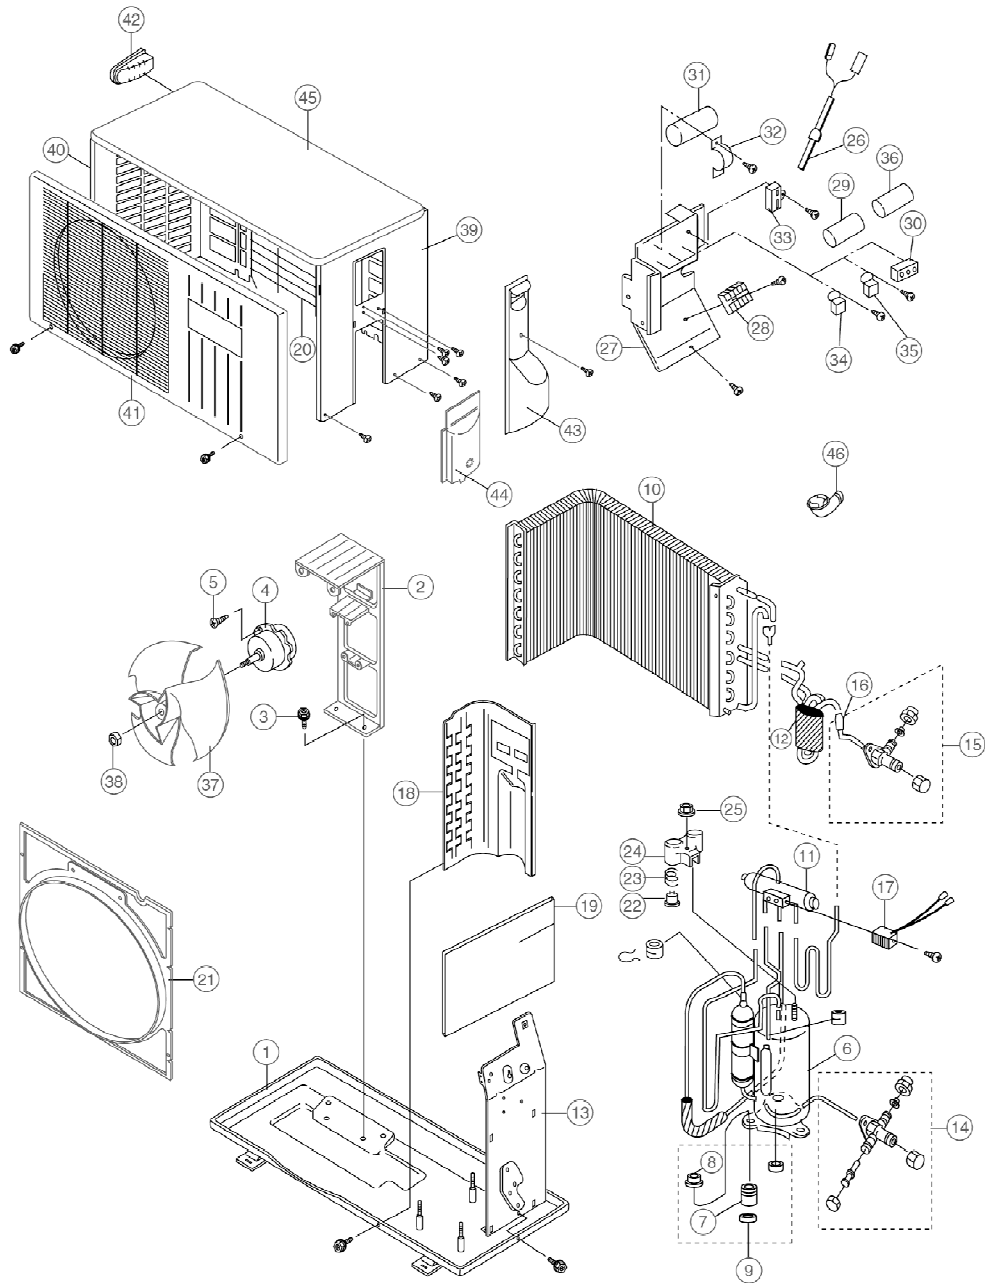

### Note:

The above exploded view is for the purpose of parts disassembly and replacement.  
The non-numbered parts are not kept as standard service parts.

## 20. Replacement Parts List

<Model: CU-A125KR>

| NO.                | DESCRIPTION & NAME                   | Q'TY | CU-A125KR                       | REMARKS |
|--------------------|--------------------------------------|------|---------------------------------|---------|
| <a href="#">1</a>  | CHASSY ASS'Y                         | 1    | CWD50K659A                      |         |
| <a href="#">2</a>  | FAN MOTOR BRACKET                    | 1    | CWD54254                        |         |
| <a href="#">3</a>  | SCREW - FAN MOTOR BRACKET            | 2    | CWH55189                        |         |
| <a href="#">4</a>  | FAN MOTOR                            | 1    | CWA95381                        | 0       |
| <a href="#">5</a>  | SCREW - FAN MOTOR MOUNT              | 4    | CWH55406                        |         |
| <a href="#">6</a>  | COMPRESSOR                           | 1    | 2KS224D5CA02                    | 0       |
| <a href="#">7</a>  | ANTI - VIBRATION BUSHING             | 3    | CWH50055                        |         |
| <a href="#">8</a>  | NUT - COMPRESSOR MOUNT               | 3    | CWH4582065                      |         |
| <a href="#">9</a>  | PACKING - COMPRESSOR MOUNTE          | 1    | CWB81047                        |         |
| <a href="#">10</a> | CONDENSER                            | 1    | CWB32C336                       |         |
| <a href="#">11</a> | 4-WAY VALVE                          | 1    | CWB00003                        | 0       |
| <a href="#">12</a> | TUBE ASS'Y (CHECK VALVE / CAPILLARY) | 1    | CWT01C652                       |         |
| <a href="#">13</a> | HOLDER COUPLING ASS'Y                | 1    | CWH35177                        |         |
| <a href="#">14</a> | 3-WAY VALVE                          | 1    | CWB01480                        | 0       |
| <a href="#">15</a> | 2-WAY VALVE                          | 1    | CWB02308                        | 0       |
| <a href="#">16</a> | STRAINER                             | 1    | CWB11025                        |         |
| <a href="#">17</a> | V - COIL COMPLETE                    | 1    | CWA43C2008                      | 0       |
| <a href="#">18</a> | SOUND PROOF BOARD                    | 1    | CWH15288                        |         |
| <a href="#">19</a> | SOUND PROOF MATERIAL                 | 1    | CWG302075                       |         |
| <a href="#">20</a> | WIRE NET                             | 1    | CWD04197A                       |         |
| <a href="#">21</a> | AIR GUIDER PROPELLER FAN             | 1    | CWD31138                        |         |
| <a href="#">22</a> | OVERLOAD PROPECTOR                   | 1    | CWA12360                        | 0       |
| <a href="#">23</a> | HOLDER - O.L.P.                      | 1    | CWH7041200                      |         |
| <a href="#">24</a> | TERMINAL COVER                       | 1    | CWH171011                       |         |
| <a href="#">25</a> | NUT - TERMINAL COVER                 | 1    | CWH7080300                      |         |
| <a href="#">26</a> | TEMPERATURE RELAY                    | 1    | CWA14C1001                      | 0       |
| <a href="#">27</a> | CONTROL BOARD                        | 1    | CWH10972                        |         |
| <a href="#">28</a> | TERMINAL BOARD ASS'Y                 | 1    | CWA28K216                       |         |
| <a href="#">29</a> | ELECTROLYTIC CAPACITOR               | 1    | CWA32C045                       | 0       |
| <a href="#">30</a> | TERMINAL BOARD ASS'Y                 | 1    | CWA4711012                      |         |
| <a href="#">31</a> | CAPACITOR - COMPRESSOR               | 1    | CWA31647<br>(30 $\mu$ F, 370V)  | 0       |
| <a href="#">32</a> | HOLDER CAPACITOR                     | 1    | CWH30057                        |         |
| <a href="#">33</a> | CAPACITOR - FAN MOTOR                | 1    | CWA31604<br>(1.5 $\mu$ F, 400V) | 0       |
| <a href="#">34</a> | ELECTROMAGNETIC SWITCH               | 1    | K6C2C7A00001                    | 0       |
| <a href="#">35</a> | ELECTROMAGNETIC SWITCH               | 1    | CWA00059                        | 0       |
| <a href="#">36</a> | ELECTROLYTIC CAPACITOR               | 1    | CWA32C067                       | 0       |
| <a href="#">37</a> | PROPELLER FAN ASS'Y                  | 1    | CWH00K087                       |         |
| <a href="#">38</a> | NUT - PROPELLER FAN                  | 1    | CWH56053                        |         |
| <a href="#">39</a> | CABINET SIDE PLATE (RIGHT)           | 1    | CWE04217A                       |         |
| <a href="#">40</a> | CABINET SIDE PLATE ( LEFT)           | 1    | CWE04220A                       |         |
| <a href="#">41</a> | CABINET FRONT PLATE                  | 1    | CWE06K104A                      |         |
| <a href="#">42</a> | HANDLE                               | 1    | CWE16037C                       |         |
| <a href="#">43</a> | CONTROL BOARD COVER                  | 1    | CWH13461                        |         |
| <a href="#">44</a> | PLATE FOR CONTROL BOARD COVER        | 1    | CWD91258                        |         |
| <a href="#">45</a> | CABINET TOP PLATE                    | 1    | CWE03K035A                      |         |
| <a href="#">46</a> | L - TUBE                             | 1    | CWH5850080                      |         |

(Note)

- All parts are supplied from MACC, Malaysia (Vendor Code: 086).
- “O” marked parts are recommended to be kept in stock.

## 21. Electronic Parts List

<Electronic Controller Part No.: CWA742320, CWA742327, CWA742313>

| SYMBOL                        | DESCRIPTION & NAME     | PART NO.                        |
|-------------------------------|------------------------|---------------------------------|
| BZ1                           | SOUND GENERATOR        | A48040                          |
| CT1                           | TRANSFORMER            | A40322                          |
| D1, D4                        | DIODE                  | A541SR154-4                     |
| D2                            | DIODE                  | A54RB501V-40                    |
| D3                            | DIODE                  | B0ACCK000005                    |
| DB1                           | DIODE                  | A54CS1VB20E                     |
| FUSE                          | FUSE                   | XBA2C20TR0                      |
| FUSE HOLDER                   | FUSE HOLDER            | K3GE1BA00015                    |
| IC1                           | INTEGRATED CIRCUIT     | A52D0022GB14                    |
| IC2                           | INTEGRATED CIRCUIT     | C3EBDG000021                    |
| IC3                           | INTEGRATED CIRCUIT     | A52A2003GR2                     |
| IC4                           | INTEGRATED CIRCUIT     | A52C040                         |
| IC5                           | INTEGRATED CIRCUIT     | A52C114                         |
| Q1                            | TRANSISTOR             | B1GBCFJJ0002                    |
| Q2, Q3                        | TRANSISTOR             | A55C2412KTX                     |
| Q4                            | TRANSISTOR             | A55D1484K                       |
| Q5 - Q8                       | TRANSISTOR             | B1GBCFGH0001                    |
| RY-HOT                        | ELECTRO MAGNETIC RELAY | A00161                          |
| RY-PWR                        | ELECTRO MAGNETIC RELAY | A001001                         |
| RY-SHi, RY-Hi, RY-M           | ELECTRO MAGNETIC RELAY | A00160                          |
| SSR1, SSR2                    | TYRISTOR               | A56G3MC202PL                    |
| SW3                           | PUSH SWITCH            | EVQQKH08Q                       |
| T1                            | TRANSFORMER            | A401022                         |
| X1                            | RESONATOR              | A45CST4.09MG                    |
| ZD1                           | DIODE                  | B0BC7R400003                    |
| ZNR1, ZNR2, ZNR3              | DIODE                  | ERZVEAV511                      |
| C-FM                          | SH CAPACITOR           | A31499 (A95K), A31698 (A7A125K) |
| AC (WHT), HOT (RED), FM (BLU) | TERMINAL BOARD         | A28069T                         |
| CR1, CR2, CR3, CR4, CR5       | SURGE ABSORBER         | J0HBJY000003                    |

Note

- All parts are supplied from MACC, Malaysia (Vendor Code: 086)

## 22. Electronic Circuit Diagram

Fig. 1

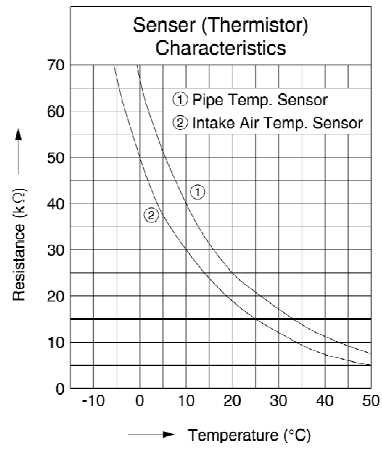


Fig. 2


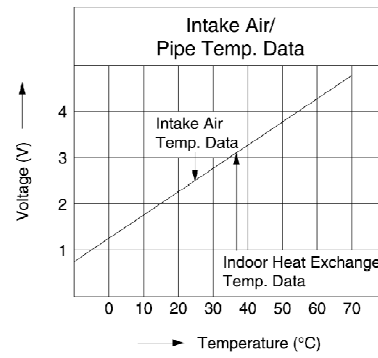


Fig. 3 OLP Characteristics (Compressor)



## How to use electronic circuit diagram

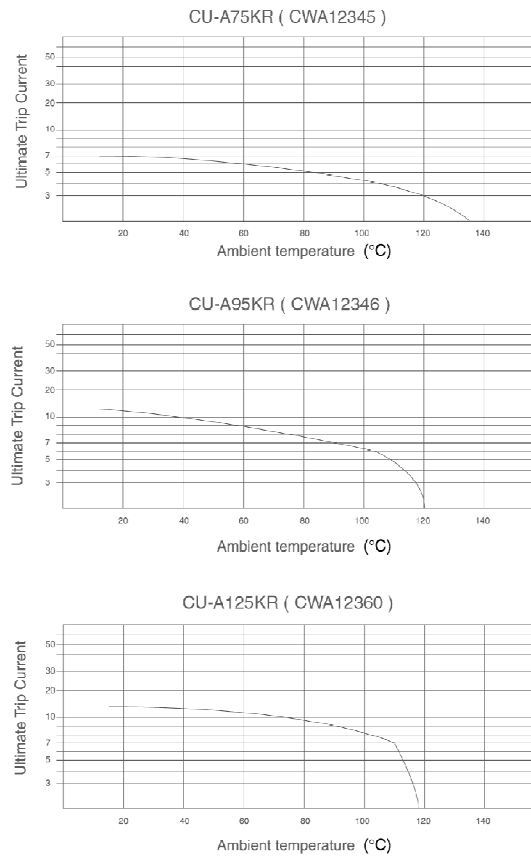

Before using the circuit diagram, read the following carefully.

\* Voltage measurement

Voltage has been measured with a digital tester when the indoor fan is set at high fan speed under the following conditions without setting the timer.

Use them for servicing.

Voltage indication is in Red at all operations.

|         | Intake air temperature | Temperature setting | Discharge air temperature | Pipe temperature |
|---------|------------------------|---------------------|---------------------------|------------------|
| Cooling | 27°C                   | 16°C                | 17°C                      | 15°C             |
| Heating | 20°C                   | 30°C                | 40°C                      | 50°C             |

\* Indications for resistance

a. K....kΩ                      M....MΩ  
W...watt                      Not indicated....1/4W

b. Type

Not indicated.....carbon resistor

Tolerance±5%



.....metal oxide resistor

Tolerance±1%

\* Indications for capacitor

a. Unit    μ....μF    P....pF

b. Type    Not indicated....ceramic capacitor

(S).....S series aluminium

electrolytic capacitor

(Z).....Z series aluminium

electrolytic capacitor

(SU).....SU series aluminium

electrolytic capacitor

(P).....P series polyester system

(SXE).....SXE series aluminium

electrolytic capacitor

(SRA).....SRA series aluminium

electrolytic capacitor

(KME).....KME series aluminium

electrolytic capacitor

\* Diode without indication.....MA165


※ Circuit Diagram is subject to change without notice for further development.

## TIMER TABLE


| Name                                   |          | Time           | Test mode<br>(When test point<br>Short-circuited) | Remarks                         |
|----------------------------------------|----------|----------------|---------------------------------------------------|---------------------------------|
| Sleep Mode Waiting                     |          | 1 hr.          | 6 sec.                                            |                                 |
| Sleep Mode Operation                   |          | 8 hrs.         | 48 sec.                                           |                                 |
| Real Timer                             |          | 1 hr.          | 1 min.                                            |                                 |
|                                        |          | 10 min.        | 10 sec.                                           |                                 |
|                                        |          | 1 min.         | 1 sec.                                            |                                 |
| Time Delay Safety Control              |          | 2 min. 58 sec. | 0 sec.                                            |                                 |
| Forced Operation                       |          | 60 sec.        | 0 sec.                                            |                                 |
| Time Save Control (Cooling)            |          | 7 min.         | 42 sec.                                           |                                 |
| Anti-Freezing                          |          | 4 min.         | 0 sec.                                            |                                 |
| Soft Dry                               | OFF      | 6 min.         | 36 sec.                                           | SOFT DRY : 10 min.<br>operation |
|                                        | ON       | 10 min.        | 60 sec.                                           |                                 |
| Deodorizing<br>Control                 | Cooling  | 40 sec.        | 4 sec.                                            |                                 |
|                                        |          | 70 sec.        | 7 sec.                                            |                                 |
|                                        |          | 20 sec.        | 2 sec.                                            |                                 |
|                                        | Soft Dry | 180 sec.       | 18 sec.                                           |                                 |
|                                        |          | 40 sec.        | 4 sec.                                            |                                 |
|                                        |          | 360 sec.       | 36 sec.                                           |                                 |
| Comp. Reverse Rotation<br>Detection    |          | 5 min.         | 30 sec.                                           | Comp. ON 5 min. and above       |
|                                        |          | 2 min          | 0 sec.                                            |                                 |
| Comp./ Fan Motor Delay Timer           |          | 1.6 sec.       | 0 sec.                                            |                                 |
| Intake Air Anti-Freezing<br>Prevention |          | 16 min.        | 96 sec.                                           |                                 |

|                             |              |          |                              |
|-----------------------------|--------------|----------|------------------------------|
| POWERFUL MODE               | 15 min.      | 4.5 sec. |                              |
| Random Auto Restart Control | 0 ~ 150 sec. | 0 sec.   |                              |
| TRS Recovery Detection      | 12 min.      | 72 sec.  |                              |
|                             | 6 min.       | 36 sec.  |                              |
|                             | 3 min.       | 18 sec.  |                              |
|                             | 1 min.       | 6 sec.   |                              |
| Time Save Control (Heating) | 30 min.      | 3 sec.   |                              |
| 4 Way Valve Control (Delay) | 5 min.       | 30 sec.  |                              |
| Deice Operation Occurs      | 60 min.      | 6 sec.   | 60 min. after previous deice |
| Deice Ends                  | 12 min.      | 72 sec.  |                              |

## 22.1. REMOTE CONTROL

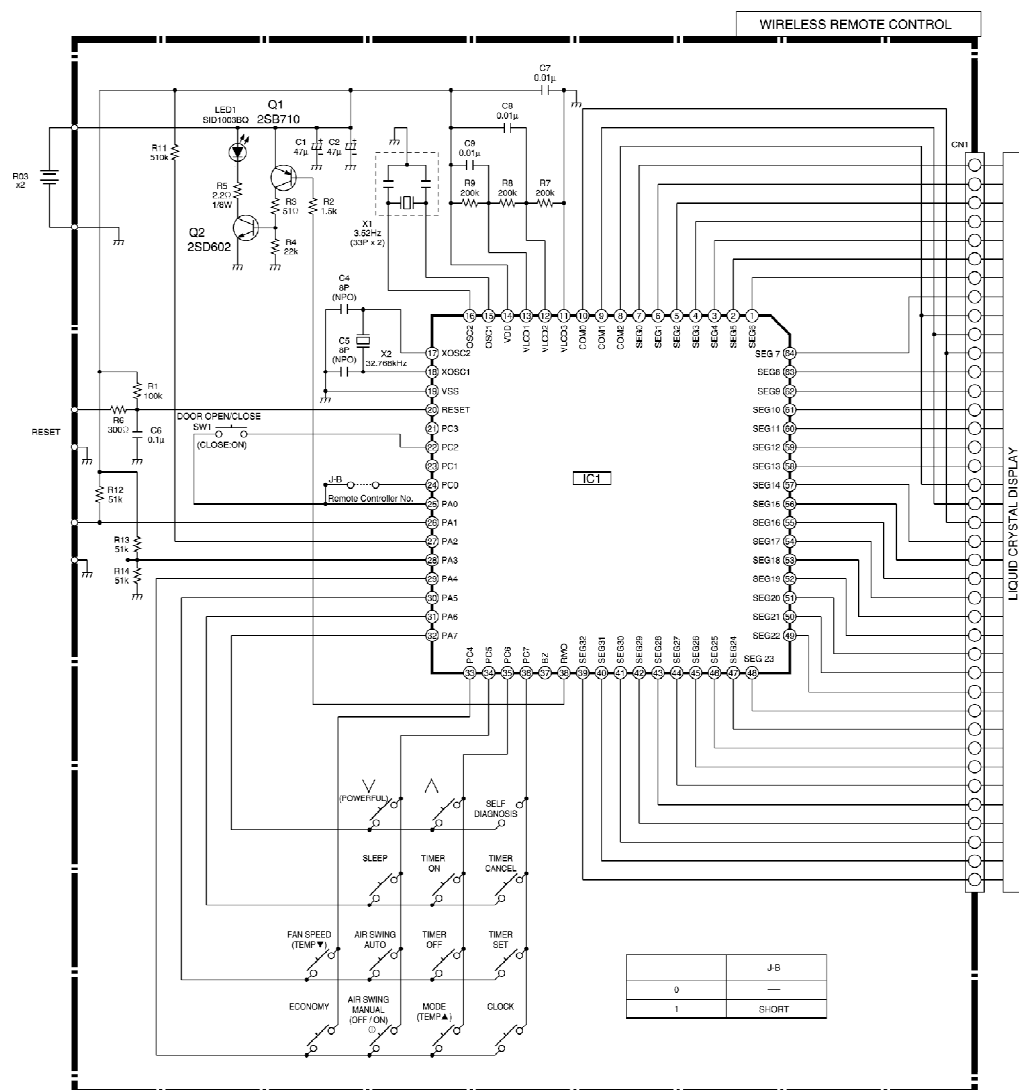


## 22.2. PRINT PATTERN / INDOOR UNIT PRINTED CIRCUIT BOARD / / / TOP VIEW

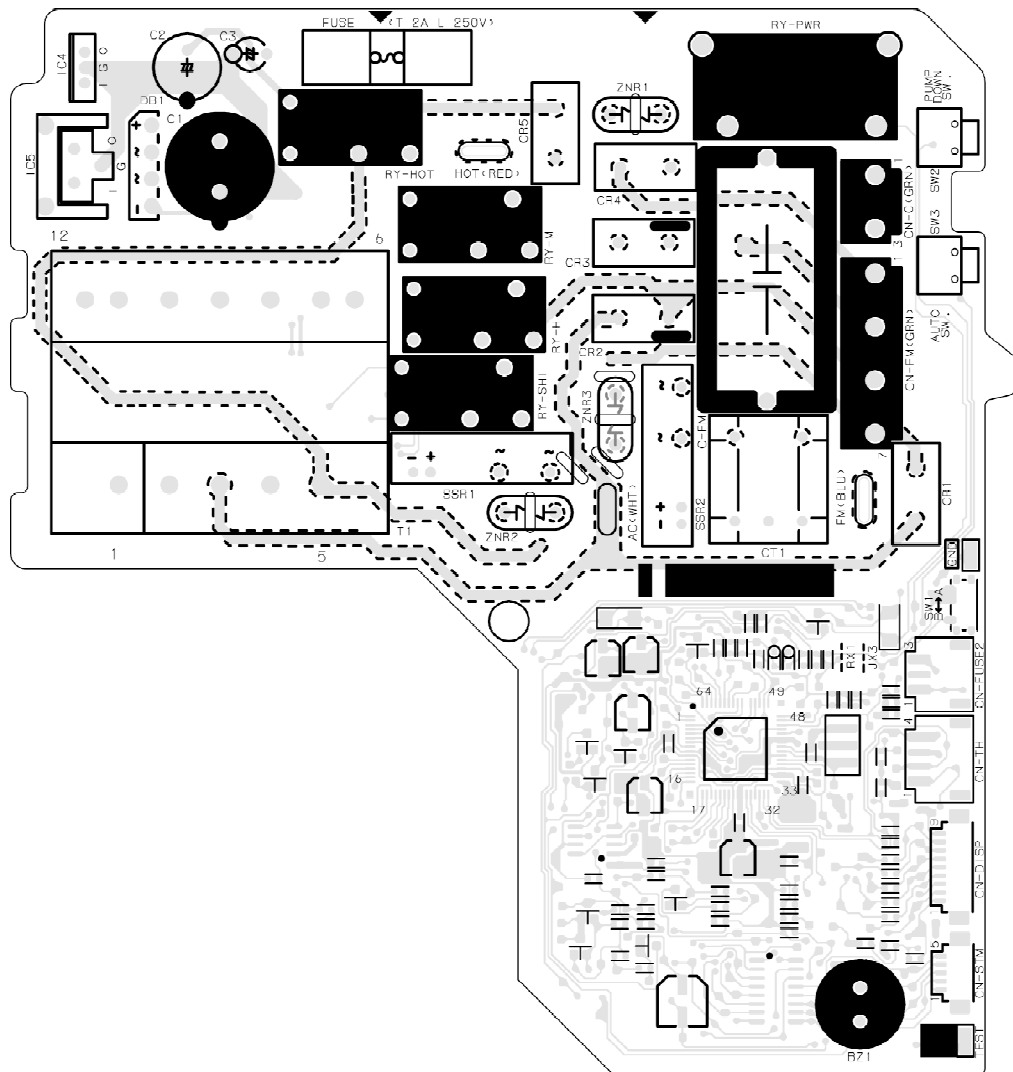

**22.3. PRINT PATTERN / INDOOR UNIT PRINTED CIRCUIT BOARD / /  
/ BOTTOM VIEW**



# Remote Control

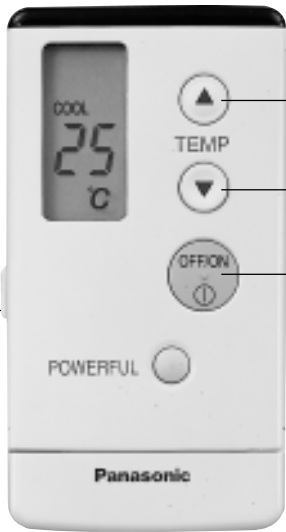

Self illuminating  
button

OFF / ON ① **Operation OFF / ON**

MODE **Operation Mode Selection**

- AUTO Automatic Operation Mode
- HEAT Heating Operation Mode
- COOL Cooling Operation Mode
- DRY Soft Dry Operation Mode

FAN SPEED **Indoor Fan Speed Selection**

- Low Speed
- Medium Speed
- High Speed
- AUTOFAN Automatic Fan Speed

AIR SWING **Airflow Direction Control**

- AUTO Automatic Airflow Direction Control
- MANUAL Airflow Direction Manual Control

POWERFUL **Powerful Mode Operation OFF/ON**

ECONOMY **Economy Mode Operation OFF/ON**

TEMP. **Room Temperature Setting**

- Temperature Setting (16°C to 30°C)
- Automatic Operation
  - ▲ HI Operation with 2°C higher than standard temperature.
  - AUTO Operation with standard temperature.
  - AUTO Operation with 2°C lower than standard temperature.
  - ▼ Lo

ON-TIMER  
OFF-TIMER **Timer Operation Selection**

- 24-hour, OFF / ON Real Timer Setting.

TIMER **Time / Timer Setting**

- Hours and minutes setting.

SET  
CANCEL **Timer Operation Set / Cancel**

- ON Timer and OFF Timer setting and cancellation.

CLOCK **Clock Setting**

- Current time setting.

SLEEP **Sleep Mode Operation OFF / ON**

## Indoor Unit



AUTO  
OFF / ON

### Automatic Operation Button

- Press for < 5s to operate Automatic operation mode.  
(Used when the remote control cannot be used.)
- Press continuously for 5s or < 10s to operate Test Run/Pump down. "Beep" sound will be heard at the 5th second.  
(Used when test running or servicing.)
- Press continuously for 10s and above to omit or resume the remote control signal receiving sound. "Beep, beep" sound will be heard at the 10th second.

### Operation Indication Lamps (LED)

- POWER (Green) ..... Lights up in operation, blinks in Automatic Operation Mode judging.
- SLEEP (Orange) ..... Lights up in Sleep Mode Operation.
- TIMER (Orange) ..... Lights up in Timer Setting.
- POWERFUL (Orange) .. Lights up in Powerful Mode Operation.
- ECONOMY (Green) ..... Lights up in Economy Mode Operation.

### Operation Mode

- Heating, Cooling, Soft Dry and Automatic Mode.

### Powerful Operation

- Reaches the desired room temperature quickly.

### Economy Operation

- To reduce electrical power consumption.

### Random Auto Restart Control

- Operation is restarted randomly after power failure at previous setting mode.

### Anti-Freezing Control

- Anti-Freezing control for indoor heat exchanger. (Cooling and Soft Dry)

### Sleep Mode Auto Control

- Indoor Fan operates at Low speed.
- Operation stops after 8 hours.

### Indoor Fan Speed Control

- High, Medium and Low.
- Automatic Fan Speed Mode
  - Heating : Fan speed varies from ME → Lo in accordance with indoor heat exchanger.
  - Cooling : Fan rotates at Hi and Me speed. Deodorizing control is available.
  - Soft Dry: Fan rotates at Lo speed. Deodorizing control is available.

### Airflow Direction Control

- Automatic air swing and manual adjusted by remote control for vertical airflow.
- Manually adjusted by hand for horizontal airflow.

### Starting Current Control

### Time Delay Safety Control

- Restarting is inhibited for approx. 3 minutes.

### 7 Minutes Time Save Control

- Cooling Operation only.

### 30 Minutes Time Save Control

- Heating Operation only.

### Hot-Start Control

- At Heating Operation the indoor fan will operate at Lo speed when indoor heat exchanger temperature reaches 30°C.

### Anti Cold Draft Control

- The indoor fan operates at SSLo when the indoor heat exchanger temperature is low.

## Outdoor Unit

**CU-A75KR / CU-A95KR**



### **Compressor Reverse Rotation Protection Control**

- To protect compressor from reverse rotation when there is a instantaneous power failure.

### **Overload Protector**

- 2-Stage OLP to protect the compressor. Overload Protector will trip when
  - Temperature of compressor increases to 120°C.
  - High temperature or high current flows to compressor.  
(Refer circuit diagram for OLP characteristic)

### **60 Secs. Forced Operation Control**

- Once the compressor is activated, it does not stop within the first 60 secs. However, it stops immediately with remote control stop signal.

### **Outdoor Fan Operation Control**

- Inner protector.

**CU-A125KR**



### **Deice Control**

- To prevent frosting at outdoor heat exchanger. (Only for Heating Operation)
- Temperature of outdoor heat exchanger is sensed by TRS (Thermal Reed Switch). TRS OFF temperature 4°C. TRS ON temperature -3°C.

### **Overload Protection Control**

- Outdoor fan stops when indoor heat exchanger temperature rises to 51°C and above, and restarts when the indoor heat exchanger temperature drops to 49°C and below.
- Compressor stop when indoor heat exchanger temperature reaches 65°C or above. (Heating Operation Only)

### **Compressor Protection Control**

- If the outdoor fan motor is not running after compressor starts for 50 secs., compressor will stop. (Cooling and Soft Dry Operation only).

### **4-Way Valve Control**

- When the unit is switched to "OFF" during Heating Operation, 4-way valve stays at Heating position for 5 minutes.

# SAFETY PRECAUTIONS

## Before operating, please read the following “Safety Precautions” carefully.

To prevent personal injury, injury to others and property damage, the following instructions must be followed.

- Incorrect operation due to failure to follow instructions will cause harm or damage, the seriousness of which is classified as follows :



### Warning

This sign warns of death or serious injury.



### Caution

This sign warns of damage to property.

- The instructions to be followed are classified by the following symbols :



This symbol (with a white background) denotes an action that is PROHIBITED.



These symbols (with a black background) denote actions that are COMPULSORY.

## ● Installation Precautions



### Warning

- **Do not install, remove and reinstall the unit yourself.**  
Improper installation will cause leakage, electric shock or fire. Please engage an authorized dealer or specialist for the installation work.



### Caution

- **This room air conditioner must be earthed.**



Improper grounding could cause electric shock.

- **Do not install the unit in a place where there may be explosive gas leaks.**



Gas leaks near the unit could cause fires.

- **Ensure that the drainage piping is connected properly.**



Otherwise, water will leak out.



## ● Operation Precautions



### Warning

This sign warns of death or serious injury.



Do not insert plug to operate the unit.  
Do not pull out plug to stop the unit.



Plug in properly.




Do not operate with wet hands.




Use specified power cord.



Do not share outlet.

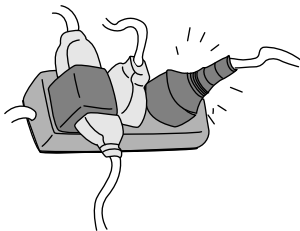

Do not repair by yourself.

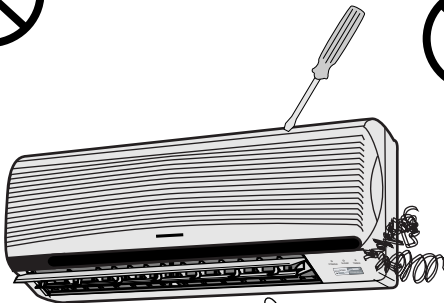


Do not damage or modify the power cord.




If abnormal condition (burnt smell, etc) occurs, switch off and unplug the power supply.



Do not insert finger or other objects into the indoor or outdoor units.

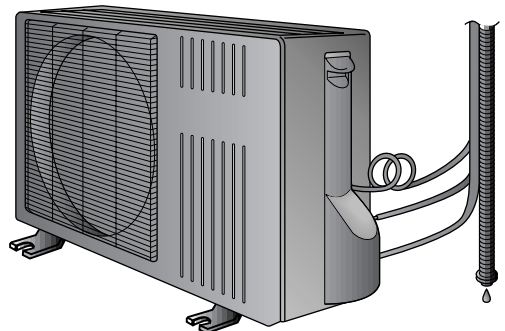

Do not exposed directly to cool air for a long period.

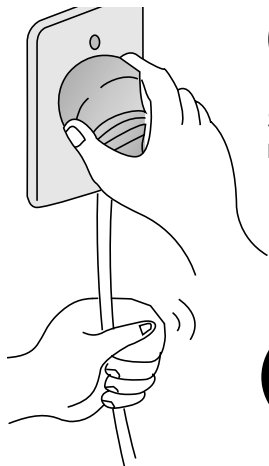

Switch off the power supply if the unit is not used for a long period.



**Caution**

This sign warns of injury.



Do not pull the cord to disconnect the plug.



Switch off the power supply before cleaning it.





Do not wash the unit with water.



Do not use for other purpose such as preservation or etc.



Do not use any combustible equipment at airflow direction.

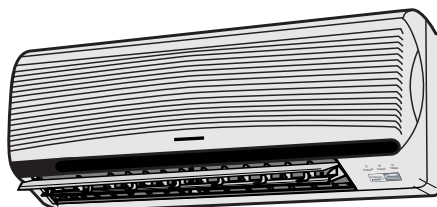


Ventilate the room regularly.



Do not sit or place anything on the outdoor unit.




Pay attention as to whether the installation rack is damaged due to long period of usage.

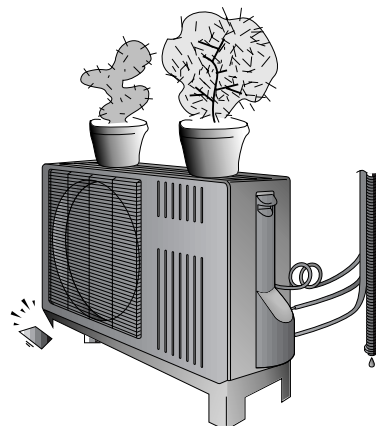


# NAME OF EACH PART


## ● Indoor Unit

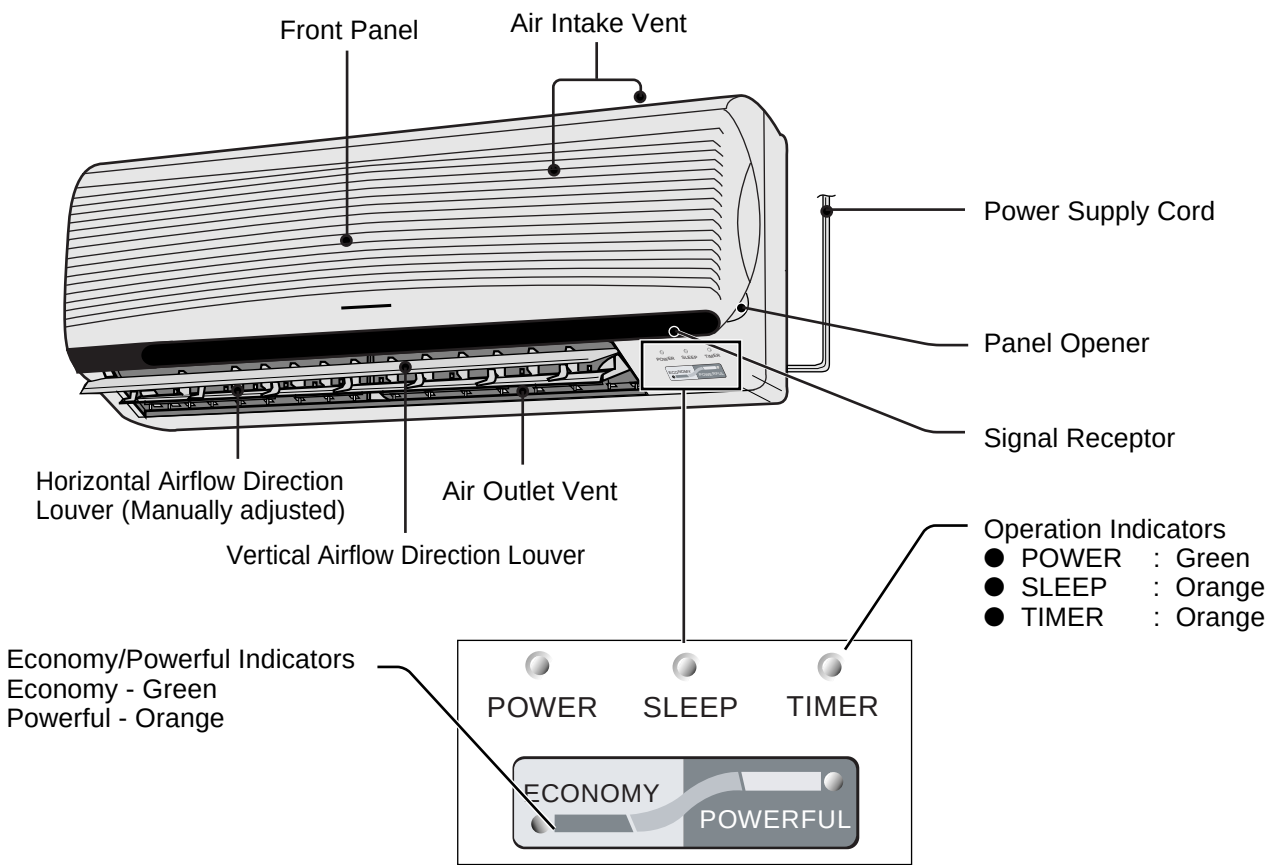


## ■ When the front panel is opened

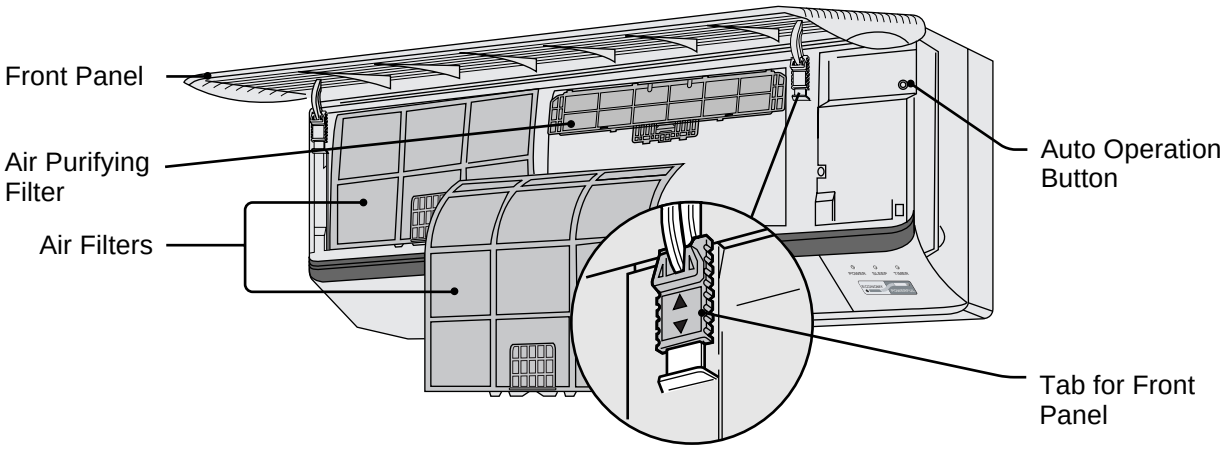


## ● Outdoor Unit

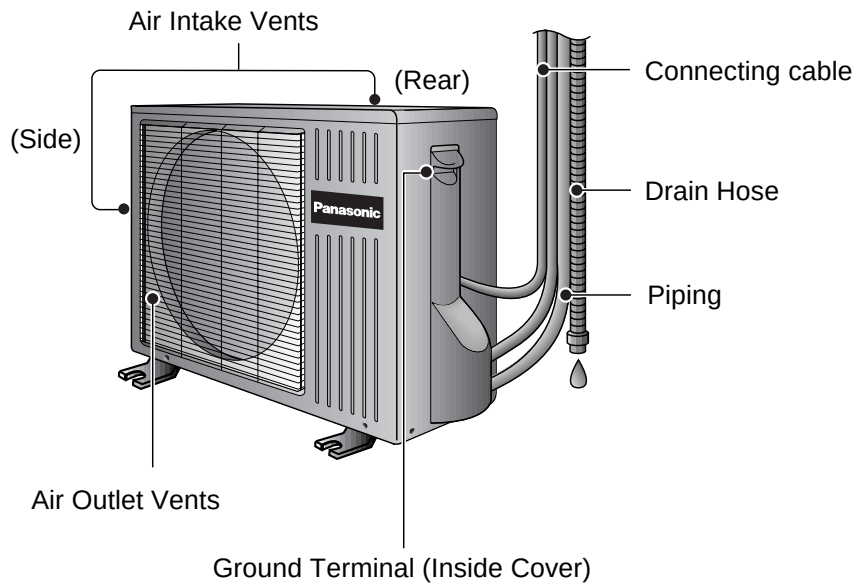


## ● Accessories

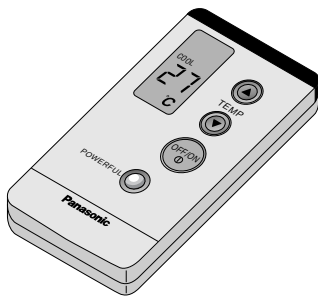



Remote Control

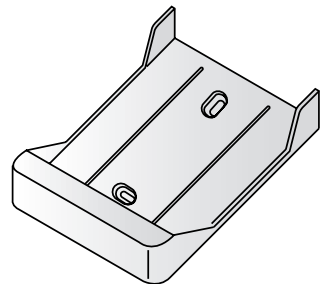

Remote Control Holder




Two RO3 (AAA) dry-cell batteries or equivalent




Air Purifying Filters  
(Catechin Air Purifying Filters and Deodorizing Filters)

## ● Remote Control

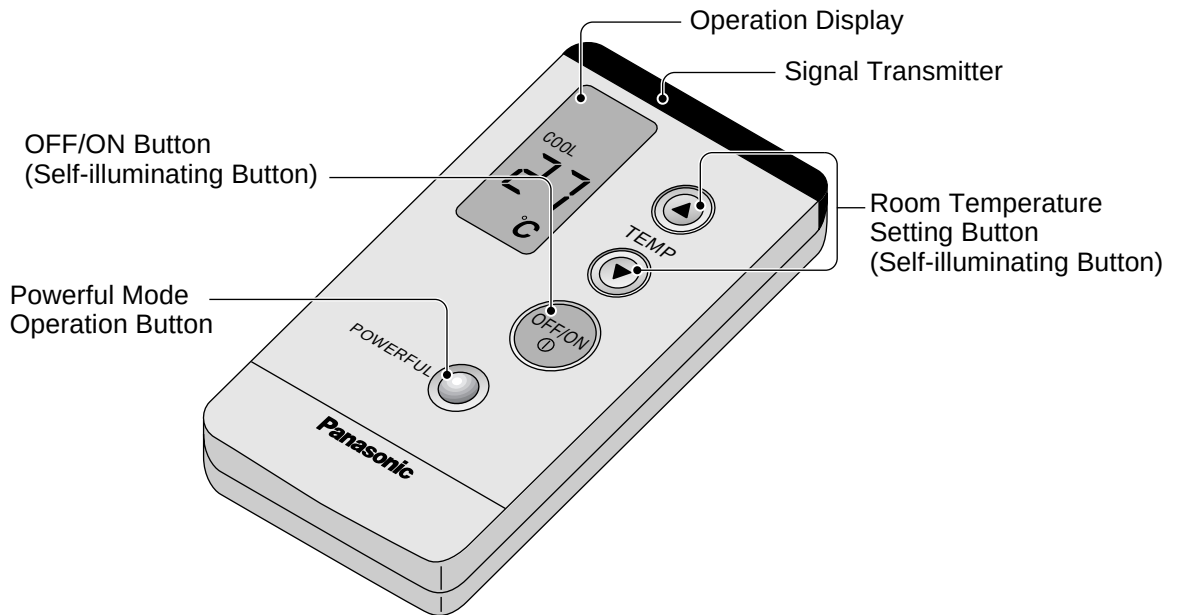


## ■ When the remote control cover is opened

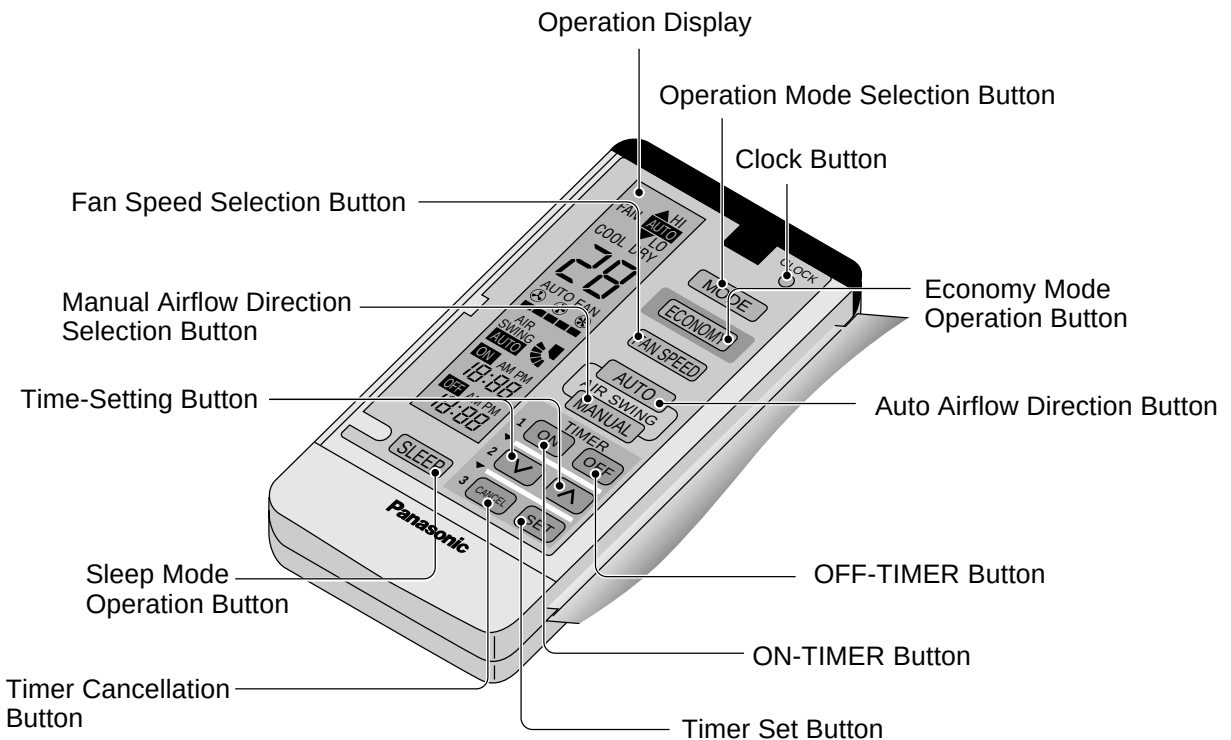

## ■ How to use the remote control

### Notes


- Do not throw or drop
- Do not get it wet
- Certain type of fluorescent lamps may affect signal reception. Consult your dealer.

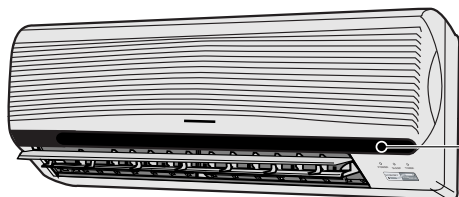

Signal receptor

- Signal received sound.  
One short beep or one long beep.

- Maximum distance : 10 m
- Make sure it is not obstructed.

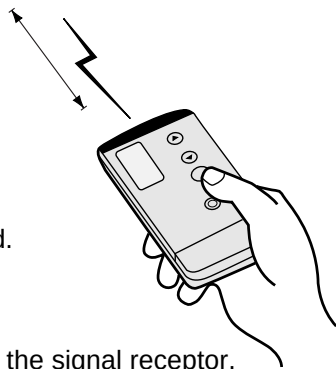


- Aim at the signal receptor.

## ■ When the back cover is opened

Reset points

- short to clear the memory

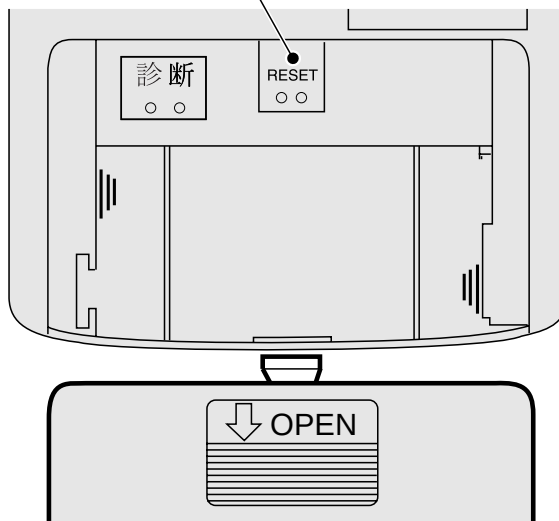


# PREPARATION BEFORE OPERATION

## Indoor Unit



### Warning

- **Ensure the power plug is securely inserted.**  
A loose plug may cause a fire or an electric shock.

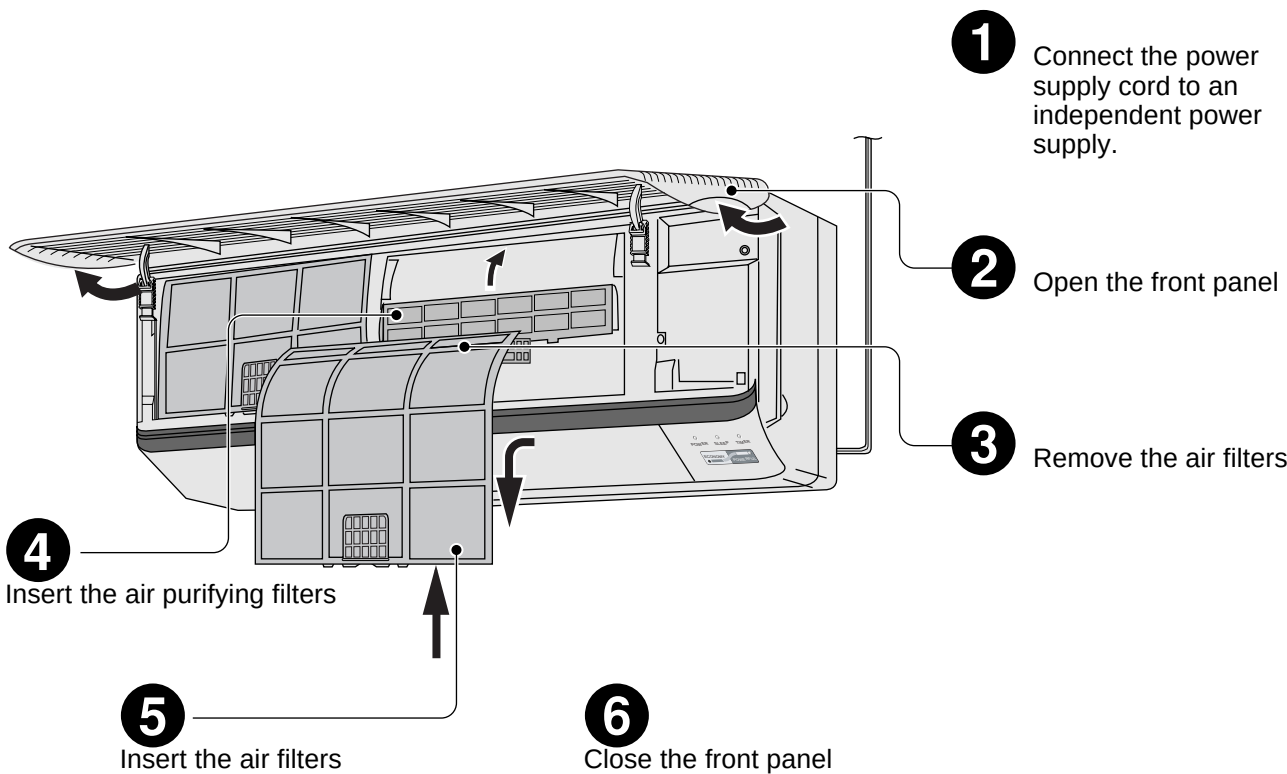


## Notes

- If the unit is not going to be used for an extended period of time, turn off the main Power supply. If it is left at the ON position, approximately 2.5 W of electricity will be used even if the indoor unit has been turned off with the remote control.
- If operation is stopped, then restart immediately, the unit will resume operation only after 3 minutes.

| Use under the following conditions (Unit in °C) |         |     |         |     |         |     |         |     |
|-------------------------------------------------|---------|-----|---------|-----|---------|-----|---------|-----|
| DBT: Dry Bulb Temp<br><br>WBT: Wet Bulb Temp    | Cooling |     |         |     | Heating |     |         |     |
|                                                 | Indoor  |     | Outdoor |     | Indoor  |     | Outdoor |     |
|                                                 | DBT     | WBT | DBT     | WBT | DBT     | WBT | DBT     | WBT |
| Maximum Temperature                             | 32      | 23  | 43      | 26  | 30      | —   | 24      | 18  |
| Minimum Temperature                             | 16      | 11  | 16      | 11  | 16      | —   | -5      | -6  |


## ● Remote Control

### ■ Inserting batteries

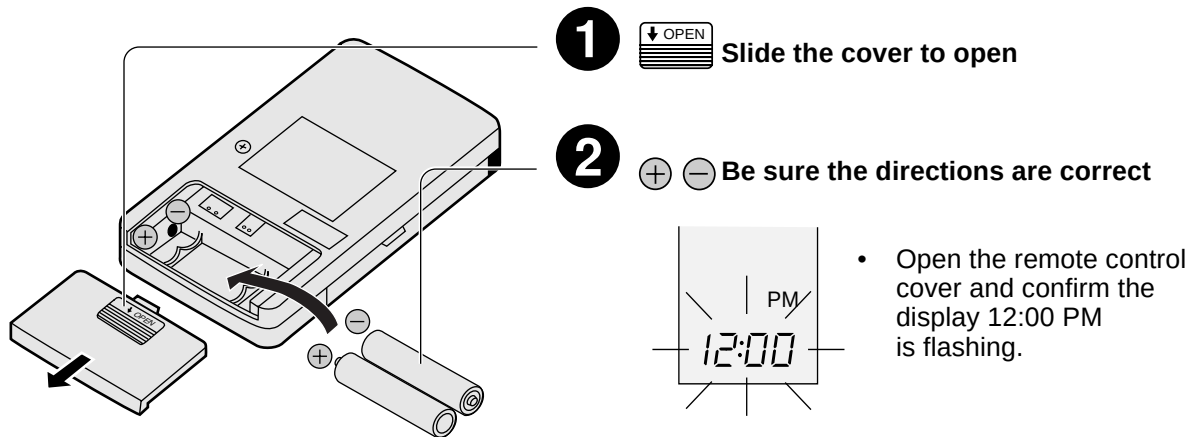

※ Set the current time (Clock) immediately to prevent battery exhaustion.

### ■ Setting the clock

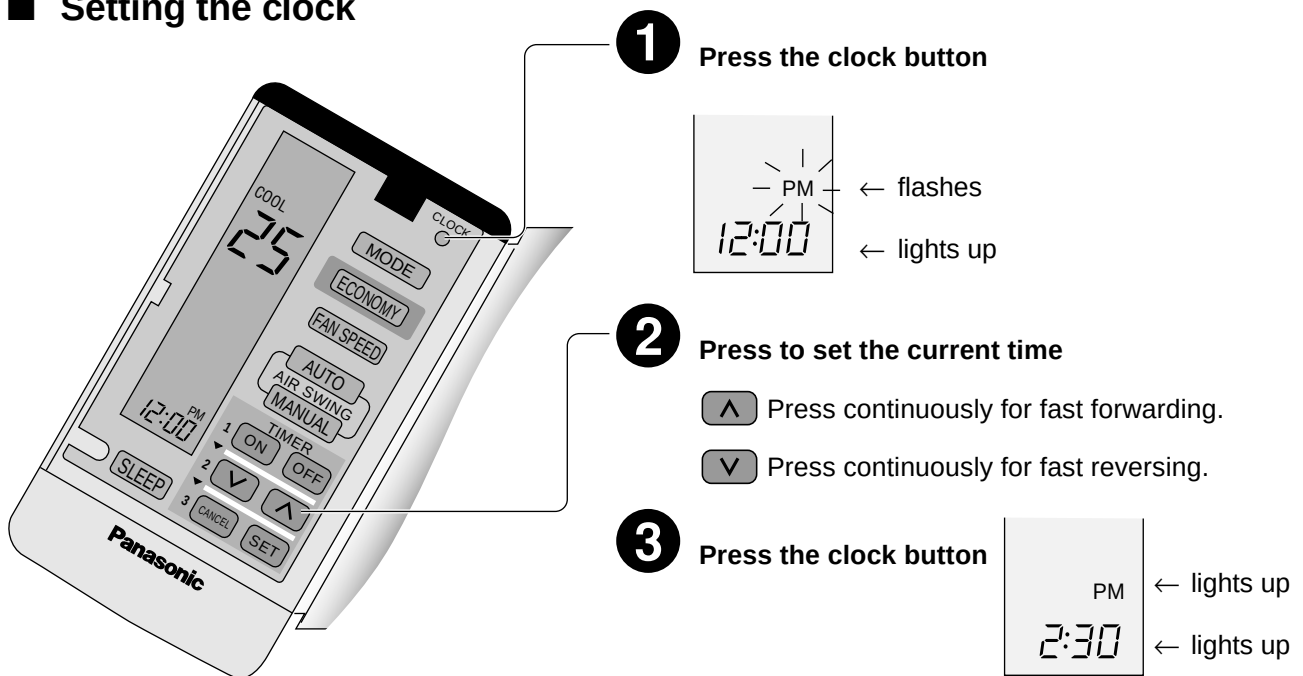

### ■ About the batteries

- Can be used for approximately one year.


Observe the following when replacing the batteries

- Replace with new batteries of the same type .
- Do not use rechargeable batteries (Ni-Cd).
- Remove the batteries if the unit is not going to be used for a long period.



# HOW TO OPERATE

## ● Automatic, Heating, Cooling, Soft Dry

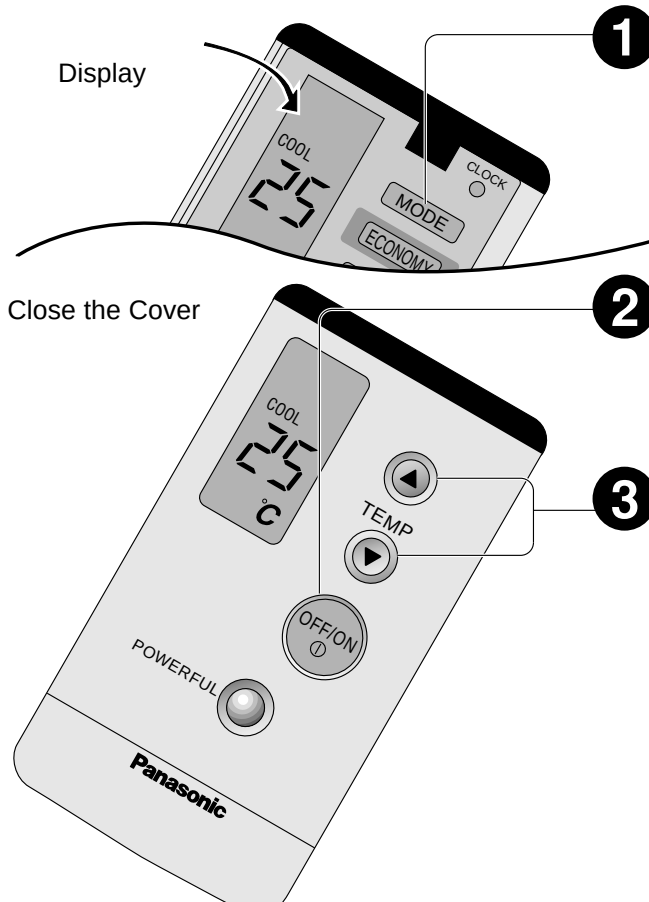

Display

Close the Cover

**1** Press to select the desired operation mode  
When pressed, the display changes in this order.

**AUTO** → **HEAT** → **COOL** → **DRY**

**2** Press to start the operation  
POWER indicator LED (Green) on indoor unit will light up.  
Press once more to stop operation.

**3** Press to select room temperature

- **AUTO** Automatic Operation  
Display
 

HI  
AUTO

 - Operation with 2°C higher than standard temperature.  

AUTO

 - Operation with standard temperature. (see operation details below)  

AUTO  
LO

 - Operation with 2°C lower than standard temperature.
- **HEAT** Heating, **COOL** Cooling, **DRY** Soft Dry operation
  - ▲ Press to increase temperature by 1°C.
  - ▼ Press to decrease temperature by 1°C.
  - The temperature can be set between 16°C and 30°C.
  - Recommended temperature  
For Heating: 20°C - 24°C.  
For Cooling: 26°C - 28°C.  
For Soft Dry: 1°C - 2°C lower than room temperature.

## ■ Operation details

### **COOL** Cooling Operation


- To set room temperature to your preference of cooling comfort.

### **AUTO** – Automatic Operation


- At the start of the automatic operation, Heating, Cooling or Soft Dry is automatically selected according to the indoor temperature.
- The operation mode changes every hour, when necessary.
- Temperature is not displayed on remote control during Auto mode operation.

### **DRY** – Soft Dry Operation

- A very gentle Cooling Operation. Consisting primarily of dehumidifying. It does not lower the room temperature.
- During Soft Dry operation, the indoor fan operates at Low fan speed.

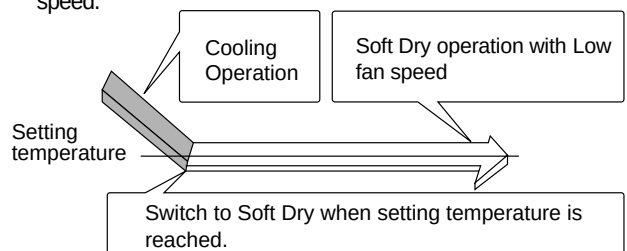


## ● Adjusting Airflow Direction And Fan Speed

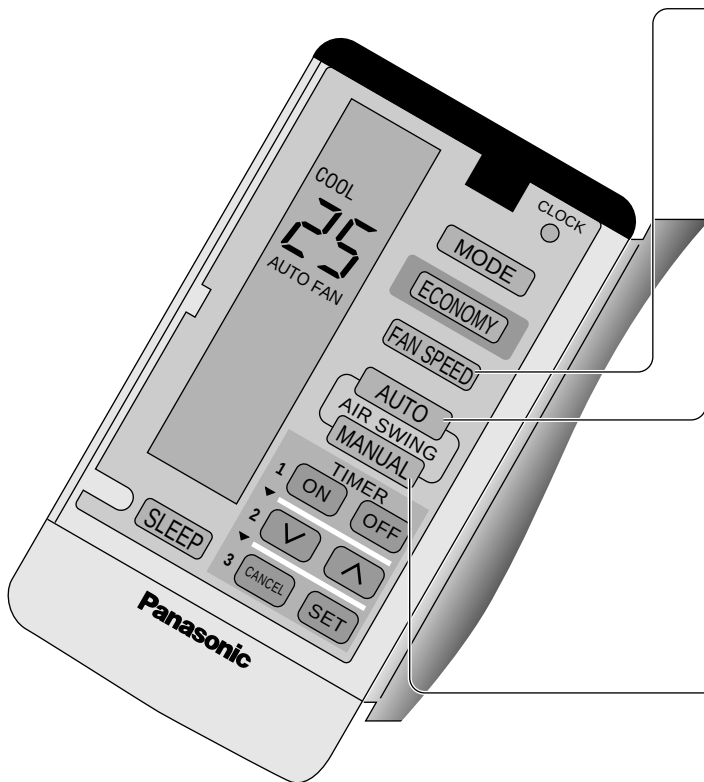

### Press to select Fan speed

- The display changes in this order

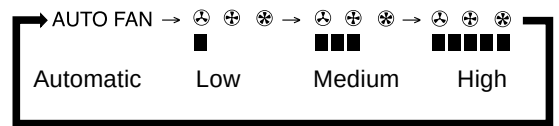


### Selecting Vertical Airflow Direction

#### Press AUTO,

- Cooling and Soft Dry – The louver swing up and down automatically.
- Heating – When the discharge air temperature is low such as at the start of heating operation, the air blows at horizontal level. As the temperature rises, the hot air blows in a downwards direction.
- To stop the automatic airflow direction operation, press **(MANUAL)** button.


#### Press MANUAL

- Manual selection of Vertical Airflow Direction Louver.
- The display changes in this order.



### Horizontal Airflow Direction

- Adjust it manually.

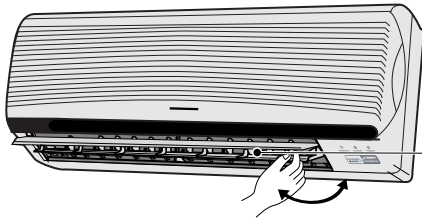

## ■ Operation details


### **HEAT** – Heating Operation

- Defrozing Operation  
Depend on the outdoor temperature, the operation occasionally stops to melt the frost on the outdoor unit.
- Heat is obtained from outdoor air to warm up the room. When the outdoor ambient air temperature falls, the heating capacity of the unit might be reduced.

### Automatic Airflow Volume

- The speed of the Indoor fan is adjusted automatically according to the operation. The Indoor fan stops occasionally during cooling operation.


### Louver adjustment range

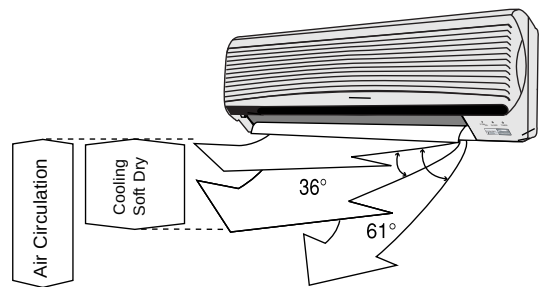

※ Five stages of adjustments can be made in this range.

# SETTING THE TIMER

Ensure that the current time is correct before setting the timer. The timer cannot be set if the time display is flashing.

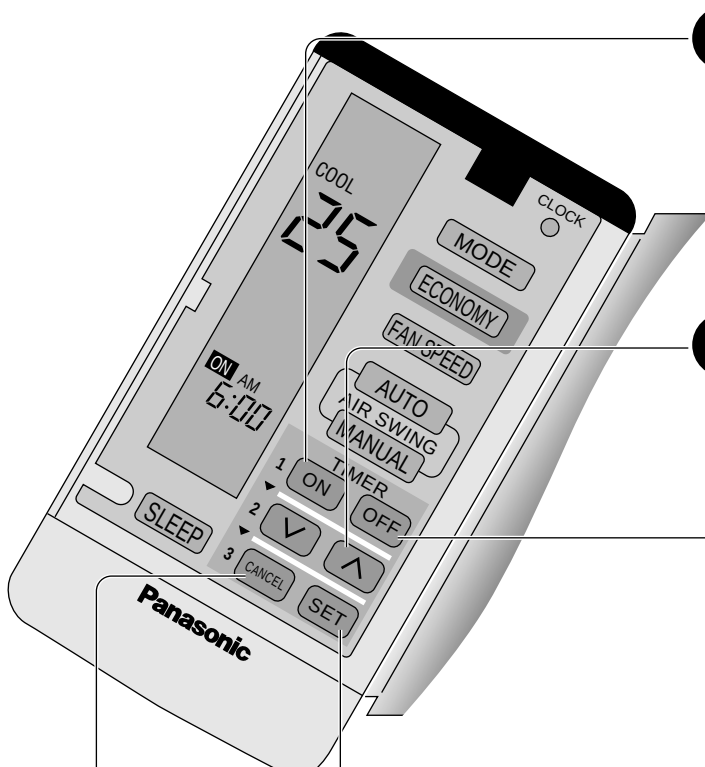

**1 Press ON-TIMER**

Flashes → 

Example: Set the ON-TIMER to 7:00AM

**2 Press to set the time**

 Increase by 10 minutes

 Decrease by 10 minutes

※ Press continuously for quick setting.

**3 Press SET**

Lights up → 

※ The timer indicator (orange) on the indoor unit will light up.

**4 To set the OFF-TIMER**

Press the OFF-TIMER then follow steps 2 and 3 as above.



■ **Timer Cancellation Button**  
(To cancel the Timer)  
Press the ON-TIMER or OFF-TIMER then press CANCEL.  
※ The timer indicator on the indoor unit will go off.

■ **To change the setting time, follow the above steps.**

## Timer details

- When the ON-Timer is set, operation will start before the actual set time. This is to allow the room temperature to reach the setting temperature by the setting time (Cooling and Soft dry, 15 minutes in advance. Heating and Automatic, 30 minutes in advance).
- Once the ON-Timer is set, operation will start at the setting time everyday.

## ● Recommended Setting of Timer

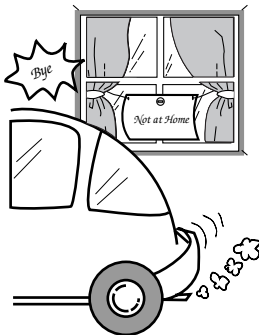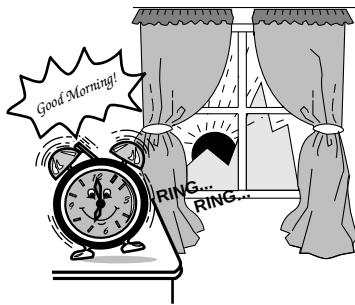

### ■ When you sleep

- Set the time at which you will go to sleep with the OFF-TIMER. This prevent wastage of electricity.

### ■ When you wake up

- Set the time at which you will wake up with the ON-TIMER. You can start the new day at a comfortable temperature.

#### Note:

(The above is an example of how you can used the OFF-TIMER and ON-TIMER mode. However it is recommended to use the sleep mode function for sleeping)

### ■ When going out

- Set the time at which you will go out with the OFF-TIMER. Set the time at which you will come back with the ON-TIMER.
- This will prevent the air conditioner from being left on while you are out, and the temperature will be pleasant when you return.

### ■ When you return

- Set the time at which you will return with the ON-TIMER.
- This will make the temperature pleasant when you return, and it will prevent the air conditioner from being left on.

## Timer details

- The current time is not displayed when the timers are set.
- When both timers are used together, the TIMER LED on the indoor unit remains lit even if the operation is stopped by the OFF-TIMER.

# CONVENIENCE OPERATION

## ● Sleep Mode


This is to obtain a comfortable room temperature while sleeping.




- To set the sleep mode, press **SLEEP**.  
✕ The sleep indicator on the indoor unit will light up.
- To cancel the sleep mode, press once more.

## ■ Operation details

- When the room temperature reaches the setting temperature, the airflow volume will automatically change to low.
- Sleep Mode Operation time is 8 hours.
- When used together with the timer, the timer has priority.

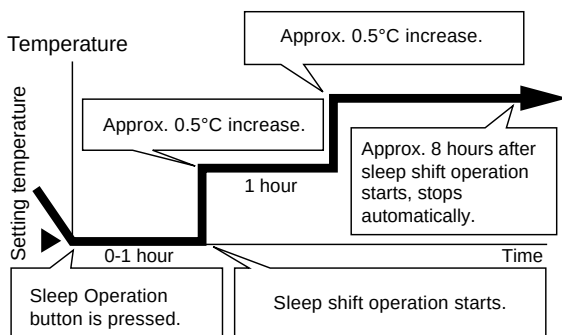


- Cooling or Soft Dry Operation for sleep mode movement will start to avoid overcooling.

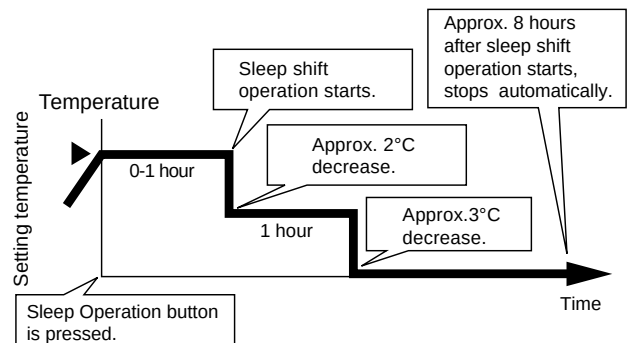

- Heating operation for sleep mode movement will start to avoid overheating.

## ● Economy or Powerful Mode

Economy and Powerful operation cannot be selected simultaneously.

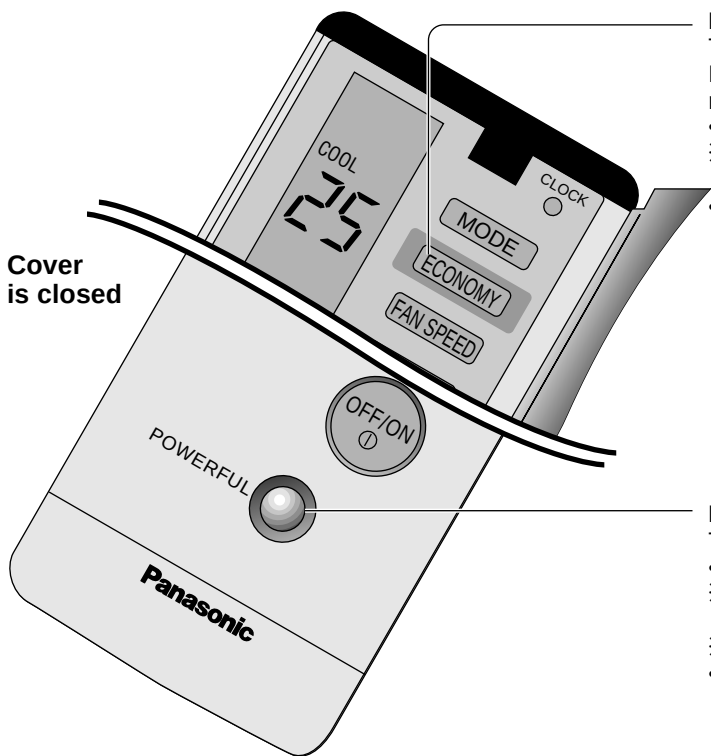

### Economy Mode

To save electrical power consumption.

However, please use this mode when the room have reached your desired temperature.

- Press ECONOMY
- ※ Economy indicator (Green) on indoor unit lights up.
- Press once more to cancel this operation.

### Powerful Mode

To obtain the setting temperature quickly.

- Press POWERFUL
- ※ Powerful indicator (Orange) on indoor unit lights up.
- ※ Powerful mode will operate for 15 minutes only.
- To cancel this operation, press once more.

## ■ Operation details


|                  | Economy operation           |                  | Powerful operation        |                |
|------------------|-----------------------------|------------------|---------------------------|----------------|
|                  | Temperature                 | Airflow volume   | Temperature               | Airflow volume |
| Cooling/Soft Dry | 0.5°C higher than set temp. | Low (on and off) | 3°C lower than set temp.  | Super High     |
| Heating          | 0.5°C lower than set temp.  | Low (on and off) | 3°C higher than set temp. | Automatic      |

- ※ • The changes of the temperature and airflow volume are automatic.
- The remote control display remain unchanged.
- If sleep button or operation mode button is pressed, economy or powerful operation is cancelled.
- During Economy mode, indoor fan operates on and off at Low speed.

# CARE AND MAINTENANCE

## ● Cleaning the Indoor Unit and Remote Control

- Wipe gently with a soft, dry cloth.
- Do not clean with water hotter than 40°C or with polishing fluids.
- The front panel can be removed and cleaned with water.

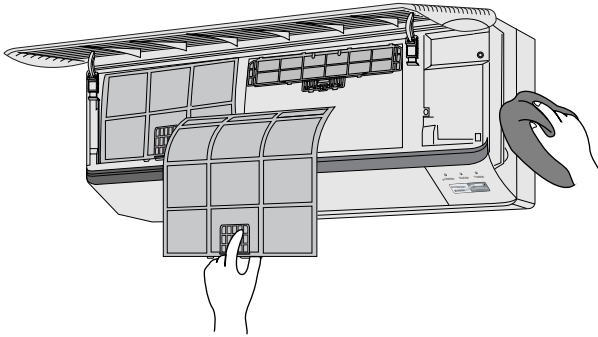

### Caution

Switch OFF and unplug the power cord before cleaning the air conditioner.




## ● Cleaning the Air Filter

(Recommendation:- If the unit is operated in a dusty environment, clean the filters every two weeks, continuous use of this dirty filters will reduce cooling efficiency)

- 1** Open the front grille and remove the two air filters. Hold the tab, lift up slightly then pull down.

- 2** Remove dirt using a vacuum cleaner.

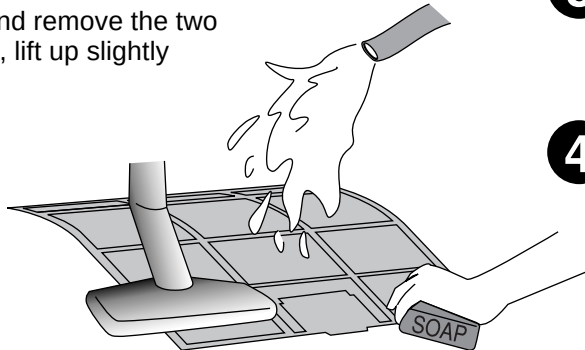

- 3** Wash back of the air filter with water.

- 4** If badly soiled, wash it with soap or a mild household detergent.



- 5** Let it dry and reinstall it. Be sure the "FRONT" mark is facing you.

✗ **Damaged air filter.**  
Consult the nearest authorized dealer.  
Part No.: CWD00240.

- Do not clean using benzene, thinner, scouring powder or cloths soaked in caustic chemicals.

## ● Cleaning the Front Panel


(Must be removed before washing)




### Caution

- Stand on a level surface when removing the front panel.
- Do not touch the metal parts in the indoor unit after removing the front panel.
- Do not leave water on the panel after cleaning. Dry thoroughly to prevent electric shock.

## ■ Removing the front panel

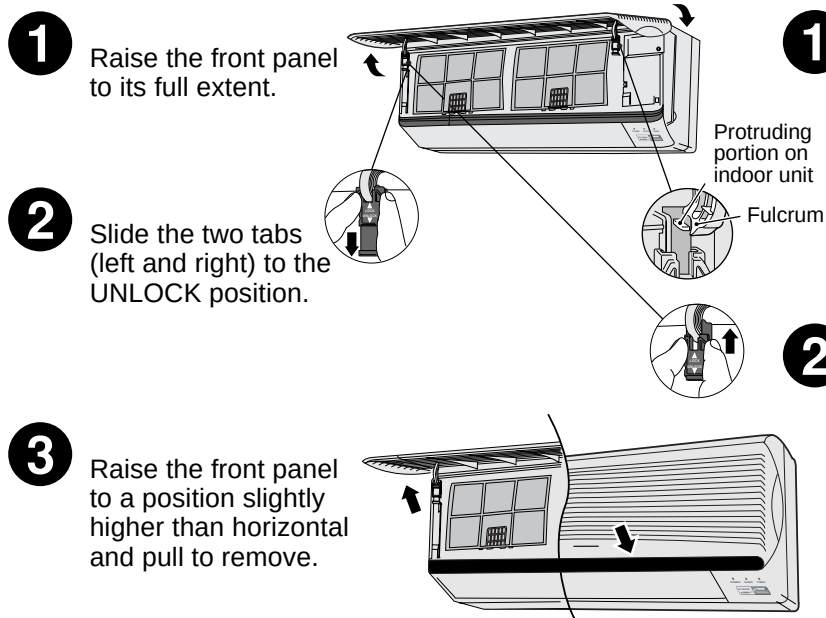


## ■ Fixing the front panel

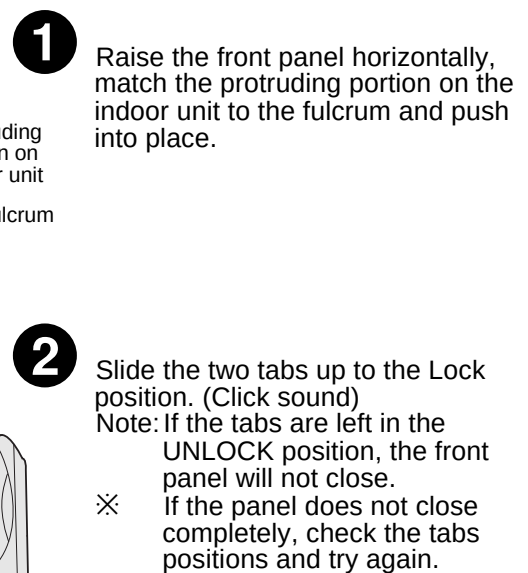

## ■ Cleaning the front panel

- Gently wash with water and a sponge.  
(Do not use a scrubbing brush or other hard cleaning aids).
- Do not press the front panel too hard when washing.  
(Excess pressure may damage the panel).
- When cleaning with kitchen cleaning fluids (neutral detergents), rinse thoroughly.  
(Do not use non neutral detergents)
- Do not dry the front panel in direct sunlight.  
(Exposure to direct sunlight may discolor or deform the panel).

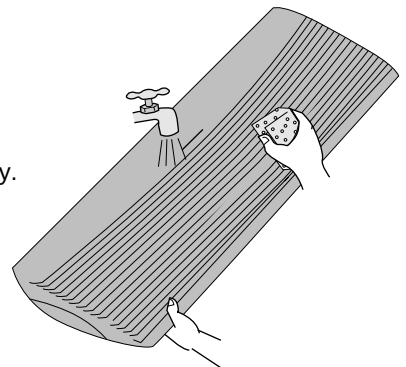




## ● Replacing the Air Purifying Filters

(Once every 3 month)

- Do not reuse dirty filters. Consult the nearest authorized dealer. (Air Purifying filter No. CZ-SFD50N)
- These filters function effectively for not more than three months.
- If the air conditioner operates with dirty filters:-
  - Air is not purified
  - Cooling capacity decreases
  - Foul odours are emitted
- Note:  
Catechin is natural brown element. The filter is coated with catechin in order to prevent the growth of bacteria and viruses.

## ■ Removing the air purifying filters

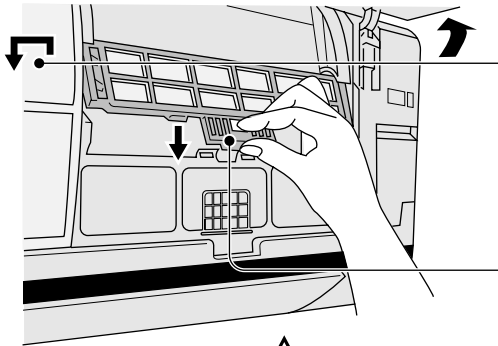


- 1** Raise the front panel to its full extent.
- 2** Remove the air filters (left and right).
  - Lift up slightly then pull down
- 3** Hold the tabs of the air purifying filters and pull.



Caution - Be careful not to hurt your hands on metal parts.

## ■ Reinstalling the air purifying filters

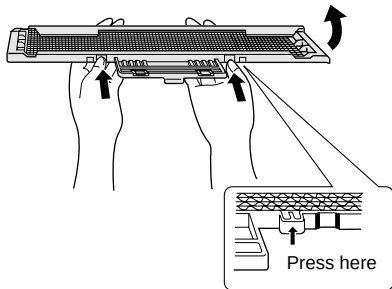


- 1** Open the filter frame to insert the new filters.
  - Deodorizing Filter (Black in colour)
  - Catechin Air Purifying Filter (Brown in colour)
- 2** Insert the new air purifying filter.  
(Be sure the "FRONT" mark is facing you)
- 3** Push until you hear a click.
- 4** Reinsert the air filters.
- 5** Close the front panel .

## ● Pre-season Inspection

- **Is the discharge air cold (warm)?**

Operation is normal if, 15 minutes after the start of operation, the temperature difference between the air intake and outlet vents is 8°C or above for cooling and 14°C or above for heating.

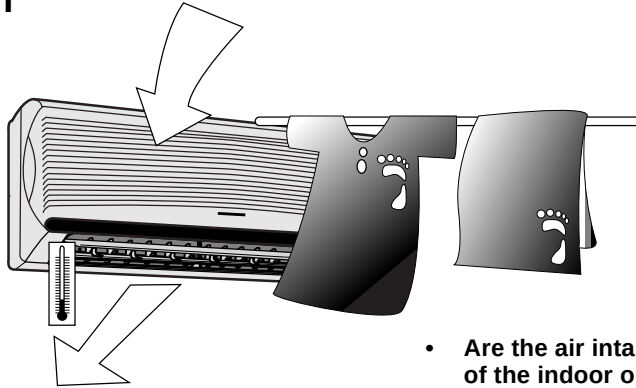

- **Are the air intake or outlet vents of the indoor or outdoor units obstructed?**

- **Are the remote control batteries weak?**


If the remote control display appears weak, replace the batteries (page 41).

## ● When the Air Conditioner is Not Used For an Extended Period of Time

**1** To dry the internal parts of the indoor unit, operate the unit for 2 - 3 hours using **COOL** operation with 30°C setting temperature.

**2** Turn off the power switch and remove the power supply plug.  
Note: If the unit is not switched off by the remote control, it will start operating when you plug in (because a Auto Restart Control is provided).

**3** Remove the remote control batteries.

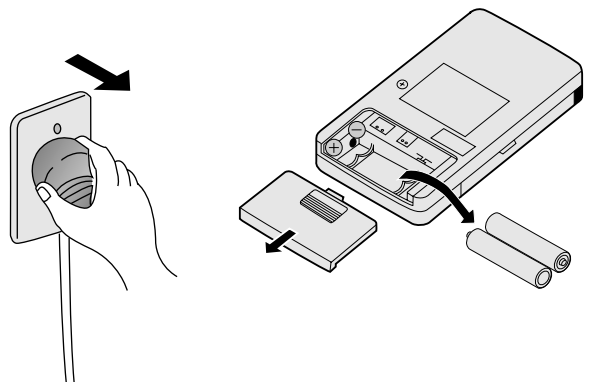

## ● Recommended Inspection

- The unit will become dirty after use over several seasons, reducing performance. Depending on the operation condition, a dirty unit may produce foul odours and dust may pollute the dehumidifying drainage.  
Seasonal inspection is recommended, in addition to regular cleaning. Consult an authorized dealer.

# TROUBLESHOOTING

## ● Normal Operation

**Q** - Is it okay?

**A** - This is the answer.

**Q** - Air conditioner has been restarted, but does not operate for 3 minutes.


**A** - This is to protect the air conditioner. Wait until the air conditioner begins operating.

**Q** - A sound like water flowing can be heard.

**A** - This is the sound of refrigerant flowing inside the air conditioner unit.

**Q** - It seems that fog is coming out from the air conditioner.

**A** - Condensation occurs when the airflow from the air conditioner cools the room air.

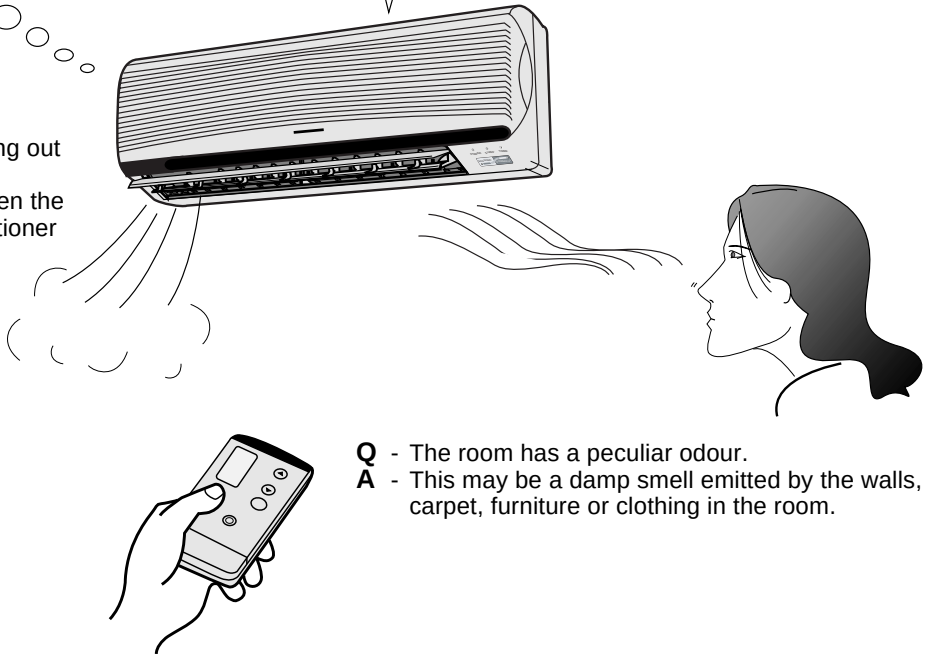

**Q** - The room has a peculiar odour.

**A** - This may be a damp smell emitted by the walls, carpet, furniture or clothing in the room.

## HEATING OPERATION

**Q** - Operation stops for about 12 minutes during heating. (The operation lamp blinks)

**A** - This is to melt the frost which has accumulated on the outdoor unit (defrosting operation). This will take no longer than about 12 minutes, so wait for operation. (Frost accumulates on the outdoor unit when the outdoor temperature is low and humidity is high.) Water comes out from the outdoor unit.

## AUTO FAN

**Q** - During Automatic Vertical Airflow setting, indoor fan stops occasionally.


**A** - This is to remove the smell emitted by the surroundings.

## HEATING OPERATION

**Q** - During heating operation, indoor fan may run at on and off conditions.

**A** - This is to prevent undesired cooling effect during heating operation.

## ● Abnormal Operation

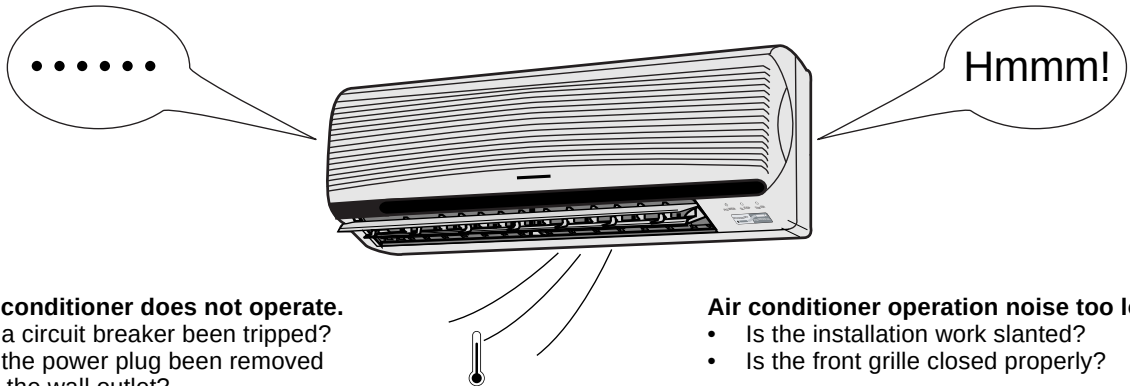

### **The air conditioner does not operate.**

- Has a circuit breaker been tripped?
- Has the power plug been removed from the wall outlet?
- Is the timer being used correctly?

### **Air conditioner operation noise too loud.**

- Is the installation work slanted?
- Is the front grille closed properly?

### **The air conditioner does not cool (warm) effectively.**

- Has the temperature been set incorrectly?
- Are the filters dirty?
- Are the intake or outlet vents of the outdoor unit obstructed?
- Are all windows and doors closed?

## ● Call the Dealer Immediately

If the following conditions occur, immediately turn off the main power supply and unplug.

- Abnormal noise is heard during operation.

- Water or foreign material gets into the remote control by mistake.

- Water leaks from the indoor unit.




- Switches or buttons do not operate properly.

- The circuit breaker switches off frequently.

- Power supply cord and plug become unusually warm.

## HELPFUL INFORMATION

### Auto Operation Button

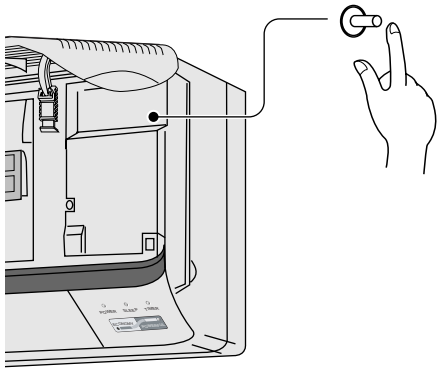

#### ■ Automatic Operation

- If the remote control fails to function or misplaced, press Auto Operation button for Automatic operation.
- The Automatic operation will be activated immediately once the Auto operation button is pressed. However, temperature cannot be adjusted in this operation.
- The power LED on the indoor unit blinks until the operation mode is selected automatically.
- To cancel this operation, press once more.

#### ■ Remote Control Signal Receiving Sound

- To switch off the beep (Signal Receiving Sound), press this Auto Operation button for 10 seconds continuously or longer.  
“Beep”, “beep” sound will be heard at the tenth seconds.  
Note: “Beep” sound will be heard at the fifth seconds;  
However please press continuously until you heard “beep”, “beep” sound.
- Repeat this, if you want to switch on the Signal Receiving Sound.


※ Note: If you press this button continuously for 5 to 10 seconds, Test Run operation will be performed. A “beep” sound will be heard at the fifth seconds, to identify the starting of Test Run operation.  
**(This is for Servicing purpose only.)**

### Auto Restart Control

- If power is resumed after a power failure, the operation will restart automatically after 3 - 5 1/2 minutes.
- Operation will be automatically restart under the previous operation mode and airflow direction when power is resumed as the operation is not stopped by remote control.


### Timer Setting

- When power failure occurs, the timer setting is cancelled. Once power is resumed, reset the timer.

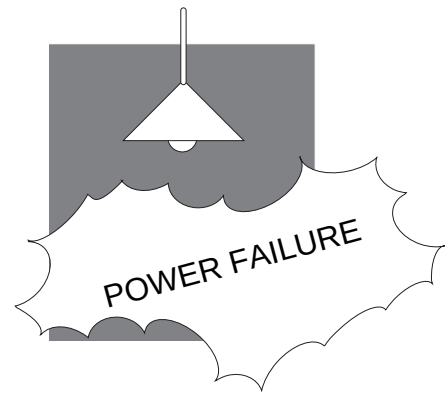

### Thunder and Lightning

- This air conditioner is equipped with a built-in surge protective device. However, in order to further protect your air conditioner from being damaged by abnormally strong lightning activity, you may switch off the main power supply and unplug from power socket.



# ENERGY SAVING AND OPERATION HINTS

## Setting Temperature

Set the temperature 1°C higher (Cooling operation) or 2°C lower (Heating operation) than actually desired. Approximately 10% of electricity costs can be saved.

## Air Filter and Air Purifying Filter

Clean the air filter every 2 weeks and change the Air Purifying Filter every 3 months. Dirty filter may reduce cooling or heating efficiency.

## Keep All Doors and Windows Closed

Otherwise, cooling and heating performance will be reduced and electricity costs are wasted.

## Outdoor Unit


Do not block the air outlet vents. Otherwise, it will lower the cooling or heating performance.

## Timer and Sleep Mode

To prevent wastage of electricity, use sleep mode when sleeping or Timer when going out to save electricity cost.

## Avoid Direct Sunlight

Keep curtains or drapes closed to keep out direct sunlight during cooling operation.

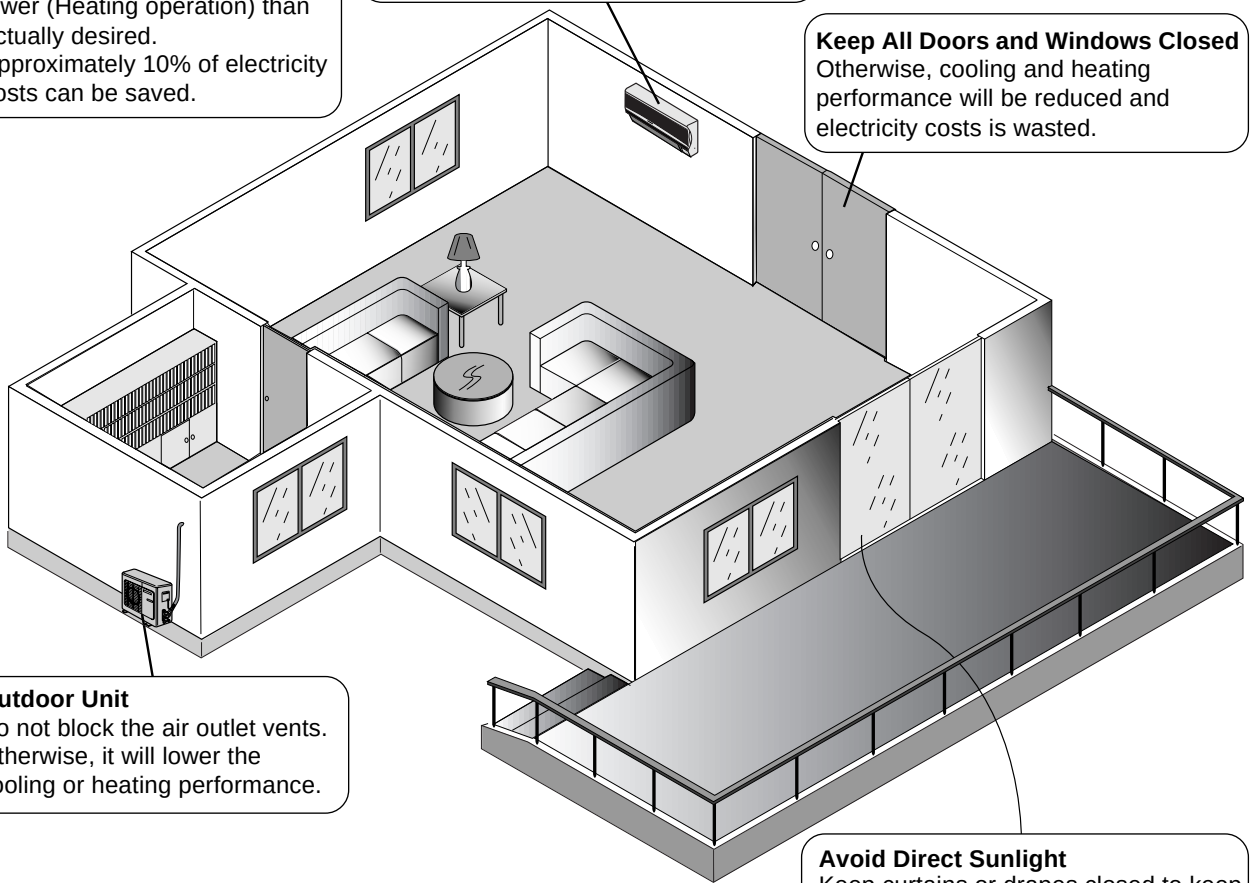



## Warning

- 1) If the supply cord is damaged or need to be replaced, it must be replaced by the manufacturer or its service agent or a similarly qualified person in order to avoid a hazard.
- 2) Remove power plug or disconnect from the mains before servicing this appliance.
- 3) Do not repair by yourself.  
In case of malfunction of this appliance, do not repair by yourself.  
Contact to the sales dealer or service dealer for a repair.
- 4) The appliance is not intended for use by young children or infirm persons without supervision.
- 5) Young children should be supervised to ensure that they do not play with the appliance.
- 6) Turn off the power (Isolation from main power supply).  
Pull off the power plug from the receptacle, or switch off the breaker, or switch off the power disconnecting mean to isolate the equipment from the main power supply in case of an emergency.



## Caution

DISCONNECT THE MAINS PLUG FROM THE SUPPLY SOCKET WHEN NOT IN USE, WHERE SUPPLY CONNECTION IS VIA MAINS PLUG.

## IMPORTANT

### 1. WHEN THE POWER CORD IS CONNECTED TO THE MAINS THROUGH A MULTI POLAR SWITCH

THERE MUST BE A MULTI POLAR SWITCH (DISCONNECTING MEANS) WITH A MINIMUM 3 mm CONTACT GAP IN THE FIXED INSTALLATION CIRCUIT.

### 2. WHEN THE POWER PLUG IS CONNECTED TO THE RECEPTACLE

Replacement or installation of power plugs shall be performed only by authorised/qualified personnels.

The wires in this main lead are coloured in accordance with the following code :

|                  |           |
|------------------|-----------|
| Green-and-yellow | : Earth   |
| Blue             | : Neutral |
| Brown            | : Live    |

If the colours of the wires in the main lead of this appliance do not correspond with the coloured markings indentifying the terminals in your plug, proceed as follows :


The green-and-yellow wire must be connected to the terminal in the plug which is marked with letter E or by the earth symbol ⊕ or coloured green or green-and-yellow.

The blue wire must be connected to the terminal which is marked with the letter N or coloured black.

The brown wire must be connected to the terminal which is marked with the letter L or coloured red.


- CS-A75KR / CU-A75KR
- CS-A95KR / CU-A95KR
- CS-A125KR / CU-A125KR

SCHEMATIC DIAGRAM 1/3

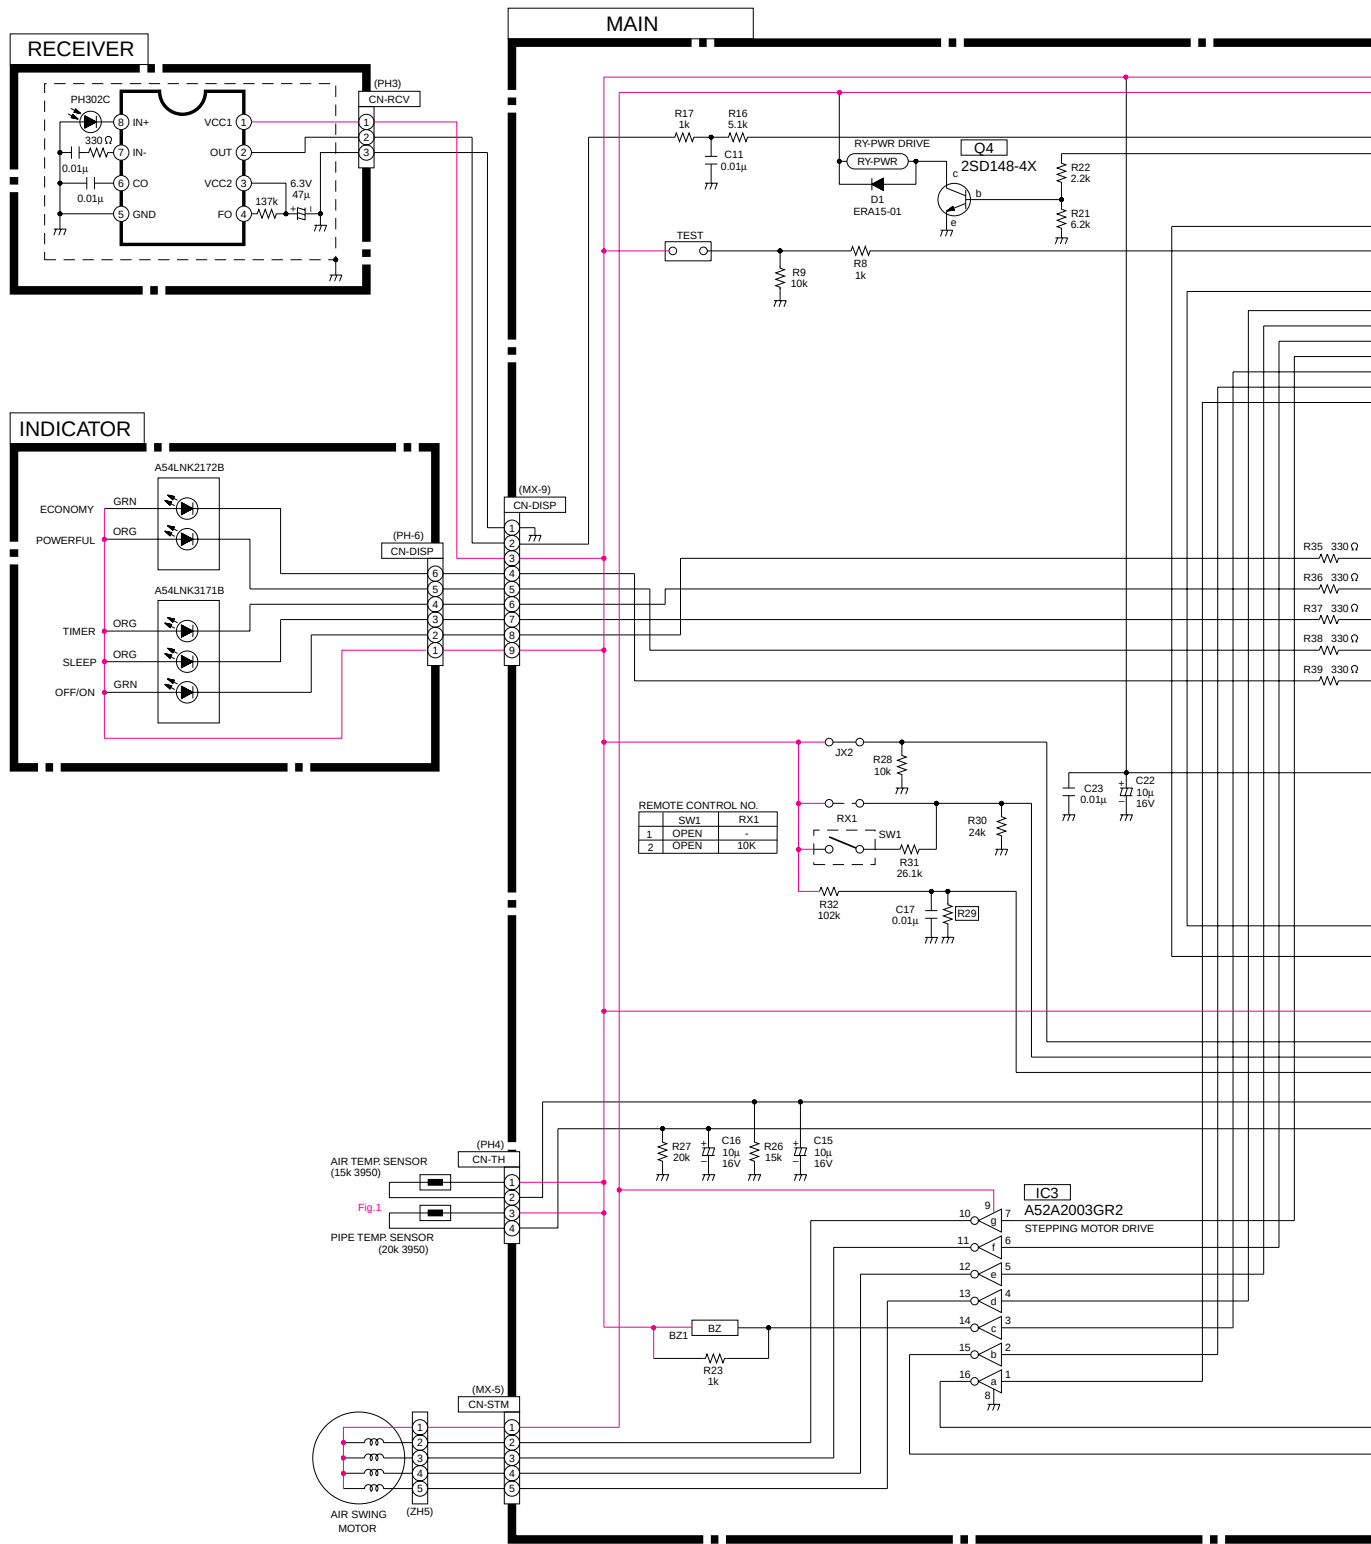



SCHEMATIC DIAGRAM 2/3

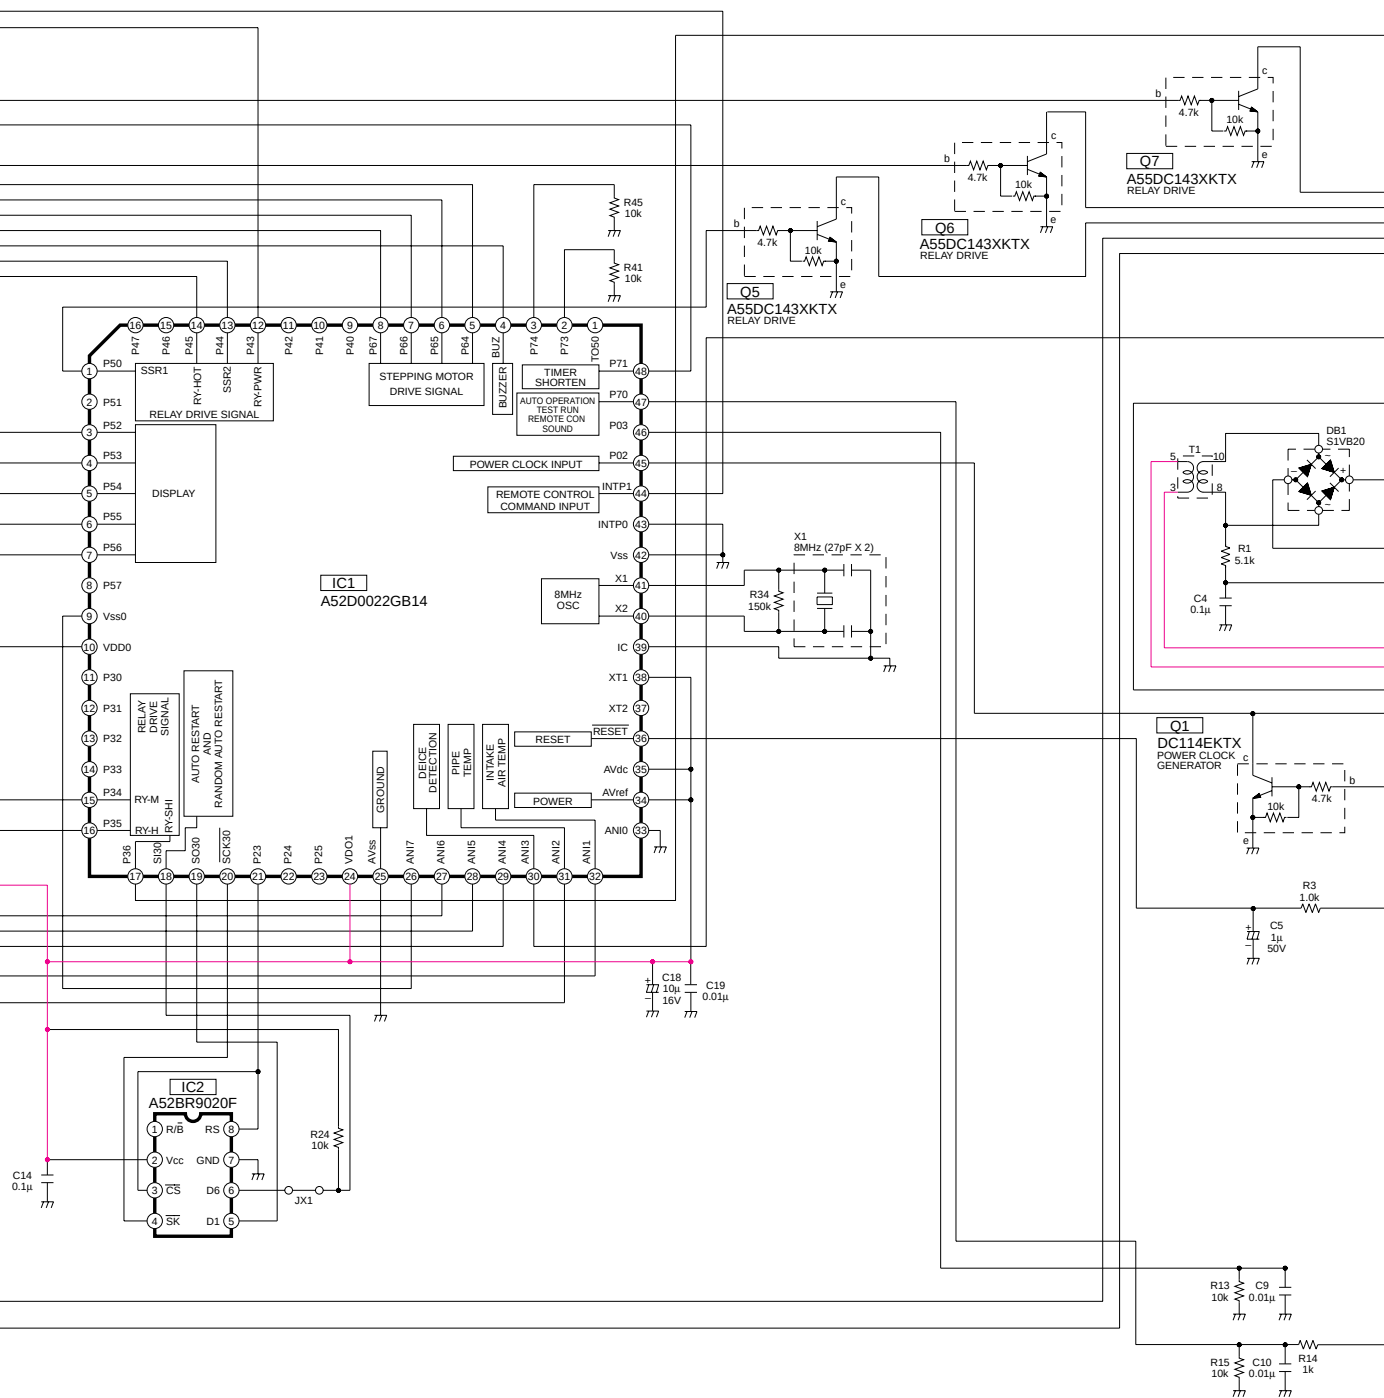

SCHEMATIC DIAGRAM 3/3

